

Civil | Structural | Geo-Environmental | Transport Planning



travis
baker

Flood Risk Assessment and Drainage Strategy

Prepared for
David Wilson Homes Mercia

Proposed Development at
Hither Green Lane, Redditch, B98 9BN

Travis Baker Ltd
Trinity Point
New Road
Halesowen
West Midlands
B63 3HY

Tel: 0121 550 8037
Fax: 0121 550 8047

info@travisbaker.co.uk
www.travisbaker.co.uk

Document Control

Project Title: Hither Green Lane, Redditch, B98 9BN

Document Type: Flood Risk Assessment and Drainage Strategy

Project Number: 21169

| Revision | Date | Comments | Prepared by | Checked by |
|----------|----------|--|-----------------|-----------------|
| - | 12.07.21 | First Issue | Mathew Grainger | Dave Baker |
| A | 20.09.21 | Redline Boundary update and Severn Trent Foul Capacity Response added. | Liam Hyland | Mathew Grainger |
| B | 22.03.22 | LLFA comments addressed | Dave Baker | Mathew Grainger |
| C | 30.11.22 | Additional LLFA comments addressed | Dave Baker | Rob Travis |
| D | 20.02.22 | Latest Site Layout incorporated | Mathew Grainger | Dave Baker |

This document has been prepared by Travis Baker Limited for the exclusive use by the commissioning party in accordance with the terms and conditions of the contract between Travis Baker Limited and the commissioning party. No other party may use, make use or rely on the contents of this report without the prior written consent of Travis Baker Limited. No liability is accepted by Travis Baker Limited for any use of this report other than for the purpose for which it was originally prepared. This document may contain and rely on information provided by Third Parties; no verification of such information has been undertaken and Travis Baker Limited accept no responsibility for any inaccuracies within such information. No part of this report may be copied or reproduced by any means without written permission from Travis Baker Limited.

The consultant's liability to the client arising out of or in connection with this document whether under the law of contract in tort (including negligence), in equity, or under statute or otherwise shall be limited to the fee paid for the preparation of this document. The consultant shall not be liable to the client in respect of any consequential or indirect loss or damage. The consultant shall be deemed to have been discharged from all liability in respect of this document whether under contract, in tort (including negligence), under statute or otherwise, on the expiration of 1 year from the completion of this document.

Contents

| | | |
|------------|--|----------|
| 1.0 | INTRODUCTION | 1 |
| 1.1 | Background to Report | 1 |
| 1.2 | Site Location and Surroundings | 1 |
| 1.3 | Brief Development Proposals | 2 |
| 2.0 | EXISTING TOPOGRAPHY AND LAND USE | 3 |
| 2.2 | Existing Drainage Provision and Run-Off | 3 |
| 2.3 | Existing Fluvial Flood Risk | 3 |
| 2.4 | Flood Risk from Other Sources | 4 |
| 3.0 | THE DEVELOPMENT PROPOSALS | 5 |
| 3.1 | Proposed Sustainable Drainage Systems | 5 |
| 3.2 | Proposed finished floor levels and flood protection | 6 |
| 3.3 | Foul Water Drainage | 6 |
| 4.0 | CONCLUSIONS | 8 |
| 4.1 | Flood Risk, Flood Consequences and Development Location | 8 |
| 5.0 | APPENDICES | 9 |

1.0 INTRODUCTION

1.1 Background to Report

1.1.1 Travis Baker were commissioned to prepare a flood risk assessment and accompanying drainage strategy in accordance with the requirements of the NPPF and local planning policy to support the planning application for a proposed 215 dwelling residential development off Hither Green Lane. The site is located at postcode B98 9BN.

1.1.2 Following the submission of the planning application the LLFA (NWWM) advised that they are broadly supportive of the principle of development but maintained a Holding Objection with the requirement for the submission of additional information. A copy of their response is in the appendices. This report was revised to include additional information to address the concerns raised which summarise as follows:

- Preserve existing drainage features and incorporate them into the layout and site landscaping
- Provide attenuation to separate sub catchments of the site rather than single large feature.
- Provide source control measures for the site.
- Undertake a Simple Index Assessment for site runoff water quality.

1.1.3 Further liaison has been undertaken with the LLFA and they have now confirmed that the drainage proposals are acceptable. A copy of their email response is in the appendices. The drainage strategy drawings have also been amended to reflect the latest round of comments.

1.2 Site Location and Surroundings

1.2.1 The centre of the site lies at grid reference SP044693 (404400, 269350).

1.2.2 The area of land to be developed is currently part of The Abbey Hotel Golf and Country Club. East of the site is Hither Green Lane and existing residential housing. The development is accessed off Hither Green Lane. North of the site is Dagnell End Road. West of the site is Meadow Farm Redditch, Marston's Inn and south of the site is the River Arrow.

1.2.3 The site falls completely within the administrative boundary of Worcestershire County Council.

1.2.4 The location of the site is shown below:



1.3 Brief Development Proposals

- 1.3.1 The proposed development will consist of 215 dwellings, access to the development is off Hither Green Lane.
- 1.3.2 The highway layout will be set to best follow the existing topography.
- 1.3.3 The development proposals are shown in the appendices.

2.0 EXISTING TOPOGRAPHY AND LAND USE


- 2.1.1** A topographical survey has been undertaken by Geoff Perry Associates, a copy of which is in the appendices.
- 2.1.2** The land is currently part of The Abbey Hotel Golf and Country Club. The land slopes generally from north to south with levels ranging from 101.50m AOD to 90.00m.
- 2.1.3** There is a large existing pond located in the north of the development, this is to be retained and slightly resized and not be used for any proposed flow attenuation.
- 2.1.4** There are smaller pools within the site and an existing car park to the northeast. The smaller pools are entirely man made and were constructed as features of the golf course, not as drainage features of the land itself.

2.2 Existing Drainage Provision and Run-Off

- 2.2.1** With reference to the topographical survey and Severn Trent Water sewer records there is an existing combined sewer to the very south of the site, running next to the river arrow.
- 2.2.2** The land falls north to south and it would appear that drainage of surface water is by overland flow and also some very shallow cut off ditches to the River Arrow.

2.3 Existing Fluvial Flood Risk

- 2.3.1** The information available from the GOV.UK website indicates that the majority of the site is within flood zone 1. However, a small proportion of the site to the south is located within Flood Zone 3 (1.0% or greater probability of flooding annually) and flood zone 2 (0.1% or greater probability of flooding annually). The flood mapping is shown below.

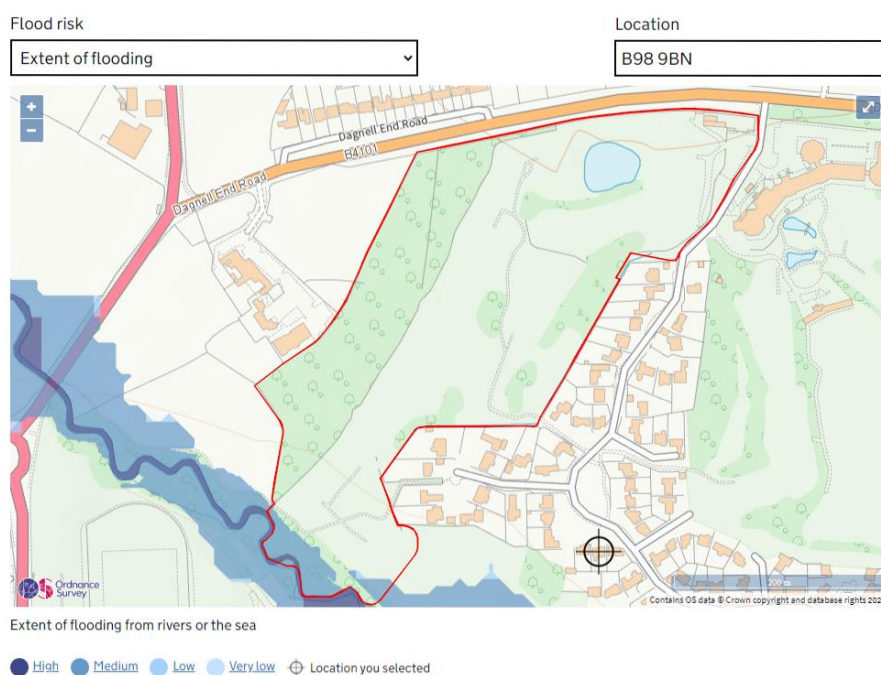

2.3.2 In order to confirm more accurately the potential for flooding to the site, a request was made to the environment Agency for flood level data in the vicinity of the site. A copy of their response Product 4 (Detailed Flood Risk Data) for flood data for the development adjacent to the River Arrow, Redditch. Ref 212168. Date 24th June 2021 is in the appendices.

2.3.3 The level data provided has been integrated and interpolated. The flood levels nearest to the site are;

1% (Climate Change) = 89.000m – 88.600m


0.5% = 89.100m – 88.700m

2.3.4 These levels have been transposed onto the drainage strategy drawing and as can be seen pose no threat and do not encroach into the area proposed for development.

2.3.5 A sequential test is therefore not required.

2.4 Flood Risk from Other Sources

2.4.1 The GOV.UK mapping showing the risk of surface water flooding to the site is below:

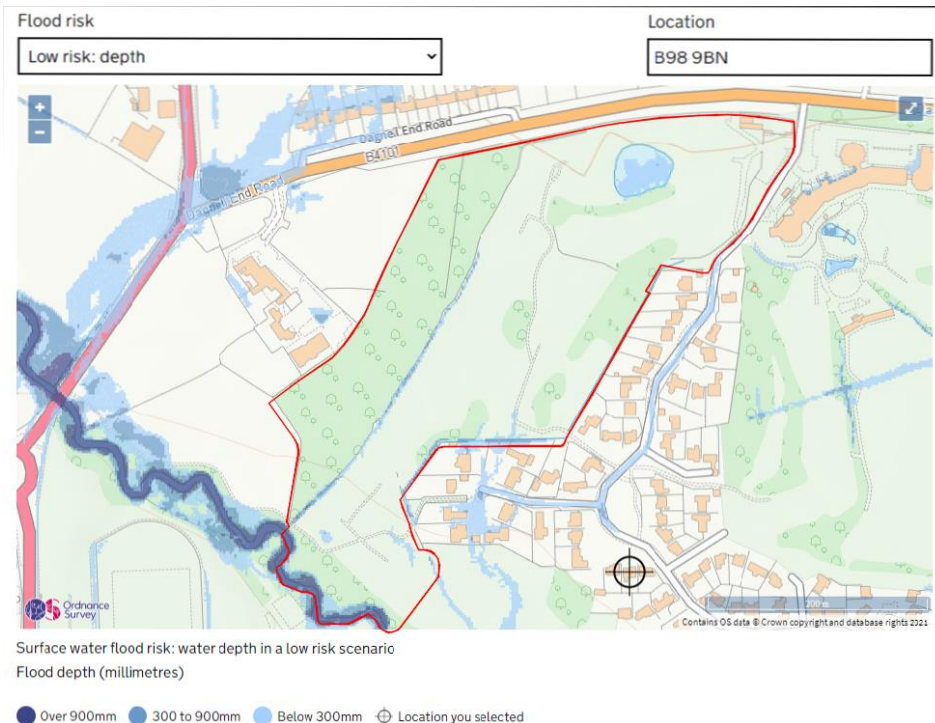

2.4.2 The areas of the site which are potentially susceptible to surface water flooding relate to the low points and small ditches within the existing site, along with the existing pond and pools. Upon redevelopment the small ditches and pools will become redundant.

3.0 THE DEVELOPMENT PROPOSALS

3.1 Proposed Sustainable Drainage Systems

3.1.1 As with any development, the first method of surface water disposal which should be investigated is by infiltration to the ground. A geo-environmental assessment has been prepared by Georisk Management Ltd. Report-no: 16101/1 states and the following;

Infiltration testing has been carried out in selected trial pits. The test results show that no significant infiltration was recorded over a timed period of approximately 4 hours and; therefore, it is considered that surface water from the development could not be effectively discharged by soakaway drainage and an alternative drainage solution will need to be sought.

3.1.2 It is therefore proposed that the disposal of surface water from the site is by positive means.

3.1.3 As described previously the existing larger pond to the north of the site will be retained. Contact has been made with the current operator of the golf course and it has been confirmed that there are no current positive surface water outfalls into or out of the pond and the water level has remained fairly constant for at least the last 10 years. It is therefore considered that the water level should not drop post development.

3.1.4 The smaller ponds located within this area of the current golf club were installed as features and hazards of the fairway / greens. They do not form part of the natural drainage sub-catchments of the area.

3.1.5 A preliminary (and subject to further detailed design) drainage strategy has been prepared by Travis Baker and is shown on drawing numbers 21169-1, 2 and 3 Preliminary Drainage Strategy and Finished Floor Levels.

3.1.6 The HR Wallingford IH124 methodology has been used to calculate the existing pre-development greenfield run-off rate for the development area. With reference to the results in the appendices, the current rate of run-off is 4.92 litres per second per hectare.

3.1.7 A total impermeable area of 4 hectares means flow attenuation will be required to limit flows to 19.6 litres per second.

3.1.8 It is proposed that the required storage will be in the form of an attenuation basin with a vortex flow control providing the flow restriction.

3.1.9 Drainage design has been developed using the Causeway FLOW hydraulic modelling software. The required volume for the attenuation basin has been calculated as 2986 cubic metres with the restricted discharge rate of 19.6 litres per second. This attenuation volume accounts for the critical 100 year + 40% rainfall events.

3.1.10 The input details and simulation results are in the appendices. These will be developed further at detailed design stage into a fully detailed model. However, at this stage, the calculations provide a robust assessment of the storage required and the ability for this to be incorporated into the development.

- 3.1.11** The attenuation basin has been designed with a varying (up to 1.2m) permanent water level along with 2m wide grass terraces to maximise biodiversity. The side slope gradients are 1:3 where grass terraces are located and 1:5 in the other areas.
- 3.1.12** As the attenuation area will be above ground and the permanent standing water will provide ecological and amenity benefits. This will not affect the hydraulic performance of the feature. The basin will also include a sediment forebay located at the inflow headwall, which will provide initial treatment and sediment collection.
- 3.1.13** The landscaping proposals will also be designed to introduce various ecological habitats which will be attractive to animals, insects and birds etc. They will form an intrinsic part of the overall landscaping and provide areas of interest to the residents.
- 3.1.14** A number of smaller shallow basins and a conveyance swale will be incorporated into the development. These will provide an additional level of water quality treatment.
- 3.1.15** In addition to the basin some areas of hardstanding will be drained via the installation of lined permeable paving, which are shown on the drainage strategy drawing. These will also provide an additional level of water quality treatment.
- 3.1.16** In order to assess the performance of the sustainable drainage features a Simple Index Assessment (CIRIA SuDS Manual) has been undertaken using the HR Wallingford tool. Three separate assessments have been undertaken covering Rooves, Parking and Roads. The results in the appendices show that the proposed SuDS features provide adequate surface water quality management.
- 3.1.17** It is proposed that upon completion of the development the piped drainage systems upstream of the balancing pond, together with the downstream flow controls will be offered to Severn Trent Water for adoption into the public sewer network via the Section 104 adoption mechanism.
- 3.1.18** The long-term successful operation of the attenuation basin, the smaller basins and the conveyance swale will be assured as they will be maintained by a bespoke management company under the requirements of the Flood and Water Management Act. A proposed SUDS management Strategy is in the Appendices.
- 3.1.19** The ultimate fully detailed design of the systems will be subject to the vetting and approval of these bodies and also the LLFA who will be consulted when applications are made for the discharge of relevant drainage related planning conditions.

3.2 Proposed finished floor levels and flood protection

- 3.2.1** There are very small areas of the site which are potentially affected by surface water flooding but as described previously these will become redundant and not affect the development. The 215 dwellings lie wholly within flood zone 1.
- 3.2.2** Therefore, there is no requirement for proposed finished floor levels to be artificially raised above surrounding ground levels.

3.3 Foul Water Drainage

- 3.3.1** Foul water generated by the proposals will be directed to the existing combined 375mm public sewer. A new manhole will be constructed between the existing

Severn Trent Water manholes 2101 and 3001 to provide the outfall to the development.

3.3.2 Severn Trent Water have been approached for confirmation of available foul water capacity in the public foul water sewer network. A copy of their response is in the appendices.

3.3.3 Severn Trent Water were contacted with regard to the increase in plot count. A sewer capacity assessment was requested to understand if there will be an impact on the existing network. The assessment will not have an impact on the development. A copy of their response is in the appendices.

4.0 CONCLUSIONS


4.1 Flood Risk, Flood Consequences and Development Location

- 4.1.1** The proposed developable area of the site lies totally within Flood Zone 1 and are not at significant risk of flooding from surface water or other sources.
- 4.1.2** Provision for the satisfactory disposal of surface and foul water are provided for, and suitable sustainable drainage features will be included in the site proposals.
- 4.1.3** The piped drainage systems will be submitted for technical approval by STW such that a Section 104 Agreement is in place. The sewerage will ultimately be adopted into the public sewer network.
- 4.1.4** The surface water attenuation basin and downstream control structure will also be suitably and regularly maintained. This will ensure that the proposals will continue to operate as intended throughout the life of the development.
- 4.1.5** It is considered that the proposed scheme is in accordance with relevant planning policy and that approval to this application should not be withheld on flooding grounds.

5.0 APPENDICES

- Appendix 1 - Travis Baker Drawing 21169 – 1, 2 and 3 Preliminary Drainage Strategy and Finished Floor Levels
- Appendix 2 - Topographical Survey
- Appendix 3 - Environment Agency Product 4 Detailed Flood Risk Data
- Appendix 4 - HR Wallingford Greenfield Runoff Rate Calculation
- Appendix 5 - 21169 - Hither Green SW Input and Results
- Appendix 6 - SUDS Maintenance Strategy
- Appendix 7 - Severn Trent Water Development Enquiry Response and Sewer Records
- Appendix 8 – Seven Trent Water Existing Sewer Capacity Check
- Appendix 9 – Simple Index Assessments for SuDS features
- Appendix 10 – NWWM (LLFA) response

Appendix 1 – Travis Baker Drawing 21169 – 1, 2 and 3 Preliminary Drainage Strategy and Finished Floor Levels

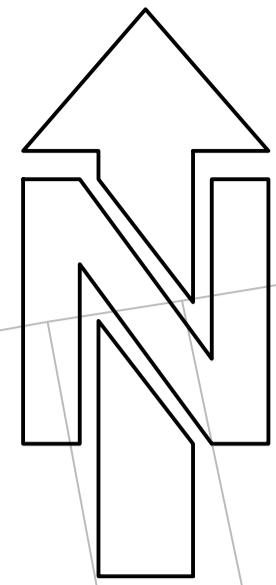

Oaktree

Greenlands

Merton House


Walcote

- DO NOT SCALE FROM THIS DRAWING. IF IN DOUBT CONTACT TRAVIS BAKER LIMITED
- ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE NOTED
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS RELATING TO THIS PROJECT
- ALL DIMENSIONS SHOULD BE CHECKED ON SITE PRIOR TO CONSTRUCTION. ANY DISCREPANCIES SHOULD BE IMMEDIATELY NOTIFIED IN WRITING TO TRAVIS BAKER LIMITED
- THE CONTRACTOR SHALL PRIOR TO CONSTRUCTION CHECK AND VERIFY THAT THE DETAILS SHOWN ON THIS DRAWING ARE FULLY COMPATIBLE WITH ANY AS CONSTRUCTED DIMENSIONS OR LEVELS. ANY DISCREPANCIES TO BE REPORTED IMMEDIATELY IN WRITING TO TRAVIS BAKER LIMITED
- THIS DRAWING HAS BEEN PREPARED FOR THE EXCLUSIVE USE OF THE COMMISSIONING PARTY AND UNLESS AGREED IN WRITING BY TRAVIS BAKER LIMITED NO OTHER PARTY MAY USE OR RELY ON ITS CONTENTS. NO LIABILITY IS ACCEPTED BY TRAVIS BAKER LIMITED FOR ANY USE OF THIS DRAWING OTHER THAN FOR THE PURPOSE FOR WHICH IT WAS ORIGINALLY PREPARED
- IT SHOULD BE NOTED THAT THIS DRAWING MAY INCLUDE DATA PROVIDED BY THIRD PARTIES. NO LIABILITY IS ACCEPTED BY TRAVIS BAKER LIMITED AS TO THE ACCURACY OF THIS DATA
- THIS DRAWING SHALL NOT BE REPRODUCED IN ANY WAY WITHOUT THE WRITTEN PERMISSION OF TRAVIS BAKER LIMITED

KEY

- SITE BOUNDARY
- FINISHED FLOOR LEVEL
- SECTION 104 ADOPTABLE SURFACE WATER SEWER
- SECTION 104 ADOPTABLE FOUL WATER SEWER
- PROPOSED EASEMENT
- SECTION 104 ADOPTABLE FLOW CONTROL
- SECTION 104 ADOPTABLE HEADWALL
- EXISTING FOUL WATER SEWER
- EXCEEDANCE FLOW ROUTES
- LINED PERMEABLE PAVING

- THE INFORMATION SHOWN ON THIS DRAWING IS PRELIMINARY ONLY AND SUBJECT TO DETAILED DESIGN.
- ROADS HAVE BEEN DESIGNED AT 300mm ABOVE EXISTING GROUND LEVEL WHERE POSSIBLE.
- PLOTS ARE PRIMARILY SET APPROX. 450mm ABOVE EXISTING GROUND LEVEL HOWEVER ADJUSTED TO TIE IN TO THE ROAD DESIGN.
- THE DRAINAGE HAS BEEN DESIGNED TO 1:100YR RETURN PERIOD + 40% CLIMATE CHANGE.
- 10% URBAN CREEP HAS BEEN APPLIED TO PRIVATE IMPERMEABLE AREAS.
- ONLY SIGNIFICANT RETAINING 450mm+ IS SHOWN
- MAX GARDEN GRADIENTS ASSUMED 1:12

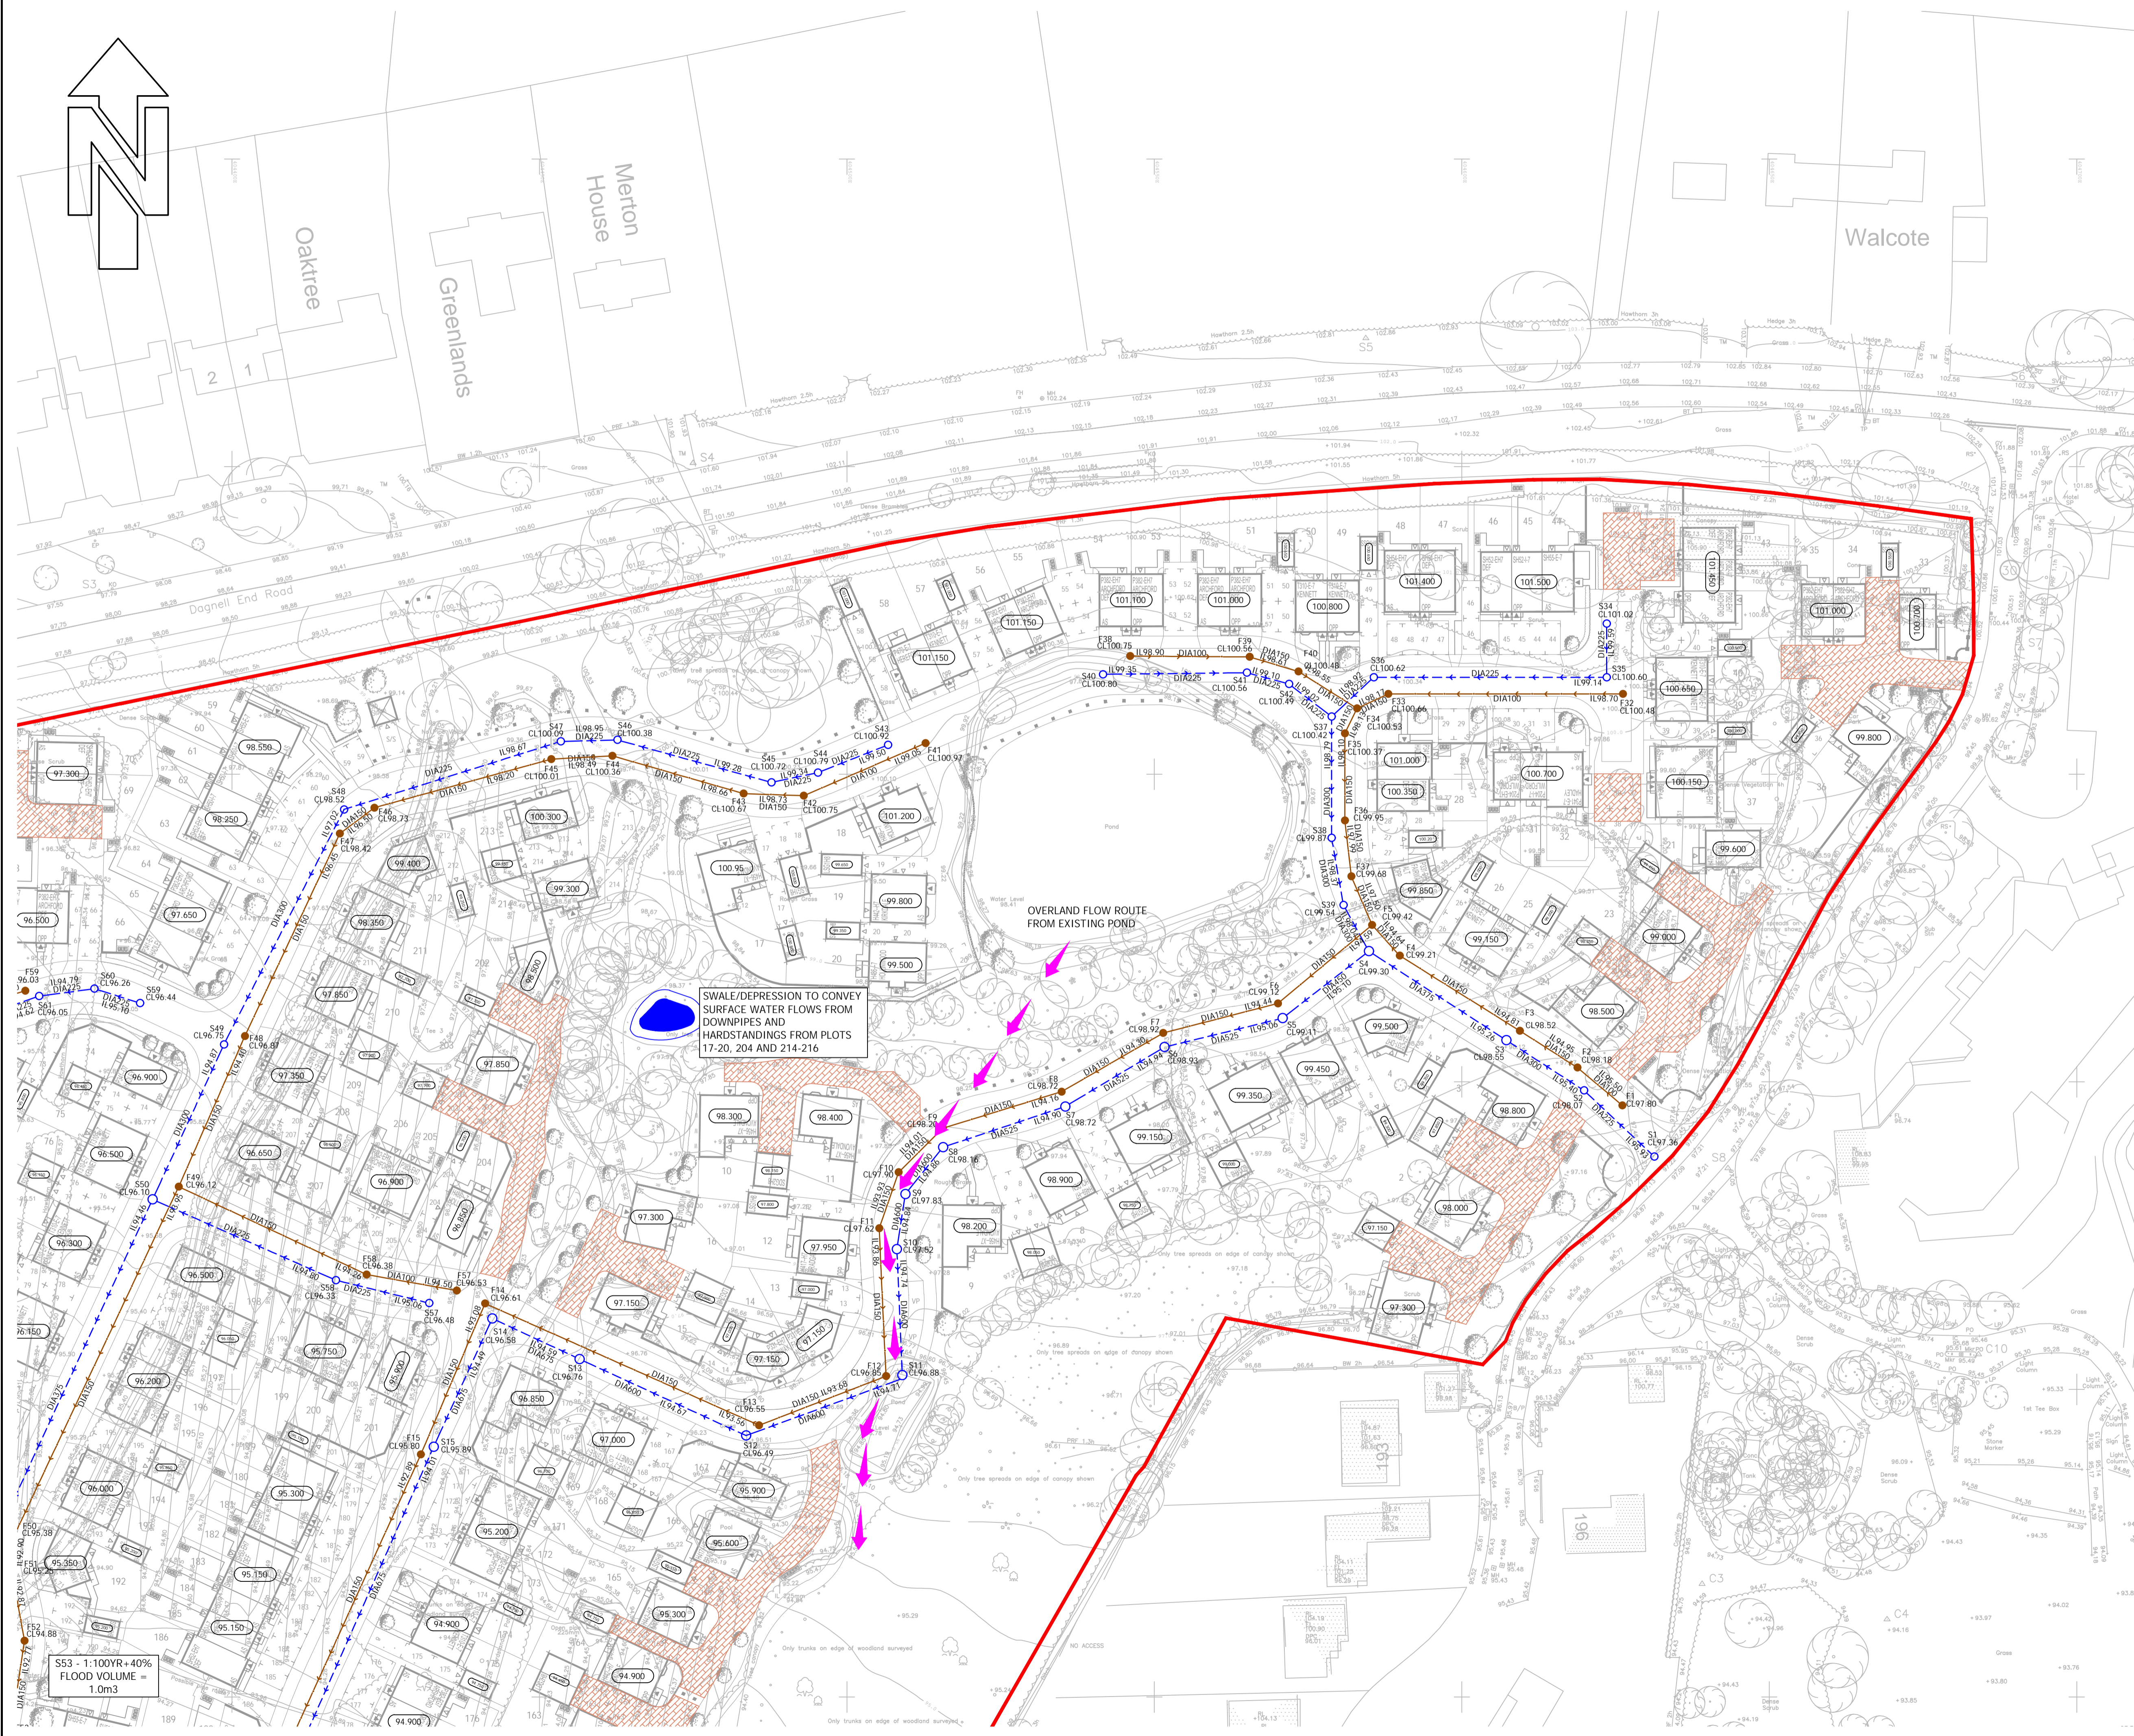

| | | | | |
|---|---|----------|----|----|
| G | LATEST LAYOUT ADDED. DRAINAGE AMENDED | 20.02.23 | TS | MG |
| F | LATEST LAYOUT ADDED. DRAINAGE AMENDED | 10.10.22 | TS | DB |
| E | NOTES AMENDED | 12.08.22 | MN | DB |
| D | STRATEGY AMENDED FOLLOWING LLFA COMMENTS | 05.07.22 | MN | DB |
| C | DRAINAGE AMENDED & FILTER DRAIN ADDED. | 23.03.22 | MG | DB |
| B | LASTEST LAYOUT ADDED. RED LINE BOUNDARY AMENDED | 20.09.21 | LH | MG |
| A | RETAINERS, TANKING AND EXPOSED BRICKWORK ADDED. | 13.08.21 | LH | MG |

| REV | DESCRIPTION | DATE | BY | AUTH |
|-----|-------------|------|----|------|
|-----|-------------|------|----|------|

Travis Baker
Trotty House
New Road
Halesowen
West Midlands
B63 3HY

Tel: 0121 550 8037
Fax: 0121 550 8047
info@travisbaker.co.uk
www.travisbaker.co.uk

CLIENT
DAVID WILSON HOMES MERCIA

PROJECT
HITHER GREEN, REDDITCH


TITLE
PRELIMINARY DRAINAGE STRATEGY AND FINISHED FLOOR LEVELS - SHEET 1

| | | | |
|-------|------------|----------|----------|
| DRAWN | AUTHORISED | SCALE | DATE |
| MG | DB | 1:500@A1 | 05.07.21 |

| | | |
|-------------|-------------|-----|
| PROJECT NO. | DRAWING NO. | REV |
| 21169 | 1 | G |

STATUS
PRELIMINARY

COPYRIGHT TRAVIS BAKER LIMITED. ALL RIGHTS RESERVED.

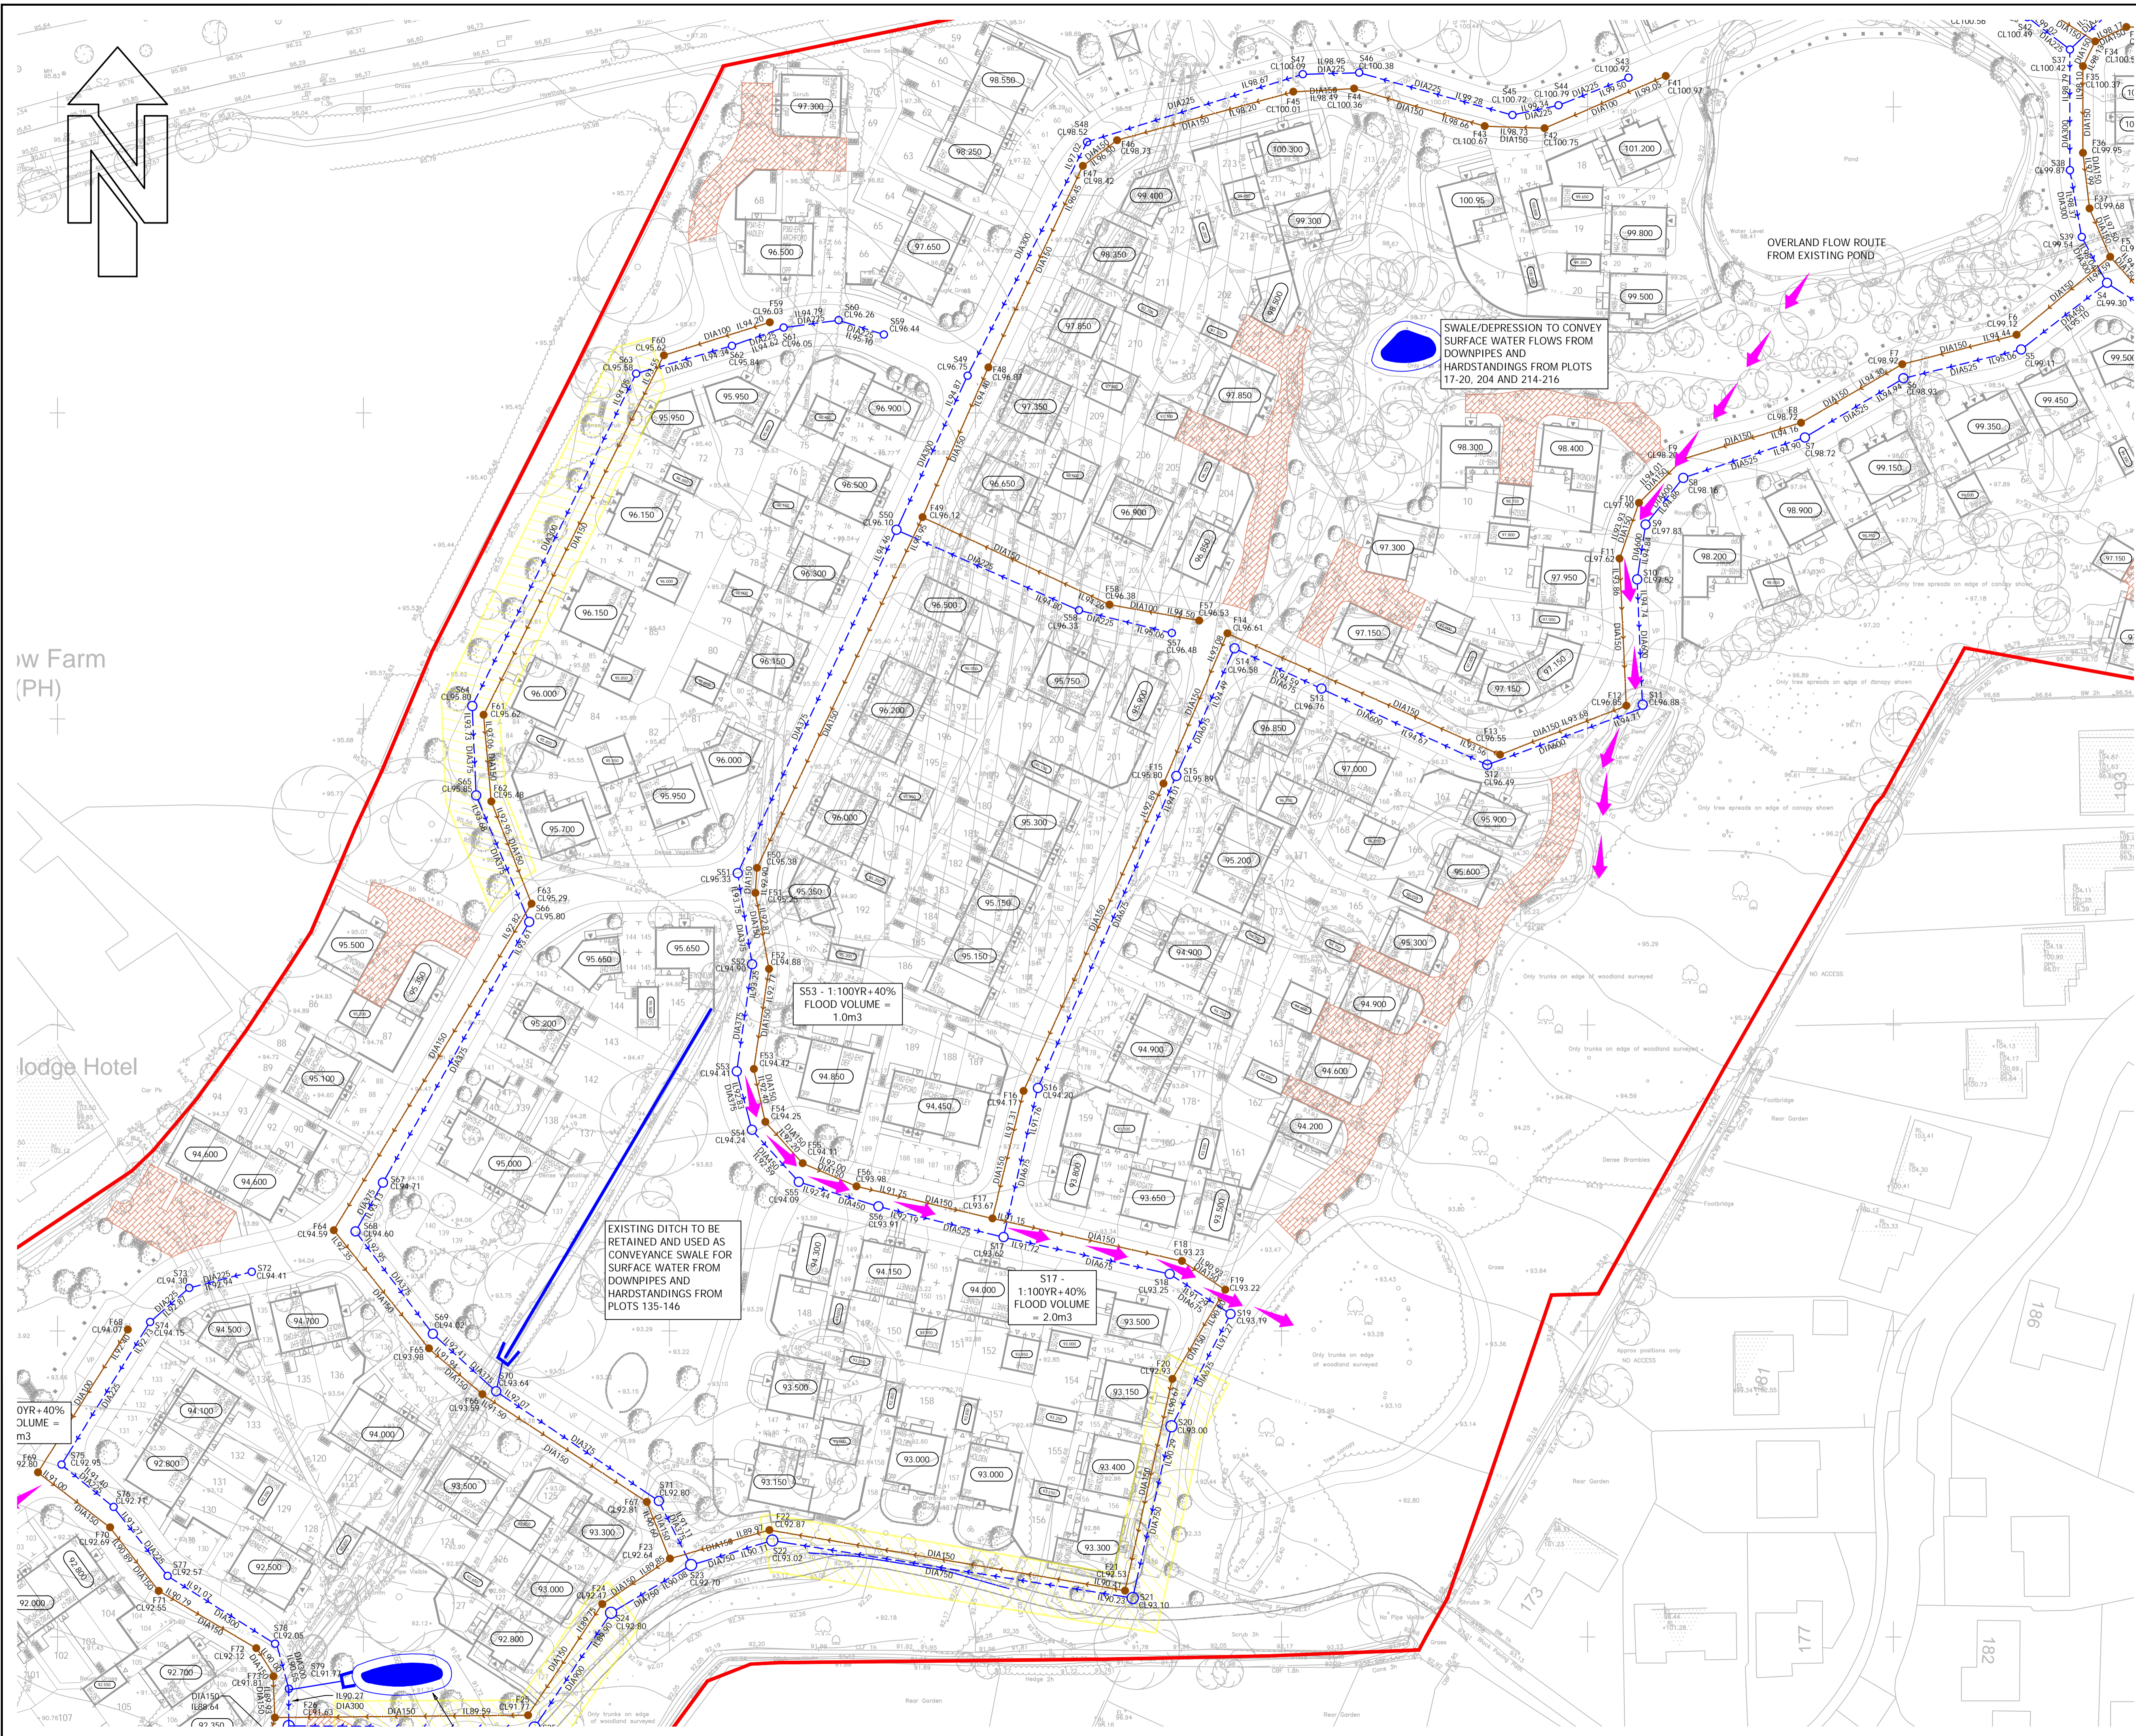

- DO NOT SCALE FROM THIS DRAWING. IF IN DOUBT CONTACT TRAVIS BAKER LIMITED.
- ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE NOTED.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS RELATING TO THIS PROJECT.
- ALL DIMENSIONS SHOULD BE CHECKED ON SITE PRIOR TO CONSTRUCTION. ANY DISCREPANCIES SHOULD BE IMMEDIATELY NOTIFIED IN WRITING TO TRAVIS BAKER LIMITED.
- THE CONTRACTOR SHALL PRIOR TO CONSTRUCTION CHECK AND VERIFY THAT THE DETAILS SHOWN ON THIS DRAWING ARE FULLY COMPATIBLE WITH ANY AS CONSTRUCTED DIMENSIONS OR LEVELS. ANY DISCREPANCIES TO BE REPORTED IMMEDIATELY IN WRITING TO TRAVIS BAKER LIMITED.
- THIS DRAWING HAS BEEN PREPARED FOR THE EXCLUSIVE USE OF THE COMMISSIONING PARTY AND UNLESS AGREED IN WRITING BY TRAVIS BAKER LIMITED NO OTHER PARTY MAY USE OR RELY ON ITS CONTENTS. NO LIABILITY IS ACCEPTED BY TRAVIS BAKER LIMITED FOR ANY USE OF THIS DRAWING OTHER THAN FOR THE PURPOSE FOR WHICH IT WAS ORIGINALLY PREPARED.
- IT SHOULD BE NOTED THAT THIS DRAWING MAY INCLUDE DATA PROVIDED BY THIRD PARTIES. NO LIABILITY IS ACCEPTED BY TRAVIS BAKER LIMITED AS TO THE ACCURACY OF THIS DATA.
- THIS DRAWING SHALL NOT BE REPRODUCED IN ANY WAY WITHOUT THE WRITTEN PERMISSION OF TRAVIS BAKER LIMITED.

KEY

- SITE BOUNDARY
- 00.000 FINISHED FLOOR LEVEL
- + SECTION 104 ADOPTABLE SURFACE WATER SEWER
- + SECTION 104 ADOPTABLE FOUL WATER SEWER
- PROPOSED EASEMENT
- + SECTION 104 ADOPTABLE FLOW CONTROL
- SECTION 104 ADOPTABLE HEADWALL
- - - EX - FWS - EX
- + EXCEEDANCE FLOW ROUTES
- LINED PERMEABLE PAVING

- THE INFORMATION SHOWN ON THIS DRAWING IS PRELIMINARY ONLY AND SUBJECT TO DETAILED DESIGN.
- ROADS HAVE BEEN DESIGNED AT 300mm ABOVE EXISTING GROUND LEVEL WHERE POSSIBLE.
- PLOTS ARE PRIMARILY SET APPROX. 450mm ABOVE EXISTING GROUND LEVEL HOWEVER ADJUSTED TO TIE IN TO THE ROAD DESIGN.
- THE DRAINAGE HAS BEEN DESIGNED TO 1:100YR RETURN PERIOD + 40% CLIMATE CHANGE.
- 10% URBAN CREEP HAS BEEN APPLIED TO PRIVATE IMPERMEABLE AREAS.
- ONLY SIGNIFICANT RETAINING 450mm+ IS SHOWN
- MAX GARDEN GRADIENTS ASSUMED 1:12

W Farm (PH)

Lodge Hotel

| REV | DESCRIPTION | DATE | BY | AUTH |
|-----|---|----------|----|------|
| G | LATEST LAYOUT ADDED. DRAINAGE AMENDED | 20.02.23 | TS | MG |
| F | LATEST LAYOUT ADDED. DRAINAGE AMENDED | 10.10.22 | TS | DB |
| E | NOTES AMENDED | 12.08.22 | MN | DB |
| D | STRATEGY AMENDED FOLLOWING LLFA COMMENTS | 05.07.22 | MN | DB |
| C | DRAINAGE AMENDED & FILTER DRAIN ADDED. | 23.03.22 | MG | DB |
| B | LATEST LAYOUT ADDED. RED LINE BOUNDARY AMENDED | 20.09.21 | LH | MG |
| A | RETAINERS, TANKING AND EXPOSED BRICKWORK ADDED. | 13.08.21 | LH | MG |

Travis Baker
 Trinity House
 New Road
 Halesowen
 West Midlands
 B63 3HY

Tel: 0121 550 8037
 Fax: 0121 550 8047
 info@travisbaker.co.uk
 www.travisbaker.co.uk

CLIENT
DAVID WILSON HOMES MERCIA



PROJECT
HITHER GREEN, REDDITCH

TITLE
PRELIMINARY DRAINAGE STRATEGY AND FINISHED FLOOR LEVELS - SHEET 2

| DRAWN | AUTHORISED | SCALE | DATE |
|-------|------------|----------|----------|
| MG | DB | 1:500@A1 | 05.07.21 |

| PROJECT NO. | DRAWING NO. | REV |
|-------------|-------------|-----|
| 21169 | 2 | G |

STATUS:
PRELIMINARY

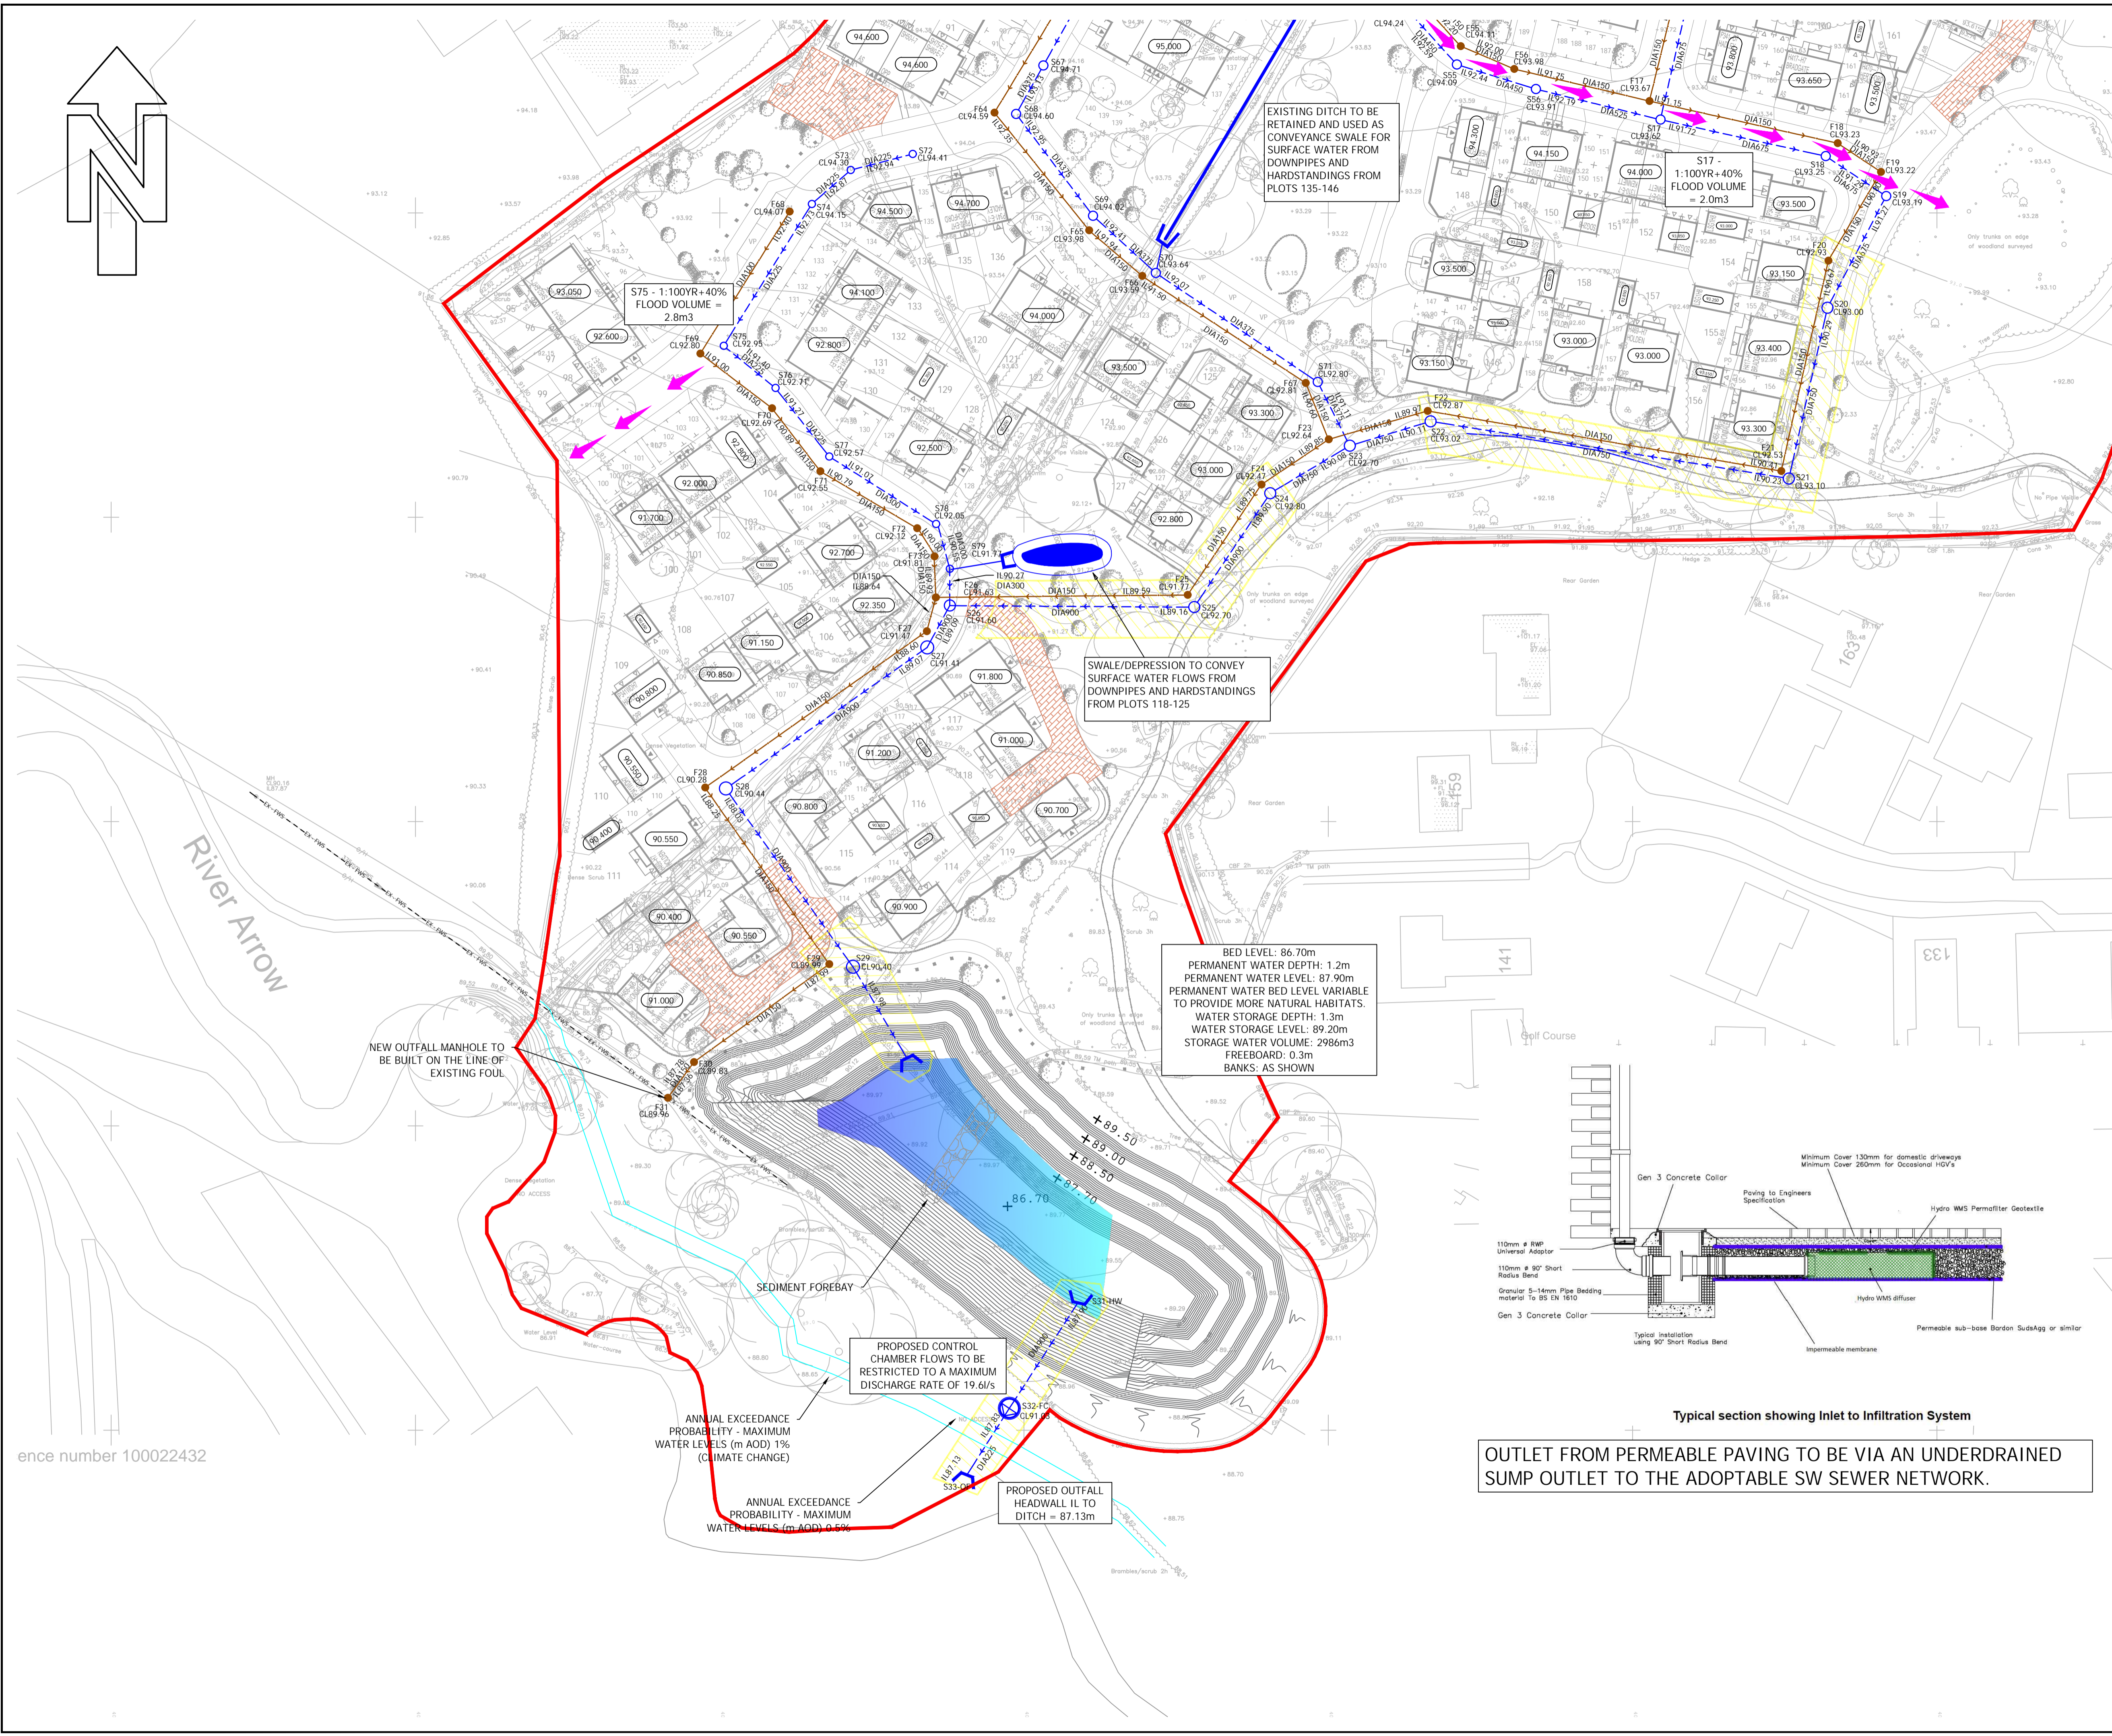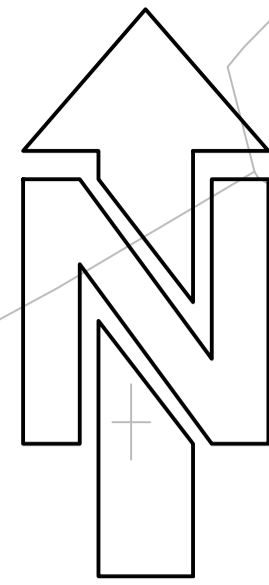

- DO NOT SCALE FROM THIS DRAWING. IF IN DOUBT CONTACT TRAVIS BAKER LIMITED
- ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE NOTED
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS RELATING TO THIS PROJECT
- ALL DIMENSIONS SHOULD BE CHECKED ON SITE PRIOR TO CONSTRUCTION. ANY DISCREPANCIES SHOULD BE IMMEDIATELY NOTIFIED IN WRITING TO TRAVIS BAKER LIMITED.
- THE CONTRACTOR SHALL PRIOR TO CONSTRUCTION CHECK AND VERIFY THAT THE DETAILS SHOWN ON THIS DRAWING ARE FULLY COMPATIBLE WITH ANY AS CONSTRUCTED DIMENSIONS OR LEVELS. ANY DISCREPANCIES TO BE REPORTED IMMEDIATELY IN WRITING TO TRAVIS BAKER LIMITED.
- THIS DRAWING HAS BEEN PREPARED FOR THE EXCLUSIVE USE OF THE COMMISSIONING PARTY AND UNLESS AGREED IN WRITING BY TRAVIS BAKER LIMITED NO OTHER PARTY MAY USE OR RELY ON ITS CONTENTS. NO LIABILITY IS ACCEPTED BY TRAVIS BAKER LIMITED FOR ANY USE OF THIS DRAWING OTHER THAN FOR THE PURPOSE FOR WHICH IT WAS ORIGINALLY PREPARED.
- IT SHOULD BE NOTED THAT THIS DRAWING MAY INCLUDE DATA PROVIDED BY THIRD PARTIES. NO LIABILITY IS ACCEPTED BY TRAVIS BAKER LIMITED AS TO THE ACCURACY OF THIS DATA.
- THIS DRAWING SHALL NOT BE REPRODUCED IN ANY WAY WITHOUT THE WRITTEN PERMISSION OF TRAVIS BAKER LIMITED.

| KEY | |
|-----|---|
| | SITE BOUNDARY |
| | FINISHED FLOOR LEVEL |
| | SECTION 104 ADOPTABLE SURFACE WATER SEWER |
| | SECTION 104 ADOPTABLE FOUL WATER SEWER |
| | PROPOSED EASEMENT |
| | SECTION 104 ADOPTABLE FLOW CONTROL |
| | SECTION 104 ADOPTABLE HEADWALL |
| | EXISTING FOUL WATER SEWER |
| | EXCEEDANCE FLOW ROUTES |
| | LINED PERMEABLE PAVING |

- THE INFORMATION SHOWN ON THIS DRAWING IS PRELIMINARY ONLY AND SUBJECT TO DETAILED DESIGN.
- ROADS HAVE BEEN DESIGNED AT 300mm ABOVE EXISTING GROUND LEVEL WHERE POSSIBLE.
- PLOTS ARE PRIMARILY SET APPROX. 450mm ABOVE EXISTING GROUND LEVEL HOWEVER ADJUSTED TO TIE IN TO THE ROAD DESIGN.
- THE DRAINAGE HAS BEEN DESIGNED TO 1:100YR RETURN PERIOD + 40% CLIMATE CHANGE.
- 10% URBAN CREEP HAS BEEN APPLIED TO PRIVATE IMPERMEABLE AREAS.
- ONLY SIGNIFICANT RETAINING 450mm+ IS SHOWN
- MAX GARDEN GRADIENTS ASSUMED 1:12

| | | | | |
|---|---|----------|----|----|
| G | LATEST LAYOUT ADDED. DRAINAGE AMENDED | 20.02.23 | TS | MG |
| F | LATEST LAYOUT ADDED. DRAINAGE AMENDED | 10.10.22 | TS | DB |
| E | NOTES AMENDED AND PERMEABLE PAVING DETAIL ADDED | 12.08.22 | MN | DB |
| D | STRATEGY AMENDED FOLLOWING LLFA | 05.07.22 | MN | DB |
| C | COMMENTS DRAINAGE AMENDED & FILTER DRAIN ADDED. AMENDED | 23.03.22 | MG | DB |
| B | LASTEST LAYOUT ADDED. RED LINE BOUNDARY AMENDED | 20.09.21 | LH | MG |
| A | RETAINERS, TANKING AND EXPOSED BRICKWORK ADDED. | 13.08.21 | LH | MG |

| REV | DESCRIPTION | DATE | BY | AUTH |
|-----|-------------|------|----|------|
|-----|-------------|------|----|------|

Travis Baker
 Trinity House
 New Road
 Halesowen
 West Midlands
 B63 3HY
 Tel: 0121 550 8037
 Fax: 0121 550 8047
 info@travisbaker.co.uk
 www.travisbaker.co.uk

CLIENT
DAVID WILSON HOMES MERCIA

PROJECT
HITHER GREEN, REDDITCH

TITLE
PRELIMINARY DRAINAGE STRATEGY AND FINISHED FLOOR LEVELS - SHEET 3


| DRAWN | AUTHORISED | SCALE | DATE |
|-------|------------|----------|----------|
| MG | DB | 1:500@A1 | 05.07.21 |

| PROJECT NO. | DRAWING NO. | REV |
|-------------|-------------|-----|
| 21169 | 3 | G |

STATUS:
PRELIMINARY

COPYRIGHT TRAVIS BAKER LIMITED. ALL RIGHTS RESERVED.

BED LEVEL: 86.70m
 PERMANENT WATER DEPTH: 1.2m
 PERMANENT WATER LEVEL: 87.90m
 PERMANENT WATER BED LEVEL VARIABLE TO PROVIDE MORE NATURAL HABITATS.
 WATER STORAGE DEPTH: 1.3m
 WATER STORAGE LEVEL: 89.20m
 STORAGE WATER VOLUME: 2986m³
 FREEBOARD: 0.3m
 BANKS: AS SHOWN

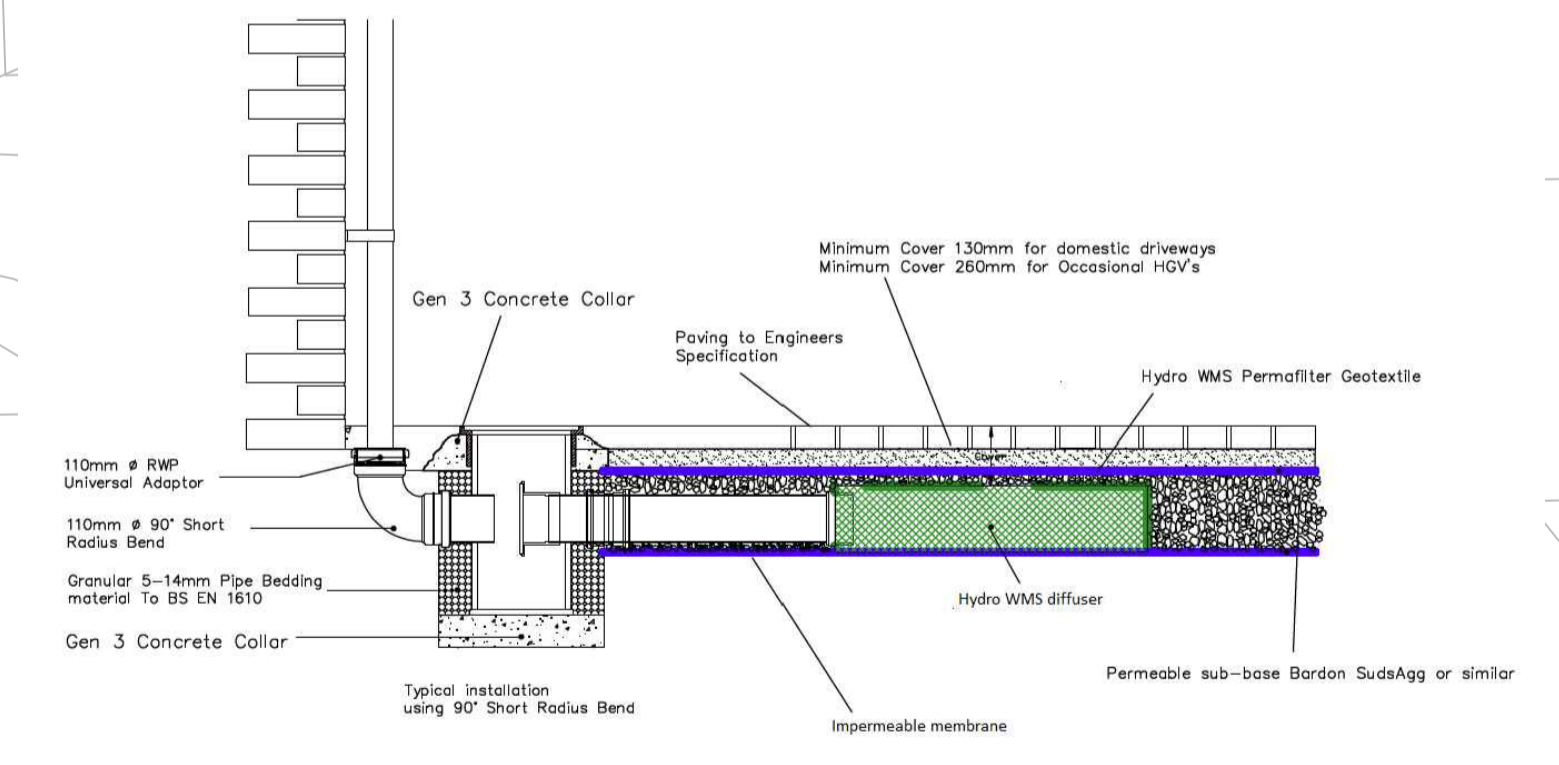

Typical section showing Inlet to Infiltration System

OUTLET FROM PERMEABLE PAVING TO BE VIA AN UNDERDRAINED SUMP OUTLET TO THE ADOPTABLE SW SEWER NETWORK.

ence number 100022432


Appendix 2 – Topographical Survey



The Contractor is to check and verify all building and site dimensions, levels and invert levels at connection points before work starts. The Contractor is to comply in all respects with current Building Legislation, British Standard Specifications, Building Regulations, Construction (Design & Management) Regulations, Party Wall Act, etc. whether or not specifically stated on this drawing. This drawing must be read with and checked against any structural, geological or other specialist documentation provided. This drawing is not intended to show details of foundations, ground conditions or ground contaminants. Each area of ground relied upon to support any structure depicted (including drainage) must be investigated by the Contractor. A suitable method of foundation should be provided allowing for existing ground conditions. Any suspect or fluid ground, contaminates on or within the ground, should be further investigated by a suitable expert. Any earthwork constructions shown indicate typical slopes for guidance only & should be further investigated by a suitable expert. Where existing trees are to be retained they should be subject to a full Arboticultural inspection for safety. All trees are to be planted so as to ensure they are a minimum 5 metres from buildings and 3 metres from drainage and services. A suitable method of foundation is to be provided to accommodate the proposed tree planting.

Geoff Perry Associates Limited do not accept any responsibility for any losses (financial or otherwise) or damage to property arising from or caused by the use of the drawings or the information contained therein. The drawings are provided as a guide only and do not constitute a contract. Geoff Perry Associates Limited's liability is limited to the amount of fees received for the work. No scale factor has been applied to the survey therefore the coordinates shown are arbitrary & not true O.S. Coordinates which have a scale factor applied. Please refer to Survey Station Table to enable establishment of the on-site grid. 3D data frozen on layer TRIANGLES

Check:

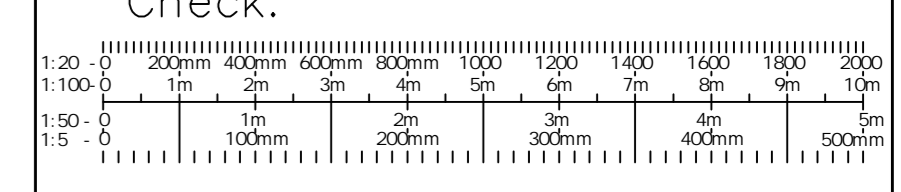

Revisions:

| | |
|-----|------------------------|
| No. | Description |
| 1 | Issue for tender |
| 2 | Issue for contract |
| 3 | Issue for construction |
| 4 | Issue for completion |
| 5 | Issue for final |

Client:
Barratt Developments Plc

Project:
Dagnell End Road, Redditch


Title:
Site Survey
Sheet 1 of 2

Date: July 2016 Scale: 1:500 @ A0
Drawn by: ICP Checked by: DW

Job No. Drwg No. Rev.
S 219 635


TOP SURVEYING

The Shrubby, 28 Erdington Road,
Aldridge, Walsall, W.S.9 1RZ
0121 274 9001
enquiries@geoffperryassoc.co.uk

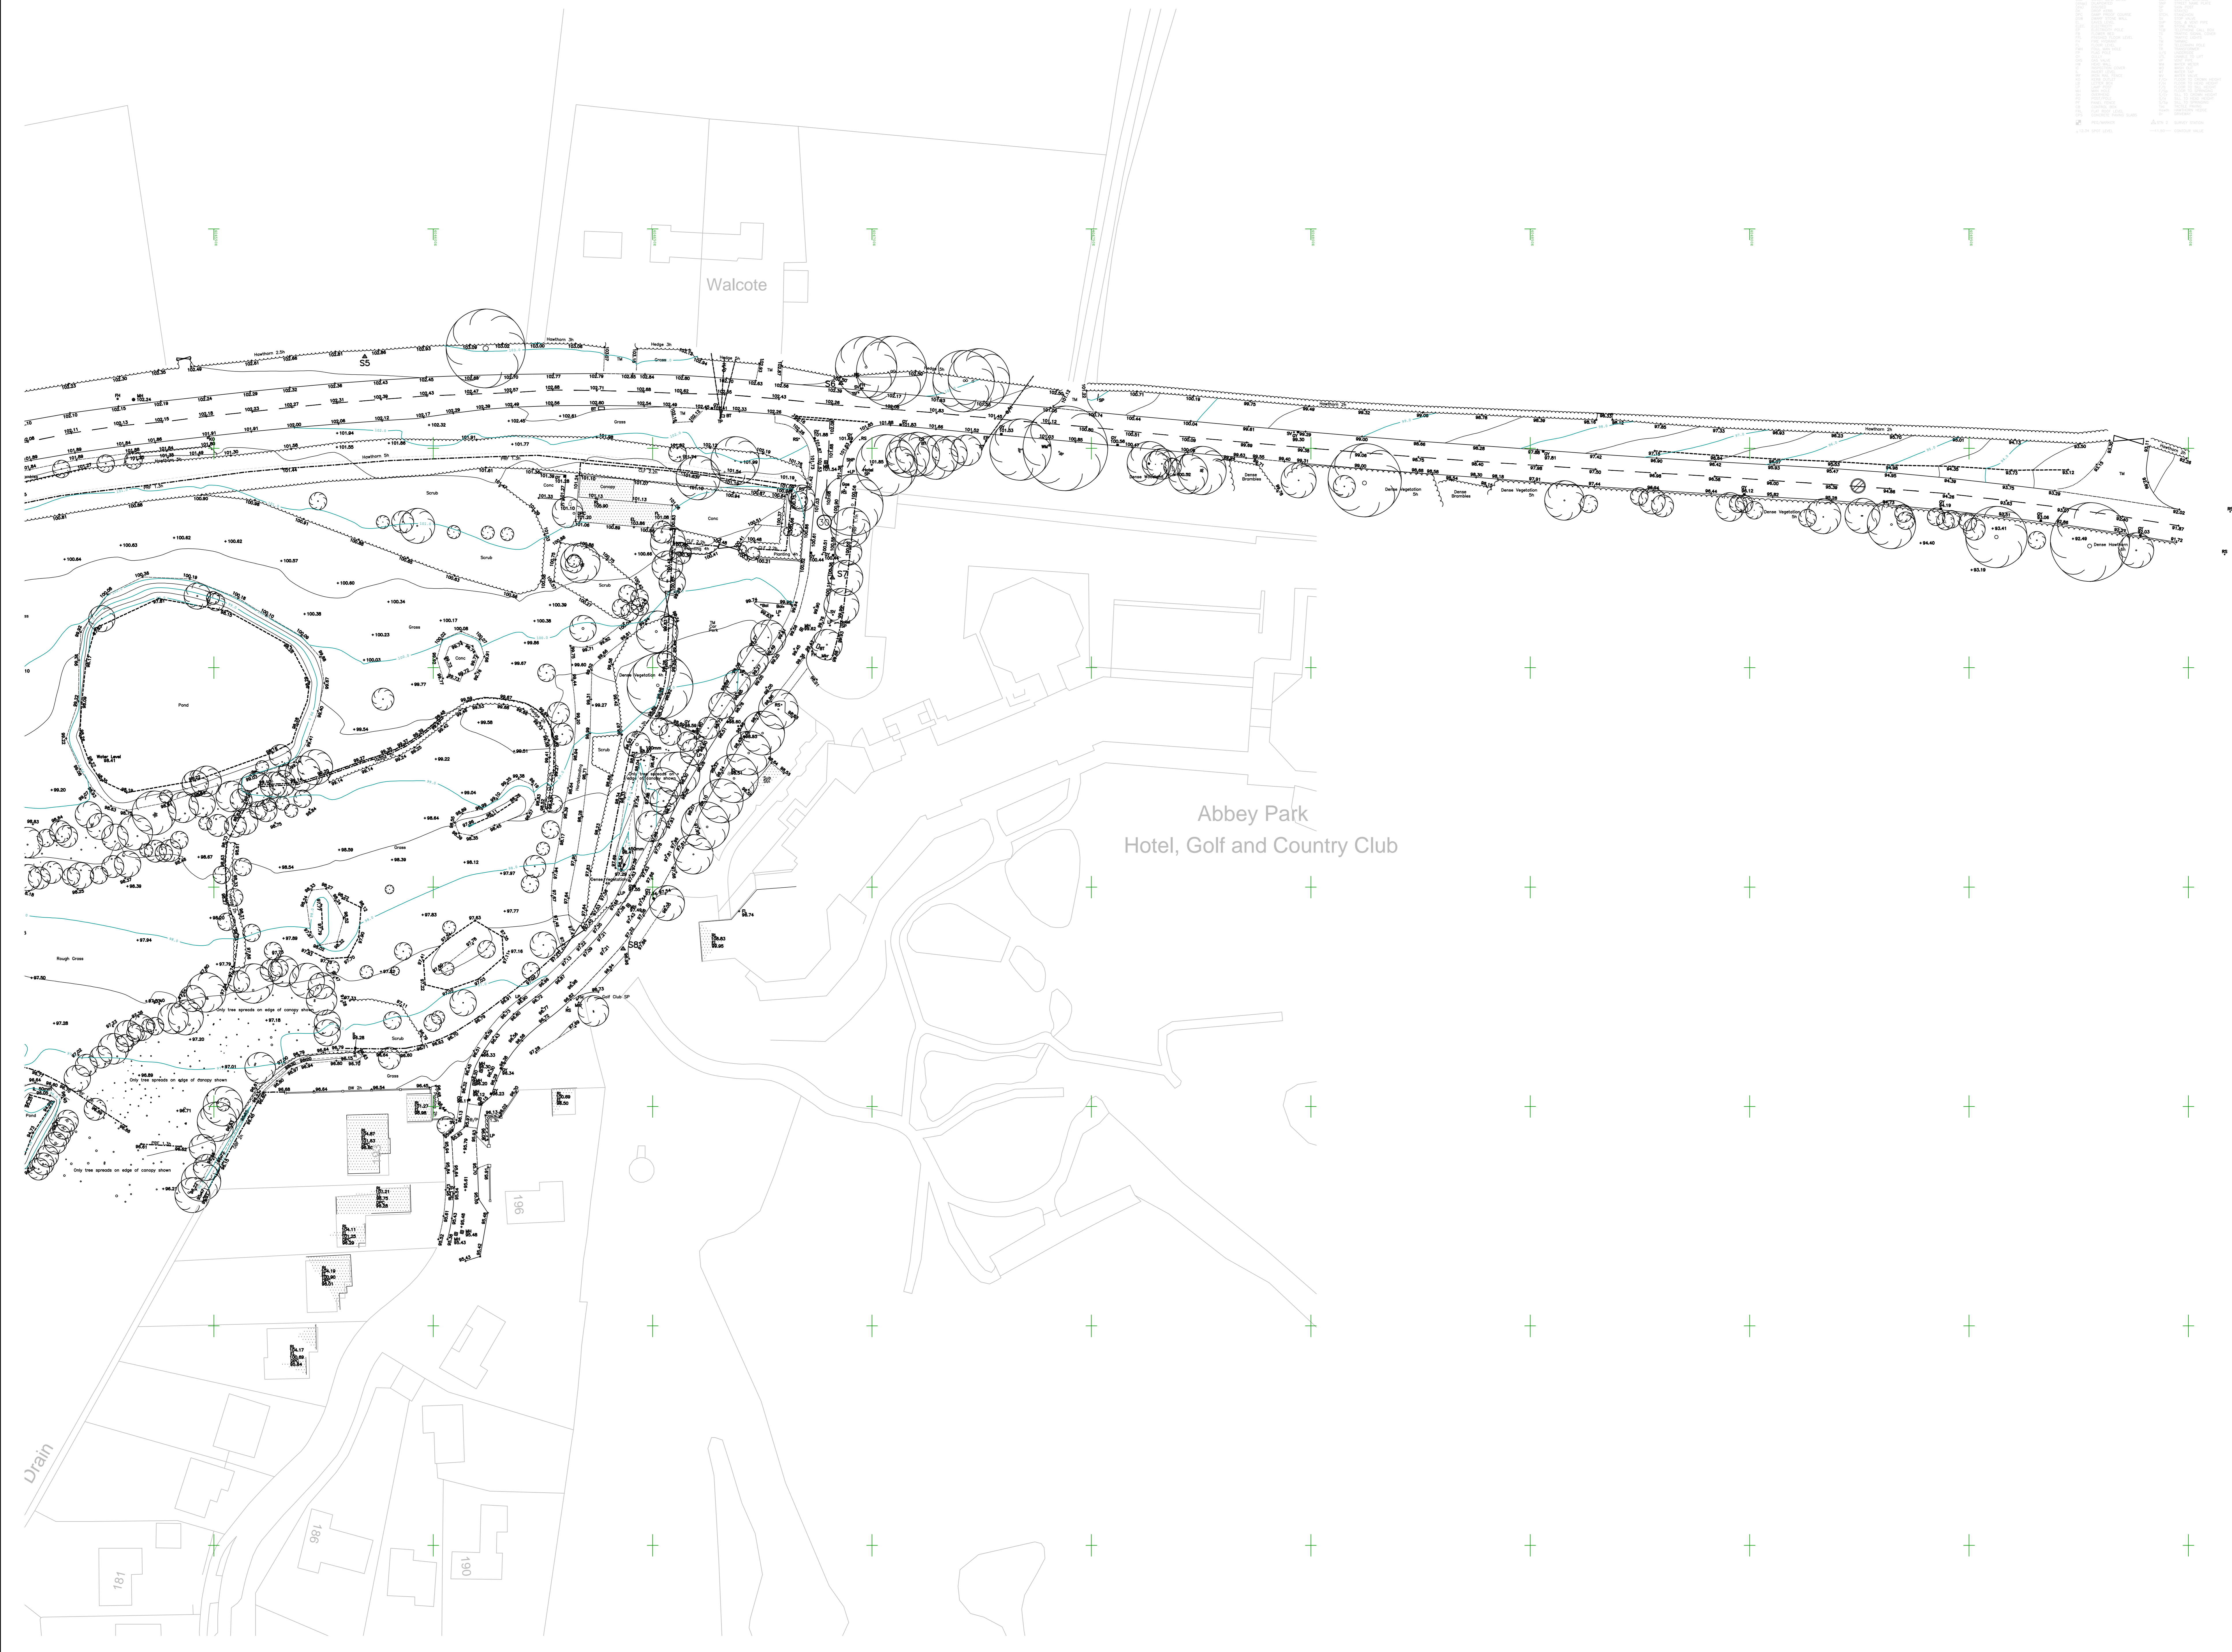

| NO. | DESCRIPTION | DATE |
|-----|------------------------|------------|
| 1 | Issue for tender | 15/07/2016 |
| 2 | Issue for contract | 15/07/2016 |
| 3 | Issue for construction | 15/07/2016 |
| 4 | Issue for completion | 15/07/2016 |
| 5 | Issue for final | 15/07/2016 |

The Contractor is to check and verify all building and site dimensions, levels and sewer invert levels at connection points before work starts. The Contractor is to comply in all respects with current Building Legislation, British Standard Specifications, Building Regulations, Construction (Design & Management) Regulations, Party Wall Act, etc. whether or not specifically stated on this drawing. This drawing must be read with and checked against any structural, geotechnical or other specialist documentation provided. This drawing is not intended to show details of foundations, ground conditions or ground contaminants. Each area of ground relied upon to support any structure depicted (including drainage) must be investigated by the Contractor. A suitable method of foundation should be provided allowing for existing ground conditions. Any suspect or fluid ground, contaminates on or within the ground, should be further investigated by a suitable expert. Any earthwork constructions shown indicate typical slopes for guidance only & should be further investigated by a suitable expert. Where existing trees are to be retained they should be subject to a full Arboricultural inspection for safety. All trees are to be planted so as to ensure they are a minimum 5 metres from buildings and 3 metres from drainage and services. A suitable method of foundation is to be provided to accommodate the proposed tree planting. Geoff Perry Associates Limited do not accept any responsibility for any losses (financial or otherwise) incurred by the Contractor arising from the use of this drawing. The Contractor shall be responsible for the design and construction of any structure shown on this drawing. A true O.S. bearing has been established to create a true O.S. bearing for angle orientation. No scale factor has been applied to the survey therefore the coordinates shown are arbitrary & not true O.S. Coordinates which have a scale factor applied. Please refer to Survey Station Table to enable establishment of the on-site grid. 3D Contour frozen on layer TRIANGLES

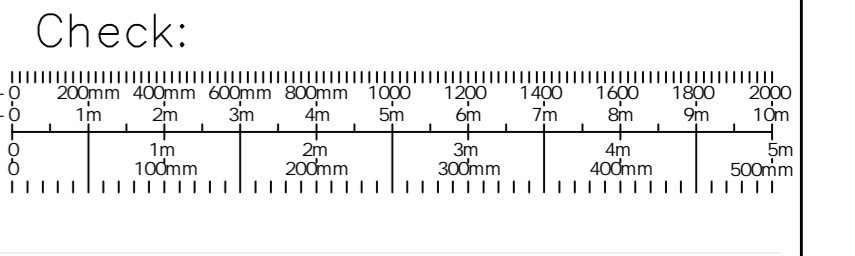

Revisions:

| NO. | DESCRIPTION | DATE |
|-----|------------------------|------------|
| 1 | Issue for tender | 15/07/2016 |
| 2 | Issue for contract | 15/07/2016 |
| 3 | Issue for construction | 15/07/2016 |
| 4 | Issue for completion | 15/07/2016 |
| 5 | Issue for final | 15/07/2016 |

Client:
Barratt Developments Plc

Project:
Dagnell End Road, Redditch

Title:
Site Survey
Sheet 2 of 2

Date: July 2016 Scale: 1:500 @ A0
 Drawn by: ICP Checked by: DW

Job No. Drwg No. Rev.
 S 219 635



The Shrubbery, 28 Erdington Road,
 Aldridge, Walsall, W.S.9 0 1 9 2
 0121 749 010
 enquiries@geoffperryassoc.co.uk

Appendix 3 – Environment Agency Product 4 Detailed Flood Risk Data

Product 4 (Detailed Flood Risk Data) for Flood data for development adjacent to River Arrow, Redditch

Reference number: 212168

Date of issue: 24 June 2021

Model Information

The following information and attached maps contain a summary of the modelled information relevant to the area of interest. The information provided is based on the best available data as of the date of issue.

| Model Name | Release Date |
|-------------|--------------|
| River Arrow | 2009 |

The Environment Agency Fluvial Modelling Standards recent publication “Delivering Benefits Through Evidence” can be found in the attached sharefile link <https://ea.sharefile.com/d-s8ab48c627aaa4f01b5bd81bc05a8fbde>

Flood Map for Planning (Rivers and Sea)

The Flood Map for Planning (Rivers and Sea) indicates the area at risk of flooding, **assuming no flood defences exist**, for a flood event with a 0.5% chance of occurring in any year for flooding from the sea, or a 1% chance of occurring in any year for fluvial (river) flooding (Flood Zone 3). It also shows the extent of the Extreme Flood Outlines (Flood Zone 2) which represents the extent of a flood event with a 0.1% chance of occurring in any year, or the highest recorded historic extent if greater. The Flood Zones refer to the land at risk of flooding and **do not** refer to individual properties. It is possible for properties to be built at a level above the floodplain but still fall within the risk area.

This Flood Map only indicates the extent and likelihood of flooding from rivers or the sea. It should also be remembered that flooding may occur from other sources such as surface water, sewers, road drainage, etc.

To find out which flood zone a location is in please use: <https://flood-map-for-planning.service.gov.uk/>

Definition of flood zones

- **Zone 1** - The area is within the lowest probability of flooding from rivers and the sea, where the chance of flooding in any one year is less than 0.1% (i.e. a 1000 to 1 chance).

- **Zone 2** - The area which falls between the extent of a flood with an annual probability of 0.1% (i.e. a 1000 to 1 chance) fluvial and tidal, or greatest recorded historic flood, whichever is greater, and the extent of a flood with an annual probability of 1% (i.e. a 100 to 1 chance) fluvial / 0.5% (i.e. a 200 to 1 chance) tidal. (Land shown in light blue on the Flood Map).
- **Zone 3** - The chance of flooding in any one year is greater than or equal to 1% (i.e. a 100 to 1 chance) for river flooding and greater than or equal to 0.5% (i.e. a 200 to 1 chance) for coastal and tidal flooding.

Note: The Flood Zones shown on the Environment Agency's Flood Map for Planning (Rivers and Sea) do not take account of the possible impacts of climate change and consequent changes in the future probability of flooding. Reference should therefore also be made to the [Strategic Flood Risk Assessment](#) when considering location and potential future flood risks to developments and land uses.

Node Data

The attached map shows a selection of 1D model node points near to your site. The fluvial levels for these node points are shown below.

Fluvial Flood Levels (m AOD)

The modelled levels are given in m AOD (N), m AOD indicates metres Above Ordnance Datum (Newlyn).

The information is taken from the model referenced above and does not include the updated climate change figures.

| Node Label | MODEL | EASTING | NORTHING | Annual Exceedance Probability -Maximum Water Levels (mAOD) Defended | | | | | | | | |
|------------|------------------------|---------|----------|---|---------------|--------------|--------------|-----------------|---------------|---------------------|-----------------|------------------|
| | | | | 20% (1 in 5) | 10% (1 in 10) | 6% (1 in 20) | 2% (1 in 50) | 1.33% (1 in 75) | 1% (1 in 100) | 1% (Climate Change) | 0.6% (1 in 200) | 0.1% (1 in 1000) |
| RAR27249 | Arrow & Aine SFRM 2009 | 404641 | 268905 | 86.17 | 86.34 | 86.5 | 86.71 | 86.81 | 86.88 | 86.94 | 86.98 | 87.25 |
| RAR28245 | Arrow & Aine SFRM 2009 | 404006 | 269290 | 88.99 | 89.21 | 89.5 | 89.98 | 90.28 | 90.57 | 90.86 | 91 | 91.79 |
| RAR28245D | Arrow & Aine SFRM 2009 | 404021 | 269278 | 88.91 | 89.11 | 89.33 | 89.65 | 89.8 | 89.93 | 90.14 | 90.28 | 90.92 |

| Node Label | MODEL | EASTING | NORTHING | AEP-Max. Water levels m(AOD) Un defended | |
|------------|------------------------|---------|----------|--|------------------|
| | | | | 1% (1 in 100) | 0.1% (1 in 1000) |
| RAR27249 | Arrow & Aine SFRM 2009 | 404641 | 268905 | 86.88 | 87.25 |
| RAR28245 | Arrow & Aine SFRM 2009 | 404006 | 269290 | 90.57 | 91.79 |
| RAR28245D | Arrow & Aine SFRM 2009 | 404021 | 269278 | 89.93 | 90.92 |

Climate Change

In February 2016 the '[Flood Risk Assessments: Climate Change Allowances](#)' were published on GOV.UK. This is in replacement of previous climate change allowances for planning applications. The data provided in this product does not include the new allowances. You will need to consider this data and factor in the new allowances to demonstrate the development will be safe from flooding. The fluvial climate change factors are now more complex and a single uplift percentage across England cannot be justified.

The Environment Agency will incorporate the new allowances into future modelling studies. For now, it remains the applicant's responsibility to demonstrate through their proposal and flood risk assessments that new developments will be safe in flood risk terms for its lifetime.

Recorded Flood Outlines

Following examination of our records of historical flooding we have no record of flooding in the area. The absence of coverage for an area does not mean that the area has never flooded, only that we do not currently have records of flooding in this area. It is also possible that the pattern of flooding in this area has changed and that this area would now flood or not flood under different circumstances.

You may also wish to contact your Local Authority or Internal Drainage Board, to see if they have other relevant local flood information.

Flood Defences

There are no formal flood defences owned or operated by the Environment Agency protecting this site. You may wish to contact the Local Authority to obtain further information regarding localised flooding from drains, culverts and small watercourses, and regarding existing or planned flood defence measures.

Planning development/s

If you have requested this information to help inform a development proposal, then you should note the information on GOV.UK on the use of Environment Agency Information for Flood Risk Assessments. You can also request pre application advice:

<https://www.gov.uk/planning-applications-assessing-flood-risk>

<https://www.gov.uk/government/publications/pre-planning-application-enquiry-form-preliminary-opinion>

Supporting Information

Surface Water

Managing the risk of flooding from surface water is the responsibility of Lead Local Flood Authorities. The 'risk of flooding from surface water' map has been produced by the Environment Agency on behalf of government, using information and input from Lead Local Flood Authorities.

You may wish to contact your Local Authority who may be able to provide further detailed information on surface water.

It is not possible to say for certain what the flood risk is but we use the best information available to provide an indication so that people can make informed choices about living with or managing the risks. The information we supply does not provide an indicator of flood risk at an individual site level. Further information can be found on the Agency's website:

<https://flood-warning-information.service.gov.uk/long-term-flood-risk>

Flood Risk from Reservoirs

The Flood Risk from Reservoirs map can be found on the Long Term Flood Risk Information website:

<https://flood-warning-information.service.gov.uk/long-term-flood-risk/map?map=Reservoirs>

Flood Alert & Flood Warning Area

We issue flood alert/warnings to specific areas when flooding is expected. If you receive a flood warning you should take immediate action.

You can check whether you are in a Flood Alert/Warning Area and register online using the links below:

<https://www.gov.uk/check-flood-risk>

<https://www.gov.uk/sign-up-for-flood-warnings>

If you would prefer to register by telephone, or if you need help during the registration process, please call Floodline on 0345 988 1188.

The associated dataset for flood warning areas is available here:

<https://data.gov.uk/dataset/flood-warning-areas3>

The associated dataset for flood alert areas is available here: <https://data.gov.uk/dataset/flood-alert-areas2>

Flood Risk Activity Permits

We now consider applications for works, which may be Flood Risk Activities, under Environmental Permitting Regulations. This replaces the process of applying for a Flood Defence Consent. You may need an environmental Permit for flood risk activities if you want to do work:

- in, under, over or near a main river (including where the river is in a culvert)
- on or near a flood defence on a main river
- in the flood plain of a main river
- on or near a sea defence

Please go to this website to find out more about how to apply:

<https://www.gov.uk/guidance/flood-risk-activities-environmental-permits>.

Please be aware that Bespoke and Standard Rules permits can take up to 2 months to determine and will incur a charge.


Further details about the Environment Agency information supplied can be found on the GOV.UK website:


<https://www.gov.uk/browse/environment-countryside/flooding-extreme-weather>

Node Point Location Plan, Ref. 212168



Legend

 Modelled Levels selection

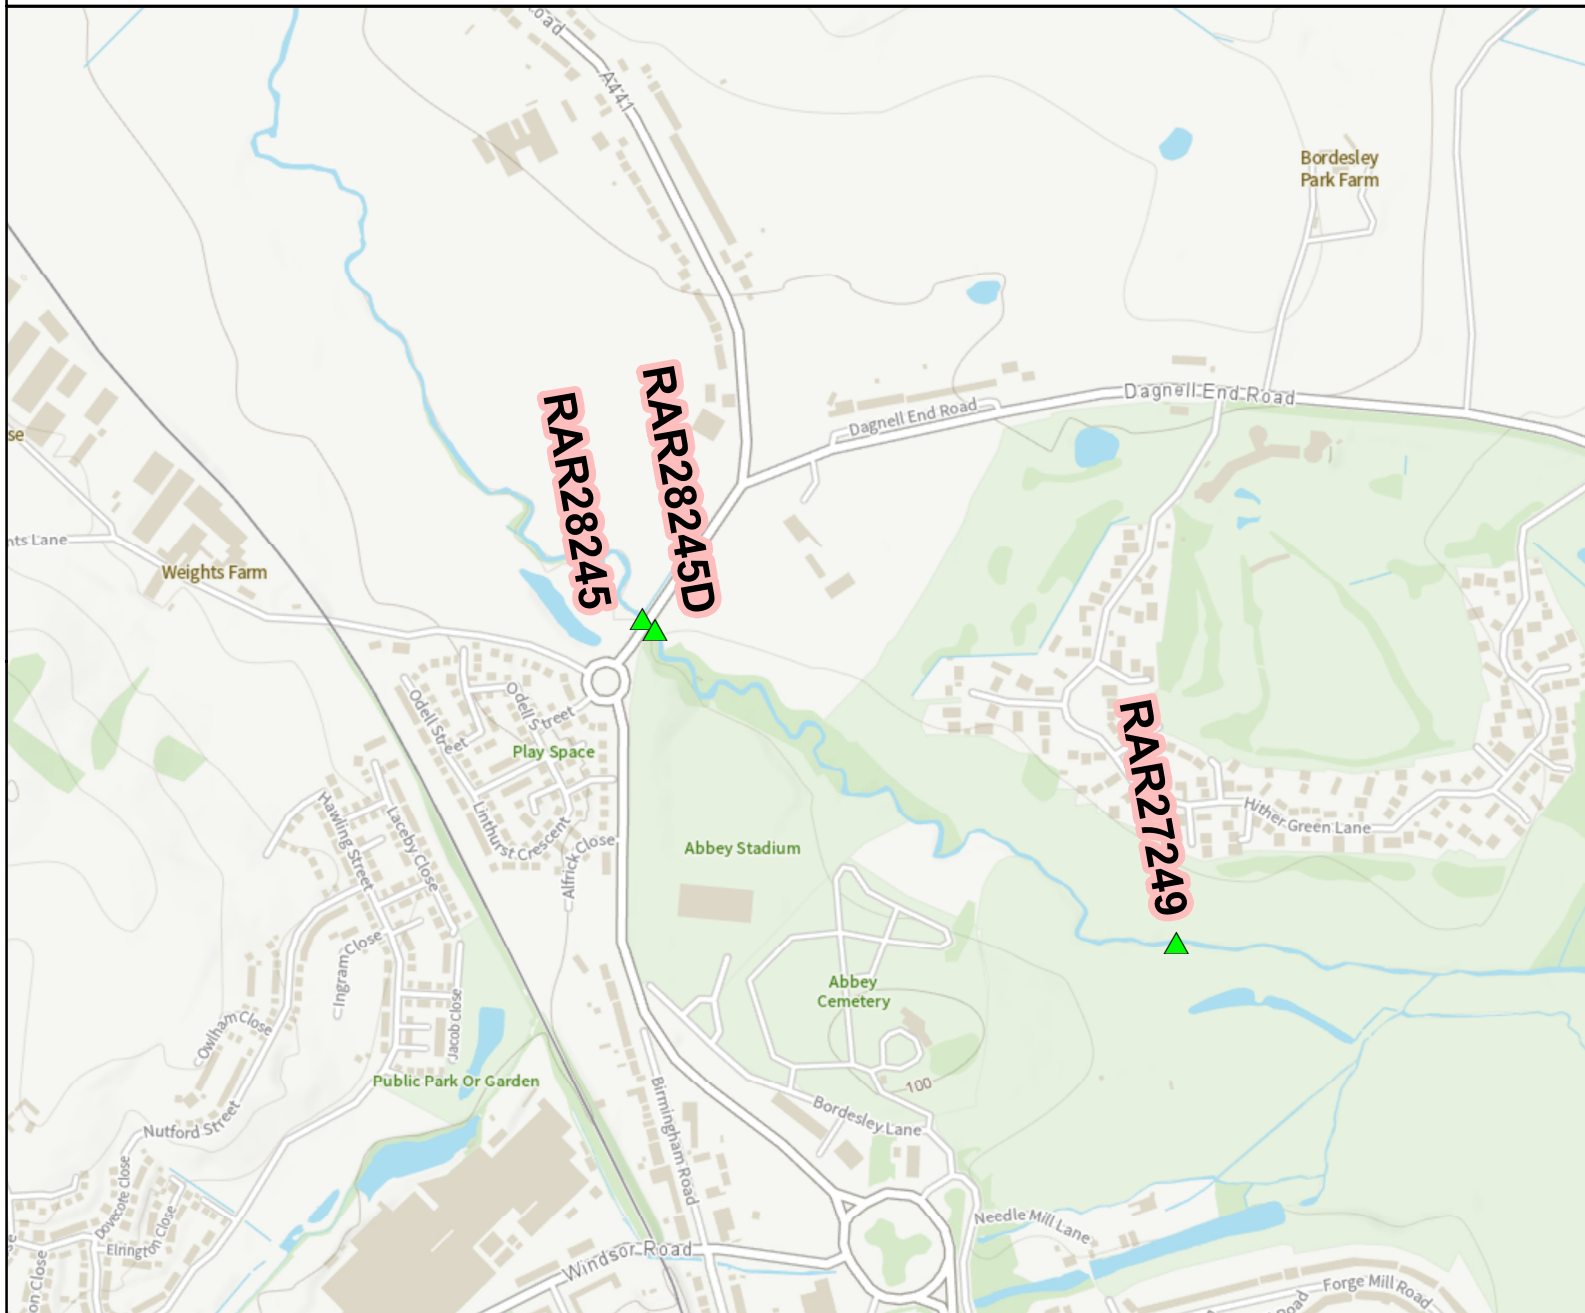

Scale: 1:9,000
Created: 24/06/2021
Eastings: 404,198
Northings: 269,239



Appendix 4 – HR Wallingford Greenfield Runoff Rate Calculation

Calculated by:

Site name:

Site location:

Site Details

Latitude:

Longitude:

Reference:

Date:

This is an estimation of the greenfield runoff rates that are used to meet normal best practice criteria in line with Environment Agency guidance "Rainfall runoff management for developments", SC030219 (2013), the SuDS Manual C753 (Ciria, 2015) and the non-statutory standards for SuDS (Defra, 2015). This information on greenfield runoff rates may be the basis for setting consents for the drainage of surface water runoff from sites.

Runoff estimation approach

Site characteristics

Total site area (ha):

Methodology

Q_{BAR} estimation method:

SPR estimation method:

Soil characteristics

| | Default | Edited |
|--------------|---------|--------|
| SOIL type: | 4 | 4 |
| HOST class: | N/A | N/A |
| SPR/SPRHOST: | 0.47 | 0.47 |

Hydrological characteristics

| | Default | Edited |
|--------------------------------|---------|--------|
| SAAR (mm): | 711 | 711 |
| Hydrological region: | 4 | 4 |
| Growth curve factor 1 year: | 0.83 | 0.83 |
| Growth curve factor 30 years: | 2 | 2 |
| Growth curve factor 100 years: | 2.57 | 2.57 |
| Growth curve factor 200 years: | 3.04 | 3.04 |

Notes

(1) Is Q_{BAR} < 2.0 l/s/ha?

When Q_{BAR} is < 2.0 l/s/ha then limiting discharge rates are set at 2.0 l/s/ha.

(2) Are flow rates < 5.0 l/s?

Where flow rates are less than 5.0 l/s consent for discharge is usually set at 5.0 l/s if blockage from vegetation and other materials is possible. Lower consent flow rates may be set where the blockage risk is addressed by using appropriate drainage elements.

(3) Is SPR/SPRHOST ≤ 0.3?

Where groundwater levels are low enough the use of soakaways to avoid discharge offsite would normally be preferred for disposal of surface water runoff.

Greenfield runoff rates

| | Default | Edited |
|-------------------------|---------|--------|
| Q _{BAR} (l/s): | 4.92 | 4.92 |
| 1 in 1 year (l/s): | 4.08 | 4.08 |
| 1 in 30 years (l/s): | 9.83 | 9.83 |
| 1 in 100 year (l/s): | 12.64 | 12.64 |
| 1 in 200 years (l/s): | 14.95 | 14.95 |

This report was produced using the greenfield runoff tool developed by HR Wallingford and available at www.uksuds.com. The use of this tool is subject to the UK SuDS terms and conditions and licence agreement, which can both be found at www.uksuds.com/terms-and-conditions.htm. The outputs from this tool are estimates of greenfield runoff rates. The use of these results is the responsibility of the users of this tool. No liability will be accepted by HR Wallingford, the Environment Agency, CEH, Hydrosolutions or any other organisation for the use of this data in the design or operational characteristics of any drainage scheme.

Appendix 5 – 21169 – Hither Green SW Input and Results



Drainage Design Report

Flow

v10.1

Copyright © 1988-2021 Causeway Technologies Ltd

| | |
|---------------------------|---|
| Network | Storm Network 1 |
| Filename | 21169-HITHER GREEN SW&FW.PFD |
| Username | Mathew Grainger (mathew.grainger@travisbaker.co.uk) |
| Last analysed | 12/07/2021 12:06:05 |
| Report produced on | 12/07/2021 12:23:18 |

Causeway Sales

| | |
|---------------|------------------------|
| Tel: | +44(0) 1628 552000 |
| Fax: | +44(0) 1628 552001 |
| Email: | marketing@causeway.com |
| Web: | www.causeway.com |

Technical support web portal:

<http://support.causeway.com>

| | |
|---|-------------------|
| Rainfall Methodology | FSR |
| Return Period (years) | 2 |
| Additional Flow (%) | 0 |
| FSR Region | England and Wales |
| M5-60 (mm) | 20.000 |
| Ratio-R | 0.400 |
| CV | 0.750 |
| Time of Entry (mins) | 5.00 |
| Maximum Time of Concentration (mins) | 30.00 |
| Maximum Rainfall (mm/hr) | 50.0 |
| Minimum Velocity (m/s) | 1.00 |
| Connection Type | Level Soffits |
| Minimum Backdrop Height (m) | 9.000 |
| Preferred Cover Depth (m) | 1.200 |
| Include Intermediate Ground | Yes |
| Enforce best practice design rules | Yes |

| | | | | | | | | | | | | | | | | | | | | |
|-------|--------|-------|-----|-----------------------------|--------|--------|-------|--------|--------|-------|-------|------|--|---------|-----------|-------|------|--|---------|-----------|
| 7.000 | 10.540 | 146.3 | 225 | Circular_Default Sewer Type | 94.413 | 92.942 | 1.246 | 94.296 | 92.870 | 1.201 | 72 | 1200 | | Manhole | Adoptable | 73 | 1200 | | Manhole | Adoptable |
| 7.001 | 8.472 | 60.6 | 225 | Circular_Default Sewer Type | 94.296 | 92.870 | 1.201 | 94.155 | 92.730 | 1.200 | 73 | 1200 | | Manhole | Adoptable | 74 | 1200 | | Manhole | Adoptable |
| 7.002 | 27.431 | 20.7 | 225 | Circular_Default Sewer Type | 94.155 | 92.730 | 1.200 | 92.948 | 91.403 | 1.320 | 74 | 1200 | | Manhole | Adoptable | 75 | 1200 | | Manhole | Adoptable |
| 7.003 | 10.965 | 84.3 | 225 | Circular_Default Sewer Type | 92.948 | 91.403 | 1.320 | 92.710 | 91.273 | 1.212 | 75 | 1200 | | Manhole | Adoptable | 76 | 1200 | | Manhole | Adoptable |
| 7.004 | 14.335 | 109.4 | 225 | Circular_Default Sewer Type | 92.710 | 91.273 | 1.212 | 92.567 | 91.142 | 1.200 | 76 | 1200 | | Manhole | Adoptable | 77 | 1200 | | Manhole | Adoptable |
| 7.005 | 20.750 | 40.1 | 300 | Circular_Default Sewer Type | 92.567 | 91.067 | 1.200 | 92.053 | 90.550 | 1.203 | 77 | 1200 | | Manhole | Adoptable | 78 | 1200 | | Manhole | Adoptable |
| 7.006 | 9.361 | 33.4 | 300 | Circular_Default Sewer Type | 92.053 | 90.550 | 1.203 | 91.770 | 90.270 | 1.200 | 78 | 1200 | | Manhole | Adoptable | 79 | 1200 | | Manhole | Adoptable |
| 7.007 | 6.676 | 11.5 | 300 | Circular_Default Sewer Type | 91.770 | 90.270 | 1.200 | 91.596 | 89.688 | 1.608 | 79 | 1200 | | Manhole | Adoptable | 26 | 1800 | | Manhole | Adoptable |
| 1.025 | 6.517 | 500.0 | 900 | Circular_Default Sewer Type | 91.596 | 89.088 | 1.608 | 91.409 | 89.075 | 1.434 | 26 | 1800 | | Manhole | Adoptable | 27 | 2100 | | Manhole | Adoptable |
| 1.026 | 43.897 | 42.2 | 900 | Circular_Default Sewer Type | 91.409 | 89.075 | 1.434 | 90.435 | 88.035 | 1.500 | 27 | 2100 | | Manhole | Adoptable | 28 | 2100 | | Manhole | Adoptable |
| 1.027 | 25.855 | 507.0 | 900 | Circular_Default Sewer Type | 90.435 | 88.035 | 1.500 | 90.400 | 87.984 | 1.516 | 28 | 2100 | | Manhole | Adoptable | 29 | 2100 | | Manhole | Adoptable |
| 1.028 | 30.611 | 501.8 | 900 | Circular_Default Sewer Type | 90.400 | 87.984 | 1.516 | 90.723 | 87.923 | 1.900 | 29 | 2100 | | Manhole | Adoptable | 30-HW | 1800 | | Manhole | Adoptable |
| 1.029 | 11.528 | 501.2 | 900 | Circular_Default Sewer Type | 90.723 | 87.923 | 1.900 | 90.700 | 87.900 | 1.900 | 30-HW | 1800 | | Manhole | Adoptable | 31-HW | 1500 | | Manhole | Adoptable |
| 1.030 | 32.293 | 496.8 | 900 | Circular_Default Sewer Type | 90.700 | 87.900 | 1.900 | 91.035 | 87.835 | 2.300 | 31-HW | 1500 | | Manhole | Adoptable | 32-FC | 3000 | | Manhole | Adoptable |
| 1.031 | 35.511 | 50.7 | 900 | Circular_Default Sewer Type | 91.035 | 87.835 | 2.300 | 89.000 | 87.135 | 0.965 | 32-FC | 3000 | | Manhole | Adoptable | 33-OF | 1800 | | Manhole | Adoptable |

| Rainfall Methodology | FSR | | Return Period (years) | Climate Change (CC %) | Additional Area (A %) | Additional Flow (Q %) |
|--|-------------------|--|------------------------------|------------------------------|------------------------------|------------------------------|
| FSR Region | England and Wales | | 2 | 0 | 0 | 0 |
| M5-60 (mm) | 20.000 | | 30 | 0 | 0 | 0 |
| Ratio-R | 0.400 | | 100 | 40 | 0 | 0 |
| Summer CV | 0.750 | | | | | |
| Winter CV | 0.840 | | | | | |
| Analysis Speed | Normal | | | | | |
| Skip Steady State | Yes | | | | | |
| Drain Down Time (mins) | 240 | | | | | |
| Additional Storage (m³/ha) | 20.0 | | | | | |
| Storm Durations (mins) | 15 | | | | | |
| | 30 | | | | | |
| | 60 | | | | | |
| | 120 | | | | | |
| | 180 | | | | | |
| | 240 | | | | | |
| | 360 | | | | | |
| | 480 | | | | | |
| | 600 | | | | | |
| | 720 | | | | | |
| | 960 | | | | | |
| | 1440 | | | | | |
| Check Discharge Rate(s) | Yes | | | | | |
| Check Discharge Volume | Yes | | | | | |
| 100 year 360 minute (m³) | | | | | | |

| | |
|-------------------------------------|------------|
| Site Makeup | Greenfield |
| Greenfield Method | IH124 |
| Positively Drained Area (ha) | |
| SAAR (mm) | |
| Soil Index | 1 |
| SPR | 0.10 |
| Region | 1 |
| Growth Factor 1 year | 0.85 |
| Growth Factor 30 year | 1.95 |
| Growth Factor 100 year | 2.48 |
| Betterment (%) | 0 |
| QBar | |
| Q 1 year (l/s) | |
| Q 30 year (l/s) | |
| Q 100 year (l/s) | |

| | |
|--------------------------------------|------------|
| Site Makeup | Greenfield |
| Greenfield Method | FSR/FEH |
| Positively Drained Area (ha) | |
| Soil Index | 1 |
| SPR | 0.10 |
| CWI | |
| Return Period (years) | 100 |
| Climate Change (%) | 0 |
| Storm Duration (mins) | 360 |
| Betterment (%) | 0 |
| PR | |
| Runoff Volume (m³) | |

| Hydro-Brake® | | | | | | | | | | | | |
|---------------------|-------------------|-------------------------|---------------------------------|---------------------|-------------------------|-------------------------|--------------------------|--------------------------------|-----------------------|-----------------------------|--------------------------------|-------------------------------|
| Node | Flap Valve | Online / Offline | Replaces Downstream Link | Loop to Node | Invert Level (m) | Design Depth (m) | Design Flow (l/s) | Objective | Sump Available | Product Number | Min Outlet Diameter (m) | Min Node Diameter (mm) |
| 32-FC | No | Online | Yes | | 87.835 | 1.300 | 19.6 | (HE) Minimise upstream storage | Yes | CTL-SHE-0193-1960-1300-1960 | 0.225 | 1500 |

| <u>Depth/Area/Inf Area</u> | | | | | | | | | |
|----------------------------|-----------------------------|-----------------------------|---------------|----------|------------------|---------------------------|-----------|------------------------|-----------------------------|
| Node | Base Inf Coefficient (m/hr) | Side Inf Coefficient (m/hr) | Safety Factor | Porosity | Invert Level (m) | Time to half empty (mins) | Depth (m) | Area (m ²) | Inf. Area (m ²) |
| 31-HW | 0.00000 | 0.00000 | 2.0 | 1.00 | 86.700 | 0 | 0.000 | 555.6 | 0.0 |
| | | | | | | | 1.200 | 1324.5 | 0.0 |
| | | | | | | | 1.201 | 1547.8 | 0.0 |
| | | | | | | | 1.800 | 2017.2 | 0.0 |
| | | | | | | | 1.801 | 2281.0 | 0.0 |
| | | | | | | | 2.300 | 2713.6 | 0.0 |
| | | | | | | | 2.301 | 3000.0 | 0.0 |
| | | | | | | | 2.800 | 3486.9 | 0.0 |

| Results for 2 year Critical Storm Duration. Lowest mass balance: 99.89% | | | | | | | | | | | | | | | | |
|---|---------|-------------|-----------|-----------|--------------|---------------|------------|--------|-----------------------------|-------|---------|---------------|----------------|----------|---------------|--------------------|
| Node Event | US Node | Peak (mins) | Level (m) | Depth (m) | Inflow (l/s) | Node Vol (m³) | Flood (m³) | Status | Link Event (Upstream Depth) | Link | DS Node | Outflow (l/s) | Velocity (m/s) | Flow/Cap | Link Vol (m³) | Discharge Vol (m³) |
| 15 minute winter | 1 | 10 | 95.983 | 0.051 | 9.7 | 0.0965 | 0.0000 | OK | 15 minute winter | 1.000 | 2 | 9.6 | 1.438 | 0.107 | 0.1045 | |
| 15 minute winter | 2 | 10 | 95.512 | 0.112 | 19.3 | 0.1709 | 0.0000 | OK | 15 minute winter | 1.001 | 3 | 18.9 | 0.831 | 0.266 | 0.3438 | |
| 15 minute winter | 3 | 11 | 95.420 | 0.157 | 28.6 | 0.3290 | 0.0000 | OK | 15 minute winter | 1.002 | 4 | 27.2 | 0.597 | 0.244 | 1.5204 | |
| 15 minute winter | 34 | 10 | 99.635 | 0.043 | 9.7 | 0.0813 | 0.0000 | OK | 15 minute winter | 2.000 | 35 | 9.6 | 0.829 | 0.082 | 0.1053 | |
| 15 minute winter | 35 | 10 | 99.253 | 0.108 | 19.3 | 0.2005 | 0.0000 | OK | 15 minute winter | 2.001 | 36 | 18.8 | 0.799 | 0.473 | 0.8977 | |
| 15 minute winter | 36 | 11 | 99.075 | 0.153 | 28.5 | 0.2688 | 0.0000 | OK | 15 minute winter | 2.002 | 37 | 28.1 | 1.039 | 0.703 | 0.2539 | |
| 15 minute winter | 40 | 10 | 99.416 | 0.064 | 9.7 | 0.1192 | 0.0000 | OK | 15 minute winter | 3.000 | 41 | 9.5 | 0.717 | 0.178 | 0.3140 | |
| 15 minute winter | 41 | 10 | 99.206 | 0.102 | 19.2 | 0.1902 | 0.0000 | OK | 15 minute winter | 3.001 | 42 | 18.9 | 1.010 | 0.329 | 0.1332 | |
| 15 minute winter | 42 | 10 | 99.130 | 0.113 | 28.6 | 0.2087 | 0.0000 | OK | 15 minute winter | 3.002 | 37 | 28.2 | 1.534 | 0.411 | 0.1605 | |
| 15 minute winter | 37 | 11 | 98.931 | 0.140 | 65.3 | 0.2495 | 0.0000 | OK | 15 minute winter | 2.003 | 38 | 65.6 | 1.848 | 0.403 | 0.6999 | |
| 15 minute winter | 38 | 11 | 98.532 | 0.162 | 74.7 | 0.2979 | 0.0000 | OK | 15 minute winter | 2.004 | 39 | 75.1 | 2.949 | 0.392 | 0.2875 | |
| 15 minute winter | 39 | 11 | 98.114 | 0.072 | 84.2 | 0.1328 | 0.0000 | OK | 15 minute winter | 2.005 | 4 | 84.3 | 4.805 | 0.132 | 0.2112 | |
| 15 minute winter | 4 | 11 | 95.409 | 0.304 | 120.5 | 0.6134 | 0.0000 | OK | 15 minute winter | 1.003 | 5 | 119.5 | 1.168 | 0.748 | 1.8713 | |
| 15 minute winter | 5 | 11 | 95.325 | 0.339 | 128.6 | 0.6871 | 0.0000 | OK | 15 minute winter | 1.004 | 6 | 127.0 | 0.871 | 0.587 | 2.9177 | |
| 15 minute winter | 6 | 12 | 95.287 | 0.341 | 136.1 | 0.6929 | 0.0000 | OK | 15 minute winter | 1.005 | 7 | 133.1 | 0.924 | 0.615 | 2.7542 | |
| 15 minute winter | 7 | 12 | 95.242 | 0.334 | 142.2 | 0.6829 | 0.0000 | OK | 15 minute winter | 1.006 | 8 | 141.1 | 1.047 | 0.647 | 2.9206 | |
| 15 minute winter | 8 | 12 | 95.178 | 0.388 | 148.6 | 0.8070 | 0.0000 | OK | 15 minute winter | 1.007 | 9 | 148.4 | 0.786 | 0.521 | 1.8666 | |
| 15 minute winter | 9 | 12 | 95.154 | 0.381 | 155.9 | 0.8051 | 0.0000 | OK | 15 minute winter | 1.008 | 10 | 155.6 | 0.851 | 0.541 | 1.6714 | |
| 15 minute winter | 10 | 12 | 95.125 | 0.368 | 163.0 | 0.7913 | 0.0000 | OK | 15 minute winter | 1.009 | 11 | 162.3 | 0.914 | 0.566 | 3.6527 | |
| 15 minute winter | 11 | 12 | 95.079 | 0.358 | 169.8 | 0.8083 | 0.0000 | OK | 15 minute winter | 1.010 | 12 | 168.1 | 1.004 | 0.593 | 3.3130 | |
| 15 minute winter | 12 | 13 | 95.021 | 0.334 | 175.6 | 0.7864 | 0.0000 | OK | 15 minute winter | 1.011 | 13 | 174.3 | 1.229 | 0.614 | 6.8990 | |
| 15 minute winter | 13 | 13 | 94.803 | 0.275 | 179.8 | 0.6175 | 0.0000 | OK | 15 minute winter | 1.012 | 14 | 180.4 | 1.681 | 0.495 | 1.6899 | |
| 15 minute winter | 14 | 13 | 94.689 | 0.185 | 185.9 | 0.4210 | 0.0000 | OK | 15 minute winter | 1.013 | 15 | 186.5 | 2.802 | 0.135 | 1.5342 | |
| 15 minute winter | 15 | 13 | 94.153 | 0.142 | 192.0 | 0.3316 | 0.0000 | OK | 15 minute winter | 1.014 | 16 | 192.4 | 1.664 | 0.102 | 6.6386 | |
| 15 minute winter | 16 | 13 | 92.102 | 0.345 | 197.9 | 0.7595 | 0.0000 | OK | 15 minute winter | 1.015 | 17 | 200.7 | 1.348 | 0.561 | 4.0501 | |
| 15 minute winter | 43 | 10 | 99.561 | 0.061 | 9.7 | 0.1136 | 0.0000 | OK | 15 minute winter | 4.000 | 44 | 9.6 | 0.654 | 0.160 | 0.1825 | |
| 15 minute winter | 44 | 10 | 99.455 | 0.118 | 19.3 | 0.2199 | 0.0000 | OK | 15 minute winter | 4.001 | 45 | 19.0 | 0.913 | 0.443 | 0.1602 | |
| 15 minute winter | 45 | 10 | 99.399 | 0.115 | 28.7 | 0.2151 | 0.0000 | OK | 15 minute winter | 4.002 | 46 | 28.2 | 1.410 | 0.480 | 0.5227 | |
| 15 minute winter | 46 | 10 | 99.065 | 0.113 | 37.9 | 0.2111 | 0.0000 | OK | 15 minute winter | 4.003 | 47 | 37.6 | 1.951 | 0.412 | 0.1776 | |
| 15 minute winter | 47 | 11 | 98.778 | 0.108 | 47.1 | 0.2022 | 0.0000 | OK | 15 minute winter | 4.004 | 48 | 47.2 | 2.573 | 0.441 | 0.6864 | |
| 15 minute winter | 48 | 11 | 97.118 | 0.097 | 56.3 | 0.1778 | 0.0000 | OK | 15 minute winter | 4.005 | 49 | 56.5 | 1.927 | 0.228 | 1.2978 | |
| 15 minute winter | 49 | 11 | 95.040 | 0.166 | 65.6 | 0.2812 | 0.0000 | OK | 15 minute winter | 4.006 | 50 | 65.8 | 1.724 | 0.533 | 1.0577 | |
| 15 minute winter | 57 | 10 | 95.117 | 0.057 | 9.7 | 0.1072 | 0.0000 | OK | 15 minute winter | 5.000 | 58 | 9.6 | 0.716 | 0.143 | 0.2140 | |
| 15 minute winter | 58 | 11 | 94.911 | 0.112 | 19.3 | 0.2033 | 0.0000 | OK | 15 minute winter | 5.001 | 50 | 18.8 | 0.979 | 0.472 | 0.6255 | |
| 15 minute winter | 50 | 11 | 94.640 | 0.182 | 93.7 | 0.4401 | 0.0000 | OK | 15 minute winter | 4.007 | 51 | 93.7 | 2.014 | 0.439 | 2.8767 | |
| 15 minute winter | 51 | 11 | 93.901 | 0.147 | 102.8 | 0.3581 | 0.0000 | OK | 15 minute winter | 4.008 | 52 | 102.1 | 2.333 | 0.279 | 0.6607 | |
| 15 minute winter | 52 | 11 | 93.423 | 0.168 | 111.2 | 0.4052 | 0.0000 | OK | 15 minute winter | 4.009 | 53 | 110.7 | 1.991 | 0.357 | 0.9836 | |
| 15 minute winter | 53 | 11 | 93.043 | 0.210 | 119.8 | 0.5118 | 0.0000 | OK | 15 minute winter | 4.010 | 54 | 118.8 | 2.096 | 0.453 | 0.5600 | |
| 15 minute winter | 54 | 11 | 92.805 | 0.216 | 127.9 | 0.5210 | 0.0000 | OK | 15 minute winter | 4.011 | 55 | 127.4 | 1.698 | 0.343 | 0.8609 | |
| 15 minute winter | 55 | 11 | 92.654 | 0.216 | 136.5 | 0.5208 | 0.0000 | OK | 15 minute winter | 4.012 | 56 | 135.3 | 1.988 | 0.367 | 0.9301 | |
| 15 minute winter | 56 | 11 | 92.379 | 0.192 | 144.4 | 0.4582 | 0.0000 | OK | 15 minute winter | 4.013 | 17 | 144.1 | 2.169 | 0.242 | 1.3998 | |
| 15 minute winter | 17 | 13 | 92.001 | 0.281 | 336.8 | 0.6528 | 0.0000 | OK | 15 minute winter | 1.016 | 18 | 340.1 | 1.937 | 0.292 | 4.8870 | |
| 15 minute winter | 18 | 13 | 91.679 | 0.386 | 345.6 | 0.8903 | 0.0000 | OK | 15 minute winter | 1.017 | 19 | 362.0 | 2.447 | 0.864 | 1.7736 | |
| 15 minute winter | 19 | 12 | 91.468 | 0.199 | 367.5 | 0.4619 | 0.0000 | OK | 15 minute winter | 1.018 | 20 | 357.9 | 2.308 | 0.182 | 3.4466 | |
| 15 minute winter | 20 | 13 | 90.799 | 0.513 | 363.4 | 1.5054 | 0.0000 | OK | 15 minute winter | 1.019 | 21 | 359.3 | 1.161 | 0.651 | 9.0489 | |
| 15 minute winter | 21 | 14 | 90.724 | 0.496 | 364.8 | 1.4451 | 0.0000 | OK | 15 minute winter | 1.020 | 22 | 353.2 | 1.101 | 0.642 | 19.1267 | |

| | | | | | | | | | | | | | | | |
|-------------------|-------|-----|--------|-------|-------|----------|--------|----|-------------------|--------------|-------|-------|-------|-------|---------|
| 15 minute winter | 22 | 14 | 90.639 | 0.530 | 357.1 | 1.5409 | 0.0000 | OK | 15 minute winter | 1.021 | 23 | 363.1 | 1.126 | 0.660 | 4.4768 |
| 15 minute winter | 59 | 10 | 95.148 | 0.046 | 9.7 | 0.0882 | 0.0000 | OK | 15 minute winter | 6.000 | 60 | 9.6 | 0.985 | 0.092 | 0.0775 |
| 15 minute winter | 60 | 10 | 94.874 | 0.087 | 19.3 | 0.1609 | 0.0000 | OK | 15 minute winter | 6.001 | 61 | 19.1 | 1.191 | 0.273 | 0.1460 |
| 15 minute winter | 61 | 10 | 94.726 | 0.104 | 28.8 | 0.1954 | 0.0000 | OK | 15 minute winter | 6.002 | 62 | 28.5 | 1.707 | 0.360 | 0.1493 |
| 15 minute winter | 62 | 10 | 94.449 | 0.108 | 38.2 | 0.1987 | 0.0000 | OK | 15 minute winter | 6.003 | 63 | 37.9 | 1.185 | 0.256 | 0.5463 |
| 15 minute winter | 63 | 11 | 94.234 | 0.182 | 47.6 | 0.3321 | 0.0000 | OK | 15 minute winter | 6.004 | 64 | 46.2 | 1.091 | 0.652 | 2.5695 |
| 15 minute winter | 64 | 11 | 93.939 | 0.210 | 55.3 | 0.4783 | 0.0000 | OK | 15 minute winter | 6.005 | 65 | 55.0 | 0.888 | 0.498 | 0.9044 |
| 15 minute winter | 65 | 11 | 93.886 | 0.202 | 64.1 | 0.4559 | 0.0000 | OK | 15 minute winter | 6.006 | 66 | 63.6 | 1.207 | 0.572 | 1.1851 |
| 15 minute winter | 66 | 11 | 93.775 | 0.161 | 72.7 | 0.3626 | 0.0000 | OK | 15 minute winter | 6.007 | 67 | 71.7 | 1.622 | 0.362 | 2.1738 |
| 15 minute winter | 67 | 12 | 93.291 | 0.157 | 80.8 | 0.3842 | 0.0000 | OK | 15 minute winter | 6.008 | 68 | 80.3 | 1.966 | 0.282 | 0.3741 |
| 15 minute winter | 68 | 11 | 93.090 | 0.141 | 88.5 | 0.3407 | 0.0000 | OK | 15 minute winter | 6.009 | 69 | 88.4 | 2.152 | 0.276 | 0.8638 |
| 15 minute winter | 69 | 11 | 92.571 | 0.159 | 96.9 | 0.3859 | 0.0000 | OK | 15 minute winter | 6.010 | 70 | 96.7 | 2.281 | 0.307 | 0.5925 |
| 15 minute winter | 70 | 11 | 92.216 | 0.148 | 105.1 | 0.3618 | 0.0000 | OK | 15 minute winter | 6.011 | 71 | 105.0 | 2.676 | 0.303 | 1.2583 |
| 15 minute winter | 71 | 12 | 91.252 | 0.141 | 113.2 | 0.3387 | 0.0000 | OK | 15 minute winter | 6.012 | 23 | 113.4 | 3.265 | 0.239 | 0.4076 |
| 15 minute winter | 23 | 14 | 90.583 | 0.502 | 453.1 | 1.4817 | 0.0000 | OK | 15 minute winter | 1.022 | 24 | 456.8 | 1.617 | 0.831 | 4.2964 |
| 15 minute winter | 24 | 14 | 90.135 | 0.234 | 460.7 | 0.6814 | 0.0000 | OK | 15 minute winter | 1.023 | 25 | 462.0 | 1.921 | 0.128 | 5.4867 |
| 15 minute winter | 25 | 14 | 89.656 | 0.495 | 465.9 | 1.4066 | 0.0000 | OK | 15 minute winter | 1.024 | 26 | 467.9 | 1.394 | 0.527 | 12.2177 |
| 15 minute winter | 72 | 10 | 93.019 | 0.077 | 9.7 | 0.1434 | 0.0000 | OK | 15 minute winter | 7.000 | 73 | 9.6 | 0.708 | 0.223 | 0.1426 |
| 15 minute winter | 73 | 10 | 92.961 | 0.091 | 19.3 | 0.1698 | 0.0000 | OK | 15 minute winter | 7.001 | 74 | 19.0 | 1.426 | 0.285 | 0.1133 |
| 15 minute winter | 74 | 10 | 92.806 | 0.076 | 28.7 | 0.1426 | 0.0000 | OK | 15 minute winter | 7.002 | 75 | 28.5 | 1.369 | 0.248 | 0.5695 |
| 15 minute winter | 75 | 11 | 91.561 | 0.158 | 38.2 | 0.2871 | 0.0000 | OK | 15 minute winter | 7.003 | 76 | 37.6 | 1.133 | 0.664 | 0.3652 |
| 15 minute winter | 76 | 11 | 91.470 | 0.197 | 47.0 | 0.3676 | 0.0000 | OK | 15 minute winter | 7.004 | 77 | 47.1 | 1.353 | 0.949 | 0.4979 |
| 15 minute winter | 77 | 11 | 91.188 | 0.121 | 56.2 | 0.2229 | 0.0000 | OK | 15 minute winter | 7.005 | 78 | 56.4 | 1.921 | 0.320 | 0.6089 |
| 15 minute winter | 78 | 11 | 90.689 | 0.139 | 65.5 | 0.2558 | 0.0000 | OK | 15 minute winter | 7.006 | 79 | 65.6 | 2.311 | 0.340 | 0.2659 |
| 15 minute winter | 79 | 11 | 90.385 | 0.115 | 74.7 | 0.2110 | 0.0000 | OK | 15 minute winter | 7.007 | 26 | 74.8 | 3.381 | 0.227 | 0.1479 |
| 15 minute winter | 26 | 14 | 89.535 | 0.447 | 513.8 | 1.3264 | 0.0000 | OK | 15 minute winter | 1.025 | 27 | 513.8 | 2.338 | 0.579 | 1.4822 |
| 15 minute winter | 27 | 14 | 89.321 | 0.246 | 518.8 | 0.9655 | 0.0000 | OK | 15 minute winter | 1.026 | 28 | 519.6 | 1.886 | 0.169 | 12.3585 |
| 15 minute winter | 28 | 14 | 88.604 | 0.569 | 523.5 | 2.2217 | 0.0000 | OK | 15 minute winter | 1.027 | 29 | 518.8 | 1.267 | 0.589 | 10.5847 |
| 15 minute winter | 29 | 15 | 88.524 | 0.540 | 522.7 | 2.1060 | 0.0000 | OK | 15 minute winter | 1.028 | 30-HW | 518.2 | 1.370 | 0.585 | 11.5831 |
| 15 minute winter | 30-HW | 15 | 88.421 | 0.498 | 518.2 | 1.2673 | 0.0000 | OK | 15 minute winter | 1.029 | 31-HW | 520.9 | 1.600 | 0.588 | 3.7525 |
| 240 minute winter | 31-HW | 240 | 88.246 | 0.346 | 137.7 | 582.5882 | 0.0000 | OK | 240 minute winter | 1.030 | 32-FC | 20.7 | 0.296 | 0.023 | 8.1829 |
| 240 minute winter | 32-FC | 240 | 88.246 | 0.411 | 20.7 | 2.9063 | 0.0000 | OK | 240 minute winter | Hydro-Brake® | 33-OF | 19.6 | | | 454.7 |
| 15 minute summer | 33-OF | 1 | 87.135 | 0.000 | 18.6 | 0.0000 | 0.0000 | OK | | | | | | | |

| Results for 30 year Critical Storm Duration. Lowest mass balance: 99.89% | | | | | | | | | | | | | | | | |
|--|---------|-------------|-----------|-----------|--------------|---------------|------------|------------|-----------------------------|-------|---------|---------------|----------------|----------|---------------|--------------------|
| Node Event | US Node | Peak (mins) | Level (m) | Depth (m) | Inflow (l/s) | Node Vol (m³) | Flood (m³) | Status | Link Event (Upstream Depth) | Link | DS Node | Outflow (l/s) | Velocity (m/s) | Flow/Cap | Link Vol (m³) | Discharge Vol (m³) |
| 15 minute winter | 1 | 10 | 96.001 | 0.069 | 18.3 | 0.1288 | 0.0000 | OK | 15 minute winter | 1.000 | 2 | 18.2 | 1.564 | 0.204 | 0.3904 | |
| 15 minute winter | 2 | 11 | 95.834 | 0.434 | 36.5 | 0.6632 | 0.0000 | SURCHARGED | 15 minute winter | 1.001 | 3 | 32.6 | 0.887 | 0.459 | 1.0602 | |
| 15 minute winter | 3 | 11 | 95.817 | 0.554 | 49.4 | 1.1571 | 0.0000 | SURCHARGED | 15 minute winter | 1.002 | 4 | 50.0 | 0.600 | 0.450 | 2.9357 | |
| 15 minute winter | 34 | 10 | 99.652 | 0.060 | 18.3 | 0.1116 | 0.0000 | OK | 15 minute winter | 2.000 | 35 | 18.2 | 0.945 | 0.154 | 0.2073 | |
| 15 minute winter | 35 | 11 | 99.363 | 0.218 | 36.5 | 0.4052 | 0.0000 | OK | 15 minute winter | 2.001 | 36 | 34.1 | 0.882 | 0.857 | 1.4988 | |
| 15 minute winter | 36 | 10 | 99.191 | 0.269 | 51.2 | 0.4727 | 0.0000 | SURCHARGED | 15 minute winter | 2.002 | 37 | 50.5 | 1.284 | 1.261 | 0.3518 | |
| 15 minute winter | 40 | 10 | 99.441 | 0.089 | 18.3 | 0.1668 | 0.0000 | OK | 15 minute winter | 3.000 | 41 | 18.1 | 0.794 | 0.338 | 0.5294 | |
| 15 minute winter | 41 | 10 | 99.265 | 0.162 | 36.4 | 0.3006 | 0.0000 | OK | 15 minute winter | 3.001 | 42 | 35.7 | 1.118 | 0.623 | 0.2274 | |
| 15 minute winter | 42 | 10 | 99.193 | 0.176 | 54.0 | 0.3264 | 0.0000 | OK | 15 minute winter | 3.002 | 37 | 53.4 | 1.749 | 0.778 | 0.2656 | |
| 15 minute winter | 37 | 10 | 99.010 | 0.219 | 122.2 | 0.3912 | 0.0000 | OK | 15 minute winter | 2.003 | 38 | 121.5 | 2.039 | 0.747 | 1.1713 | |
| 15 minute winter | 38 | 11 | 98.625 | 0.255 | 139.7 | 0.4694 | 0.0000 | OK | 15 minute winter | 2.004 | 39 | 139.7 | 3.228 | 0.729 | 0.4671 | |
| 15 minute winter | 39 | 11 | 98.141 | 0.099 | 157.0 | 0.1826 | 0.0000 | OK | 15 minute winter | 2.005 | 4 | 157.2 | 5.119 | 0.246 | 0.3886 | |
| 15 minute winter | 4 | 11 | 95.797 | 0.692 | 220.1 | 1.3973 | 0.0000 | SURCHARGED | 15 minute winter | 1.003 | 5 | 216.7 | 1.368 | 1.355 | 2.8149 | |
| 15 minute winter | 5 | 11 | 95.666 | 0.680 | 234.0 | 1.3765 | 0.0000 | SURCHARGED | 15 minute winter | 1.004 | 6 | 231.8 | 1.073 | 1.071 | 4.2742 | |
| 15 minute winter | 6 | 12 | 95.593 | 0.647 | 249.1 | 1.3158 | 0.0000 | SURCHARGED | 15 minute winter | 1.005 | 7 | 246.8 | 1.142 | 1.140 | 4.0597 | |
| 15 minute winter | 7 | 12 | 95.515 | 0.607 | 264.1 | 1.2418 | 0.0000 | SURCHARGED | 15 minute winter | 1.006 | 8 | 262.1 | 1.213 | 1.201 | 4.5244 | |
| 15 minute winter | 8 | 12 | 95.421 | 0.631 | 279.4 | 1.3136 | 0.0000 | SURCHARGED | 15 minute winter | 1.007 | 9 | 276.9 | 0.983 | 0.972 | 2.7582 | |
| 15 minute winter | 9 | 12 | 95.383 | 0.610 | 294.2 | 1.2897 | 0.0000 | SURCHARGED | 15 minute winter | 1.008 | 10 | 290.6 | 1.042 | 1.011 | 2.5383 | |
| 15 minute winter | 10 | 12 | 95.342 | 0.585 | 307.9 | 1.2586 | 0.0000 | OK | 15 minute winter | 1.009 | 11 | 305.8 | 1.111 | 1.067 | 5.6625 | |
| 15 minute winter | 11 | 12 | 95.277 | 0.556 | 320.1 | 1.2566 | 0.0000 | OK | 15 minute winter | 1.010 | 12 | 320.6 | 1.213 | 1.131 | 5.2084 | |
| 15 minute winter | 12 | 12 | 95.196 | 0.509 | 334.9 | 1.1979 | 0.0000 | OK | 15 minute winter | 1.011 | 13 | 333.8 | 1.496 | 1.175 | 10.7456 | |
| 15 minute winter | 13 | 12 | 94.921 | 0.393 | 348.1 | 0.8814 | 0.0000 | OK | 15 minute winter | 1.012 | 14 | 347.7 | 1.996 | 0.954 | 2.7334 | |
| 15 minute winter | 14 | 12 | 94.775 | 0.271 | 361.9 | 0.6164 | 0.0000 | OK | 15 minute winter | 1.013 | 15 | 360.9 | 3.277 | 0.262 | 2.5358 | |
| 15 minute winter | 15 | 12 | 94.210 | 0.199 | 375.2 | 0.4629 | 0.0000 | OK | 15 minute winter | 1.014 | 16 | 372.8 | 1.882 | 0.197 | 10.9015 | |
| 15 minute winter | 16 | 12 | 92.292 | 0.535 | 387.1 | 1.1777 | 0.0000 | OK | 15 minute winter | 1.015 | 17 | 387.3 | 1.502 | 1.082 | 7.0070 | |
| 15 minute winter | 43 | 10 | 99.584 | 0.084 | 18.3 | 0.1582 | 0.0000 | OK | 15 minute winter | 4.000 | 44 | 18.2 | 0.721 | 0.303 | 0.3055 | |
| 15 minute winter | 44 | 10 | 99.529 | 0.193 | 36.5 | 0.3580 | 0.0000 | OK | 15 minute winter | 4.001 | 45 | 35.7 | 1.010 | 0.834 | 0.2727 | |
| 15 minute winter | 45 | 10 | 99.467 | 0.183 | 54.0 | 0.3415 | 0.0000 | OK | 15 minute winter | 4.002 | 46 | 53.3 | 1.560 | 0.907 | 0.8895 | |
| 15 minute winter | 46 | 11 | 99.132 | 0.180 | 71.4 | 0.3381 | 0.0000 | OK | 15 minute winter | 4.003 | 47 | 71.2 | 2.171 | 0.780 | 0.3018 | |
| 15 minute winter | 47 | 11 | 98.836 | 0.166 | 88.8 | 0.3116 | 0.0000 | OK | 15 minute winter | 4.004 | 48 | 89.2 | 2.937 | 0.832 | 1.1352 | |
| 15 minute winter | 48 | 11 | 97.157 | 0.136 | 106.5 | 0.2507 | 0.0000 | OK | 15 minute winter | 4.005 | 49 | 106.7 | 2.142 | 0.431 | 2.1806 | |
| 15 minute winter | 49 | 11 | 95.157 | 0.283 | 124.0 | 0.4802 | 0.0000 | OK | 15 minute winter | 4.006 | 50 | 121.1 | 1.905 | 0.981 | 1.8678 | |
| 15 minute winter | 57 | 10 | 95.139 | 0.079 | 18.3 | 0.1490 | 0.0000 | OK | 15 minute winter | 5.000 | 58 | 18.2 | 0.816 | 0.270 | 0.3526 | |
| 15 minute winter | 58 | 11 | 94.974 | 0.174 | 36.5 | 0.3170 | 0.0000 | OK | 15 minute winter | 5.001 | 50 | 35.5 | 1.131 | 0.893 | 1.0222 | |
| 15 minute winter | 50 | 11 | 94.732 | 0.274 | 173.9 | 0.6610 | 0.0000 | OK | 15 minute winter | 4.007 | 51 | 174.8 | 2.265 | 0.819 | 4.7643 | |
| 15 minute winter | 51 | 11 | 93.976 | 0.222 | 192.1 | 0.5415 | 0.0000 | OK | 15 minute winter | 4.008 | 52 | 191.5 | 2.522 | 0.524 | 1.1511 | |
| 15 minute winter | 52 | 11 | 93.525 | 0.270 | 208.8 | 0.6514 | 0.0000 | OK | 15 minute winter | 4.009 | 53 | 207.9 | 2.174 | 0.671 | 1.6827 | |
| 15 minute winter | 53 | 11 | 93.174 | 0.341 | 225.2 | 0.8313 | 0.0000 | OK | 15 minute winter | 4.010 | 54 | 223.9 | 2.366 | 0.853 | 0.9312 | |
| 15 minute winter | 54 | 11 | 92.930 | 0.341 | 241.2 | 0.8217 | 0.0000 | OK | 15 minute winter | 4.011 | 55 | 240.2 | 1.899 | 0.646 | 1.4494 | |
| 15 minute winter | 55 | 11 | 92.768 | 0.330 | 257.5 | 0.7949 | 0.0000 | OK | 15 minute winter | 4.012 | 56 | 255.9 | 2.285 | 0.695 | 1.5223 | |
| 15 minute winter | 56 | 11 | 92.472 | 0.285 | 273.2 | 0.6796 | 0.0000 | OK | 15 minute winter | 4.013 | 17 | 272.0 | 2.434 | 0.457 | 2.6334 | |
| 15 minute winter | 17 | 12 | 92.176 | 0.457 | 659.8 | 1.0611 | 0.0000 | OK | 15 minute winter | 1.016 | 18 | 653.8 | 2.273 | 0.562 | 7.9629 | |
| 15 minute winter | 18 | 13 | 91.856 | 0.563 | 668.1 | 1.2997 | 0.0000 | OK | 15 minute winter | 1.017 | 19 | 665.8 | 2.682 | 1.590 | 3.1523 | |
| 15 minute winter | 19 | 13 | 91.656 | 0.387 | 676.3 | 0.8987 | 0.0000 | OK | 15 minute winter | 1.018 | 20 | 681.6 | 2.338 | 0.346 | 5.8978 | |
| 15 minute winter | 20 | 13 | 91.419 | 1.133 | 692.1 | 3.3258 | 0.0000 | SURCHARGED | 15 minute winter | 1.019 | 21 | 696.9 | 1.584 | 1.262 | 12.6570 | |
| 15 minute winter | 21 | 13 | 91.266 | 1.038 | 707.4 | 3.0258 | 0.0000 | SURCHARGED | 15 minute winter | 1.020 | 22 | 709.4 | 1.612 | 1.290 | 26.2435 | |
| 15 minute winter | 22 | 13 | 91.009 | 0.900 | 719.9 | 2.6179 | 0.0000 | SURCHARGED | 15 minute winter | 1.021 | 23 | 721.3 | 1.639 | 1.312 | 6.1001 | |

| | | | | | | | | | | | | | | | |
|-------------------|-------|-----|--------|-------|--------|-----------|--------|------------|-------------------|--------------|-------|--------|-------|-------|---------|
| 15 minute winter | 59 | 10 | 95.165 | 0.063 | 18.3 | 0.1214 | 0.0000 | OK | 15 minute winter | 6.000 | 60 | 18.2 | 1.093 | 0.173 | 0.1307 |
| 15 minute winter | 60 | 10 | 94.920 | 0.134 | 36.5 | 0.2471 | 0.0000 | OK | 15 minute winter | 6.001 | 61 | 36.2 | 1.318 | 0.516 | 0.2489 |
| 15 minute winter | 61 | 10 | 94.782 | 0.160 | 54.5 | 0.3002 | 0.0000 | OK | 15 minute winter | 6.002 | 62 | 53.9 | 1.954 | 0.681 | 0.2464 |
| 15 minute winter | 62 | 11 | 94.509 | 0.168 | 72.2 | 0.3085 | 0.0000 | OK | 15 minute winter | 6.003 | 63 | 71.1 | 1.293 | 0.479 | 0.9040 |
| 15 minute winter | 63 | 11 | 94.437 | 0.386 | 89.4 | 0.7032 | 0.0000 | SURCHARGED | 15 minute winter | 6.004 | 64 | 86.4 | 1.231 | 1.220 | 4.1014 |
| 15 minute winter | 64 | 11 | 94.065 | 0.336 | 103.7 | 0.7649 | 0.0000 | OK | 15 minute winter | 6.005 | 65 | 103.1 | 1.015 | 0.933 | 1.4830 |
| 15 minute winter | 65 | 11 | 94.000 | 0.316 | 120.4 | 0.7133 | 0.0000 | OK | 15 minute winter | 6.006 | 66 | 119.6 | 1.376 | 1.076 | 1.9468 |
| 15 minute winter | 66 | 11 | 93.854 | 0.240 | 136.9 | 0.5407 | 0.0000 | OK | 15 minute winter | 6.007 | 67 | 135.4 | 1.836 | 0.683 | 3.6281 |
| 15 minute winter | 67 | 11 | 93.373 | 0.239 | 152.7 | 0.5824 | 0.0000 | OK | 15 minute winter | 6.008 | 68 | 151.1 | 2.202 | 0.530 | 0.6308 |
| 15 minute winter | 68 | 11 | 93.160 | 0.211 | 167.4 | 0.5086 | 0.0000 | OK | 15 minute winter | 6.009 | 69 | 166.6 | 2.410 | 0.519 | 1.4566 |
| 15 minute winter | 69 | 11 | 92.654 | 0.242 | 183.2 | 0.5868 | 0.0000 | OK | 15 minute winter | 6.010 | 70 | 182.6 | 2.585 | 0.579 | 0.9920 |
| 15 minute winter | 70 | 11 | 92.288 | 0.220 | 198.7 | 0.5362 | 0.0000 | OK | 15 minute winter | 6.011 | 71 | 198.9 | 3.078 | 0.574 | 2.1037 |
| 15 minute winter | 71 | 12 | 91.324 | 0.214 | 214.3 | 0.5112 | 0.0000 | OK | 15 minute winter | 6.012 | 23 | 213.7 | 3.475 | 0.450 | 1.0264 |
| 15 minute winter | 23 | 13 | 90.895 | 0.814 | 925.5 | 2.4021 | 0.0000 | SURCHARGED | 15 minute winter | 1.022 | 24 | 928.0 | 2.160 | 1.688 | 6.2090 |
| 15 minute winter | 24 | 13 | 90.290 | 0.389 | 938.5 | 1.1319 | 0.0000 | OK | 15 minute winter | 1.023 | 25 | 940.2 | 2.156 | 0.260 | 9.5234 |
| 15 minute winter | 25 | 13 | 89.942 | 0.781 | 950.7 | 2.2206 | 0.0000 | OK | 15 minute winter | 1.024 | 26 | 954.7 | 1.749 | 1.075 | 19.7830 |
| 15 minute winter | 72 | 10 | 93.057 | 0.115 | 18.3 | 0.2122 | 0.0000 | OK | 15 minute winter | 7.000 | 73 | 18.1 | 0.805 | 0.422 | 0.2371 |
| 15 minute winter | 73 | 10 | 93.004 | 0.134 | 36.4 | 0.2511 | 0.0000 | OK | 15 minute winter | 7.001 | 74 | 36.1 | 1.625 | 0.539 | 0.1890 |
| 15 minute winter | 74 | 11 | 92.846 | 0.116 | 54.3 | 0.2172 | 0.0000 | OK | 15 minute winter | 7.002 | 75 | 53.1 | 1.559 | 0.462 | 0.8278 |
| 15 minute winter | 75 | 11 | 92.132 | 0.729 | 71.4 | 1.3251 | 0.0000 | SURCHARGED | 15 minute winter | 7.003 | 76 | 68.2 | 1.716 | 1.205 | 0.4361 |
| 15 minute winter | 76 | 11 | 91.859 | 0.586 | 85.5 | 1.0943 | 0.0000 | SURCHARGED | 15 minute winter | 7.004 | 77 | 84.8 | 2.132 | 1.707 | 0.5644 |
| 15 minute winter | 77 | 11 | 91.244 | 0.177 | 102.1 | 0.3252 | 0.0000 | OK | 15 minute winter | 7.005 | 78 | 101.9 | 2.141 | 0.580 | 0.9903 |
| 15 minute winter | 78 | 11 | 90.758 | 0.208 | 119.2 | 0.3825 | 0.0000 | OK | 15 minute winter | 7.006 | 79 | 119.0 | 2.543 | 0.617 | 0.4381 |
| 15 minute winter | 79 | 11 | 90.441 | 0.171 | 136.3 | 0.3137 | 0.0000 | OK | 15 minute winter | 7.007 | 26 | 136.3 | 3.808 | 0.413 | 0.2389 |
| 15 minute winter | 26 | 13 | 89.753 | 0.665 | 1076.2 | 1.9734 | 0.0000 | OK | 15 minute winter | 1.025 | 27 | 1081.9 | 3.001 | 1.220 | 2.4582 |
| 15 minute winter | 27 | 12 | 89.461 | 0.386 | 1089.2 | 1.5142 | 0.0000 | OK | 15 minute winter | 1.026 | 28 | 1097.2 | 2.186 | 0.357 | 19.6481 |
| 15 minute winter | 28 | 13 | 89.041 | 1.006 | 1107.7 | 3.9273 | 0.0000 | SURCHARGED | 15 minute winter | 1.027 | 29 | 1104.1 | 1.742 | 1.254 | 16.3837 |
| 15 minute winter | 29 | 13 | 88.890 | 0.906 | 1114.6 | 3.5366 | 0.0000 | SURCHARGED | 15 minute winter | 1.028 | 30-HW | 1117.8 | 1.808 | 1.263 | 18.6823 |
| 15 minute winter | 30-HW | 13 | 88.708 | 0.785 | 1117.8 | 1.9989 | 0.0000 | OK | 15 minute winter | 1.029 | 31-HW | 1123.3 | 2.102 | 1.268 | 6.1100 |
| 480 minute winter | 31-HW | 472 | 88.573 | 0.673 | 145.8 | 1239.2270 | 0.0000 | OK | 480 minute winter | 1.030 | 32-FC | 21.0 | 0.284 | 0.024 | 17.2059 |
| 480 minute winter | 32-FC | 472 | 88.573 | 0.738 | 21.0 | 5.2193 | 0.0000 | OK | 480 minute winter | Hydro-Brake® | 33-OF | 19.6 | | | 682.3 |
| 15 minute summer | 33-OF | 1 | 87.135 | 0.000 | 19.6 | 0.0000 | 0.0000 | OK | | | | | | | |

| Results for 100 year +40% CC Critical Storm Duration. Lowest mass balance: 99.89% | | | | | | | | | | | | | | | | |
|---|---------|-------------|-----------|-----------|--------------|---------------|------------|--------|-----------------------------|------------------|---------|---------------|----------------|----------|---------------|--------------------|
| Node Event | US Node | Peak (mins) | Level (m) | Depth (m) | Inflow (l/s) | Node Vol (m³) | Flood (m³) | Status | Link Event (Upstream Depth) | Link | DS Node | Outflow (l/s) | Velocity (m/s) | Flow/Cap | Link Vol (m³) | Discharge Vol (m³) |
| 15 minute winter | 1 | | 12 | 97.305 | 1.372 | 33.3 | 2.5734 | 0.0000 | FLOOD RISK | 15 minute winter | 1.000 | 27.8 | 1.534 | 0.312 | 0.6248 | |
| 15 minute winter | 2 | | 12 | 97.250 | 1.850 | 54.4 | 2.8292 | 0.0000 | SURCHARGED | 15 minute winter | 1.001 | 54.0 | 0.859 | 0.761 | 1.0602 | |
| 15 minute winter | 3 | | 12 | 97.200 | 1.937 | 79.1 | 4.0467 | 0.0000 | SURCHARGED | 15 minute winter | 1.002 | 82.8 | 0.750 | 0.745 | 2.9357 | |
| 15 minute winter | 34 | | 12 | 100.557 | 0.965 | 33.3 | 1.8096 | 0.0000 | SURCHARGED | 15 minute winter | 2.000 | 26.3 | 0.980 | 0.223 | 0.3472 | |
| 15 minute winter | 35 | | 12 | 100.523 | 1.378 | 56.0 | 2.5615 | 0.0000 | FLOOD RISK | 15 minute winter | 2.001 | 52.5 | 1.321 | 1.321 | 1.5061 | |
| 15 minute winter | 36 | | 12 | 100.077 | 1.155 | 80.8 | 2.0283 | 0.0000 | SURCHARGED | 15 minute winter | 2.002 | 78.9 | 1.985 | 1.971 | 0.3730 | |
| 15 minute winter | 40 | | 12 | 100.281 | 0.929 | 33.3 | 1.7320 | 0.0000 | SURCHARGED | 15 minute winter | 3.000 | 26.9 | 0.812 | 0.502 | 0.9305 | |
| 15 minute winter | 41 | | 12 | 100.203 | 1.100 | 57.1 | 2.0423 | 0.0000 | SURCHARGED | 15 minute winter | 3.001 | 53.9 | 1.354 | 0.939 | 0.2829 | |
| 15 minute winter | 42 | | 12 | 100.076 | 1.059 | 83.0 | 1.9610 | 0.0000 | SURCHARGED | 15 minute winter | 3.002 | 80.8 | 2.033 | 1.179 | 0.3463 | |
| 15 minute winter | 37 | | 12 | 99.750 | 0.959 | 185.8 | 1.7094 | 0.0000 | SURCHARGED | 15 minute winter | 2.003 | 186.8 | 2.652 | 1.147 | 1.3881 | |
| 15 minute winter | 38 | | 12 | 98.990 | 0.620 | 213.4 | 1.1388 | 0.0000 | SURCHARGED | 15 minute winter | 2.004 | 213.7 | 3.309 | 1.115 | 0.6496 | |
| 15 minute winter | 39 | | 12 | 98.231 | 0.189 | 242.9 | 0.3473 | 0.0000 | OK | 15 minute winter | 2.005 | 241.3 | 4.756 | 0.378 | 0.5016 | |
| 15 minute winter | 4 | | 12 | 97.142 | 2.037 | 345.2 | 4.1151 | 0.0000 | SURCHARGED | 15 minute winter | 1.003 | 346.1 | 2.184 | 2.164 | 2.8149 | |
| 15 minute winter | 5 | | 12 | 96.813 | 1.827 | 372.1 | 3.6983 | 0.0000 | SURCHARGED | 15 minute winter | 1.004 | 372.8 | 1.726 | 1.722 | 4.2742 | |
| 15 minute winter | 6 | | 12 | 96.620 | 1.674 | 398.8 | 3.4026 | 0.0000 | SURCHARGED | 15 minute winter | 1.005 | 399.7 | 1.850 | 1.846 | 4.0597 | |
| 15 minute winter | 7 | | 12 | 96.404 | 1.496 | 425.7 | 3.0611 | 0.0000 | SURCHARGED | 15 minute winter | 1.006 | 426.5 | 1.975 | 1.955 | 4.5244 | |
| 15 minute winter | 8 | | 12 | 96.142 | 1.352 | 452.5 | 2.8136 | 0.0000 | SURCHARGED | 15 minute winter | 1.007 | 453.4 | 1.610 | 1.592 | 2.7582 | |
| 15 minute winter | 9 | | 12 | 96.034 | 1.261 | 479.4 | 2.6650 | 0.0000 | SURCHARGED | 15 minute winter | 1.008 | 480.3 | 1.705 | 1.670 | 2.5466 | |
| 15 minute winter | 10 | | 12 | 95.916 | 1.159 | 506.3 | 2.4925 | 0.0000 | SURCHARGED | 15 minute winter | 1.009 | 507.2 | 1.801 | 1.771 | 5.7744 | |
| 15 minute winter | 11 | | 12 | 95.723 | 1.002 | 533.2 | 2.2629 | 0.0000 | SURCHARGED | 15 minute winter | 1.010 | 534.0 | 1.896 | 1.883 | 5.5634 | |
| 15 minute winter | 12 | | 12 | 95.514 | 0.827 | 560.0 | 1.9458 | 0.0000 | SURCHARGED | 15 minute winter | 1.011 | 561.8 | 2.024 | 1.978 | 12.8285 | |
| 15 minute winter | 13 | | 12 | 95.065 | 0.537 | 587.8 | 1.2043 | 0.0000 | OK | 15 minute winter | 1.012 | 588.6 | 2.303 | 1.615 | 3.9602 | |
| 15 minute winter | 14 | | 12 | 94.876 | 0.372 | 614.6 | 0.8470 | 0.0000 | OK | 15 minute winter | 1.013 | 616.0 | 3.560 | 0.447 | 4.2283 | |
| 15 minute winter | 15 | | 13 | 94.339 | 0.328 | 642.0 | 0.7642 | 0.0000 | OK | 15 minute winter | 1.014 | 630.1 | 2.105 | 0.333 | 14.7442 | |
| 15 minute winter | 16 | | 13 | 93.818 | 2.061 | 656.1 | 4.5363 | 0.0000 | SURCHARGED | 15 minute winter | 1.015 | 645.9 | 1.809 | 1.804 | 8.9277 | |
| 15 minute winter | 43 | | 12 | 100.778 | 1.278 | 33.3 | 2.3963 | 0.0000 | FLOOD RISK | 15 minute winter | 4.000 | 24.1 | 0.739 | 0.401 | 0.4882 | |
| 15 minute winter | 44 | | 12 | 100.742 | 1.405 | 55.1 | 2.6124 | 0.0000 | FLOOD RISK | 15 minute winter | 4.001 | 48.1 | 1.209 | 1.123 | 0.3068 | |
| 15 minute winter | 45 | | 12 | 100.640 | 1.355 | 76.8 | 2.5360 | 0.0000 | FLOOD RISK | 15 minute winter | 4.002 | 72.1 | 1.814 | 1.226 | 1.0333 | |
| 15 minute winter | 46 | | 12 | 100.048 | 1.096 | 99.3 | 2.0556 | 0.0000 | SURCHARGED | 15 minute winter | 4.003 | 96.1 | 2.418 | 1.053 | 0.3662 | |
| 15 minute winter | 47 | | 12 | 99.572 | 0.902 | 124.0 | 1.6905 | 0.0000 | SURCHARGED | 15 minute winter | 4.004 | 121.3 | 3.049 | 1.132 | 1.4873 | |
| 15 minute winter | 48 | | 13 | 97.274 | 0.253 | 150.0 | 0.4658 | 0.0000 | OK | 15 minute winter | 4.005 | 146.1 | 2.248 | 0.590 | 2.9196 | |
| 15 minute winter | 49 | | 13 | 96.624 | 1.749 | 177.5 | 2.9682 | 0.0000 | FLOOD RISK | 15 minute winter | 4.006 | 156.4 | 2.222 | 1.267 | 1.9521 | |
| 15 minute winter | 57 | | 13 | 96.138 | 1.078 | 33.3 | 2.0214 | 0.0000 | SURCHARGED | 15 minute winter | 5.000 | 25.7 | 0.864 | 0.383 | 0.6214 | |
| 15 minute winter | 58 | | 13 | 96.113 | 1.313 | 57.1 | 2.3918 | 0.0000 | FLOOD RISK | 15 minute winter | 5.001 | 49.8 | 1.253 | 1.252 | 1.2953 | |
| 15 minute winter | 50 | | 13 | 95.928 | 1.470 | 237.6 | 3.5477 | 0.0000 | FLOOD RISK | 15 minute winter | 4.007 | 217.8 | 2.230 | 1.020 | 6.8172 | |
| 15 minute winter | 51 | | 13 | 95.133 | 1.379 | 249.2 | 3.3642 | 0.0000 | FLOOD RISK | 15 minute winter | 4.008 | 236.6 | 2.455 | 0.647 | 1.6607 | |
| 15 minute winter | 52 | | 13 | 94.818 | 1.564 | 269.9 | 3.7703 | 0.0000 | FLOOD RISK | 15 minute winter | 4.009 | 262.5 | 2.380 | 0.848 | 1.9514 | |
| 15 minute winter | 53 | | 13 | 94.408 | 1.575 | 295.8 | 3.8430 | 1.0324 | FLOOD | 15 minute winter | 4.010 | 290.3 | 2.632 | 1.107 | 1.0881 | |
| 15 minute winter | 54 | | 13 | 94.114 | 1.525 | 323.6 | 3.6761 | 0.0000 | FLOOD RISK | 15 minute winter | 4.011 | 317.6 | 2.005 | 0.854 | 1.8126 | |
| 15 minute winter | 55 | | 13 | 93.957 | 1.519 | 350.9 | 3.6610 | 0.0000 | FLOOD RISK | 15 minute winter | 4.012 | 335.0 | 2.365 | 0.910 | 2.1542 | |
| 15 minute winter | 56 | | 13 | 93.759 | 1.572 | 368.3 | 3.7448 | 0.0000 | FLOOD RISK | 15 minute winter | 4.013 | 361.2 | 2.457 | 0.606 | 4.5494 | |
| 15 minute winter | 17 | | 13 | 93.622 | 1.902 | 977.0 | 4.4202 | 2.0627 | FLOOD | 15 minute winter | 1.016 | 951.5 | 2.666 | 0.818 | 9.9326 | |
| 15 minute winter | 18 | | 13 | 93.166 | 1.874 | 967.3 | 4.3229 | 0.0000 | FLOOD RISK | 15 minute winter | 1.017 | 971.0 | 2.759 | 2.319 | 4.2455 | |
| 15 minute winter | 19 | | 13 | 92.858 | 1.589 | 984.9 | 3.6869 | 0.0000 | SURCHARGED | 15 minute winter | 1.018 | 990.4 | 2.775 | 0.503 | 7.4030 | |
| 15 minute winter | 20 | | 13 | 92.441 | 2.155 | 1003.7 | 6.3246 | 0.0000 | SURCHARGED | 15 minute winter | 1.019 | 1010.8 | 2.297 | 1.831 | 12.6570 | |
| 15 minute winter | 21 | | 13 | 92.122 | 1.894 | 1024.1 | 5.5202 | 0.0000 | SURCHARGED | 15 minute winter | 1.020 | 1031.2 | 2.343 | 1.876 | 26.2435 | |
| 15 minute winter | 22 | | 13 | 91.584 | 1.475 | 1045.6 | 4.2887 | 0.0000 | SURCHARGED | 15 minute winter | 1.021 | 1051.2 | 2.389 | 1.912 | 6.1001 | |

| | | | | | | | | | | | | | | | |
|-------------------|-------|-----|--------|-------|--------|-----------|--------|------------|-------------------|--------------|-------|--------|-------|-------|---------|
| 15 minute winter | 59 | 12 | 96.066 | 0.964 | 33.3 | 1.8532 | 0.0000 | SURCHARGED | 15 minute winter | 6.000 | 60 | 25.3 | 1.100 | 0.240 | 0.3087 |
| 15 minute winter | 60 | 12 | 96.038 | 1.252 | 55.1 | 2.3128 | 0.0000 | FLOOD RISK | 15 minute winter | 6.001 | 61 | 49.0 | 1.358 | 0.698 | 0.3613 |
| 15 minute winter | 61 | 12 | 95.918 | 1.296 | 79.1 | 2.4292 | 0.0000 | FLOOD RISK | 15 minute winter | 6.002 | 62 | 73.1 | 1.957 | 0.924 | 0.3555 |
| 15 minute winter | 62 | 12 | 95.648 | 1.307 | 103.3 | 2.4024 | 0.0000 | FLOOD RISK | 15 minute winter | 6.003 | 63 | 97.3 | 1.382 | 0.656 | 1.1474 |
| 15 minute winter | 63 | 12 | 95.469 | 1.417 | 128.1 | 2.5845 | 0.0000 | FLOOD RISK | 15 minute winter | 6.004 | 64 | 121.9 | 1.731 | 1.722 | 4.2659 |
| 15 minute winter | 64 | 12 | 94.632 | 0.903 | 153.3 | 2.0590 | 0.0000 | SURCHARGED | 15 minute winter | 6.005 | 65 | 146.1 | 1.325 | 1.322 | 1.6096 |
| 15 minute winter | 65 | 12 | 94.508 | 0.824 | 178.0 | 1.8586 | 0.0000 | SURCHARGED | 15 minute winter | 6.006 | 66 | 174.6 | 1.583 | 1.570 | 2.4725 |
| 15 minute winter | 66 | 12 | 94.280 | 0.666 | 207.9 | 1.4991 | 0.0000 | SURCHARGED | 15 minute winter | 6.007 | 67 | 199.7 | 1.931 | 1.007 | 5.3889 |
| 15 minute winter | 67 | 12 | 93.723 | 0.589 | 233.0 | 1.4375 | 0.0000 | SURCHARGED | 15 minute winter | 6.008 | 68 | 227.2 | 2.332 | 0.796 | 1.0091 |
| 15 minute winter | 68 | 12 | 93.508 | 0.559 | 260.5 | 1.3477 | 0.0000 | SURCHARGED | 15 minute winter | 6.009 | 69 | 257.2 | 2.489 | 0.802 | 2.3124 |
| 15 minute winter | 69 | 12 | 93.061 | 0.649 | 290.5 | 1.5755 | 0.0000 | SURCHARGED | 15 minute winter | 6.010 | 70 | 274.0 | 2.632 | 0.869 | 1.5390 |
| 15 minute winter | 70 | 13 | 92.658 | 0.590 | 307.3 | 1.4383 | 0.0000 | SURCHARGED | 15 minute winter | 6.011 | 71 | 298.6 | 3.125 | 0.861 | 3.5367 |
| 15 minute winter | 71 | 13 | 91.820 | 0.710 | 331.9 | 1.6988 | 0.0000 | SURCHARGED | 15 minute winter | 6.012 | 23 | 321.1 | 3.698 | 0.676 | 1.2932 |
| 15 minute winter | 23 | 13 | 91.342 | 1.261 | 1374.1 | 3.7205 | 0.0000 | SURCHARGED | 15 minute winter | 1.022 | 24 | 1376.2 | 3.127 | 2.503 | 6.7030 |
| 15 minute winter | 24 | 13 | 90.909 | 1.008 | 1395.3 | 2.9332 | 0.0000 | SURCHARGED | 15 minute winter | 1.023 | 25 | 1397.1 | 2.290 | 0.386 | 14.2586 |
| 15 minute winter | 25 | 13 | 90.679 | 1.518 | 1416.2 | 4.3166 | 0.0000 | SURCHARGED | 15 minute winter | 1.024 | 26 | 1418.0 | 2.238 | 1.597 | 23.0763 |
| 15 minute winter | 72 | 12 | 93.930 | 0.988 | 33.3 | 1.8290 | 0.0000 | SURCHARGED | 15 minute winter | 7.000 | 73 | 27.0 | 0.833 | 0.629 | 0.4195 |
| 15 minute winter | 73 | 12 | 93.888 | 1.018 | 56.7 | 1.9079 | 0.0000 | SURCHARGED | 15 minute winter | 7.001 | 74 | 53.9 | 1.636 | 0.805 | 0.3369 |
| 15 minute winter | 74 | 12 | 93.746 | 1.016 | 82.2 | 1.9048 | 0.0000 | SURCHARGED | 15 minute winter | 7.002 | 75 | 80.8 | 2.031 | 0.703 | 1.0910 |
| 15 minute winter | 75 | 11 | 92.948 | 1.545 | 108.6 | 2.8073 | 2.3403 | FLOOD | 15 minute winter | 7.003 | 76 | 93.6 | 2.354 | 1.652 | 0.4361 |
| 15 minute winter | 76 | 11 | 92.497 | 1.224 | 125.6 | 2.2885 | 0.0000 | FLOOD RISK | 15 minute winter | 7.004 | 77 | 119.2 | 2.997 | 2.399 | 0.5701 |
| 15 minute winter | 77 | 12 | 91.510 | 0.443 | 150.6 | 0.8148 | 0.0000 | SURCHARGED | 15 minute winter | 7.005 | 78 | 150.4 | 2.233 | 0.855 | 1.4612 |
| 15 minute winter | 78 | 12 | 91.068 | 0.518 | 181.8 | 0.9504 | 0.0000 | SURCHARGED | 15 minute winter | 7.006 | 79 | 180.9 | 2.634 | 0.938 | 0.6592 |
| 15 minute winter | 79 | 13 | 90.724 | 0.454 | 212.3 | 0.8354 | 0.0000 | SURCHARGED | 15 minute winter | 7.007 | 26 | 210.3 | 4.057 | 0.638 | 0.4701 |
| 15 minute winter | 26 | 13 | 90.374 | 1.286 | 1617.8 | 3.8161 | 0.0000 | SURCHARGED | 15 minute winter | 1.025 | 27 | 1619.6 | 3.125 | 1.826 | 4.1303 |
| 15 minute winter | 27 | 13 | 90.167 | 1.092 | 1638.7 | 4.2772 | 0.0000 | SURCHARGED | 15 minute winter | 1.026 | 28 | 1641.0 | 2.590 | 0.534 | 27.8208 |
| 15 minute winter | 28 | 13 | 89.712 | 1.677 | 1660.1 | 6.5472 | 0.0000 | SURCHARGED | 15 minute winter | 1.027 | 29 | 1661.7 | 2.622 | 1.887 | 16.3862 |
| 15 minute winter | 29 | 13 | 89.365 | 1.381 | 1680.8 | 5.3885 | 0.0000 | SURCHARGED | 15 minute winter | 1.028 | 30-HW | 1681.9 | 2.654 | 1.900 | 19.4004 |
| 720 minute winter | 30-HW | 720 | 89.093 | 1.170 | 190.8 | 2.9784 | 0.0000 | SURCHARGED | 720 minute winter | 1.029 | 31-HW | 189.5 | 0.774 | 0.214 | 7.3061 |
| 720 minute winter | 31-HW | 720 | 89.092 | 1.192 | 189.5 | 2597.9090 | 0.0000 | SURCHARGED | 720 minute winter | 1.030 | 32-FC | 20.9 | 0.276 | 0.024 | 20.4665 |
| 720 minute winter | 32-FC | 720 | 89.092 | 1.257 | 20.9 | 8.8833 | 0.0000 | SURCHARGED | 720 minute winter | Hydro-Brake® | 33-OF | 19.6 | | | 957.0 |
| 15 minute summer | 33-OF | 1 | 87.135 | 0.000 | 19.6 | 0.0000 | 0.0000 | OK | | | | | | | |

Appendix 6 – SUDS Maintenance Strategy



1. The SUDS Proposals

- 1.1 The SUDs on the proposed development site are to consist of an attenuation basin. The basin will attenuate the contributions of site wide surface water with restricted flows to the receiving watercourses.
- 1.2 The attenuation basins provide storage for all storm events up to and including the 100 year plus 40% event, including the necessary allowance for potential urban creep.

2. Design and Adoption

- 2.1 This SUDS features will not be adopted by the Local Authority with designs for these areas being assessed through the planning permission process. They have been developed in line with the latest CIRIA guidance as per engineering good practice, and the yet to be adopted DeFRA SuDS design standards.

3. Maintenance

- 3.1 The below table is a typical maintenance regime for such assets, which is based on good practice and general current procedures:

| Activity | Indicative frequency | Typical tasks | Maintenance Liability |
|-----------------------------|---|--|-----------------------|
| Routine/regular maintenance | Monthly | • Litter picking | Management Company |
| | | • Grass cutting | Management Company |
| | | • Inspection of Inlets, outlets and control structures | Management Company |
| Occasional maintenance | Annually | • Silt control around components | Management Company |
| | | • Vegetation management around components | Management Company |
| | | • Suction sweeping of permeable paving | N/A |
| | | • Silt removal from catchpits, soakways and cellular storage | Management Company |
| Remedial maintenance | As required (tasks to repair problems due to damage or vandalism) | • Inlet/outlet repair | Management Company |
| | | • Erosion repairs | Management Company |
| | | • Reinstatement of edgings | N/A |
| | | • Reinstatement following pollution | Management Company |
| | | • Removal of silt build up | Management Company |

4. Maintenance

- 4.1 Undertaking the above maintenance regime of the SUDS features, including occasional removal of silt and vegetation that gathers in SUDS, is required to ensure long term performance.



4.2 Organic waste should be used around the SUDS components or schemes to form wildlife piles. If this is not practical it should be composted or, as a last resort, removed to a licensed landfill site. The Environment Agency has adopted a risk-based approach in relation to removal of silt from SUDS (Environment agency 2011).

4.3 Green waste from SUDS components and schemes is much the same as waste from normal landscape maintenance and can be managed by:

- Shredded for surface spreading like a mulch
- The development of wildlife piles to provide habitat, refuges, shelter etc. When they biodegrade, they can compost.
- On or offsite (Council Green Waste) composting which can provide useful mulching
- Disposal to landfill often as a last resort

5. Reliability

5.1 The reliability of SUDS is critically dependent on the quality of the design and construction, in particular the management of silt.

5.2 The proposed development of SUDS features have been designed to accommodate flows up to the 100yr + 40% envelope within which they are intended to operate with additional freeboard (circa 300mm).

5.3 We understand that this design envelope mitigates future flooding risks to the development and also provides an abundant whole life cycle design life in line with modern planning requirements.

6. Health and Safety

6.1 These SUDS features have been designed to be as shallow as possible with gentle side slopes, which should minimize health and safety risks.

6.2 The design guide used for these features (CIRIA's SUDS Manual and DeFRA's Technical Standards for Sustainable Drainage Systems) incorporates health and safety implications of these SUDS components. Also, the proposals are incorporated within the Construction, Design and Management Regulations 2015, which requires hazards to be removed by good design wherever possible rather than providing mitigation to manage risk.

6.3 Those responsible for the maintenance and management of SUDS should take appropriate health and safety precautions for activities and risk assessments should be undertaken.

Appendix 7 – Severn Trent Water Development Enquiry Response and Sewer Records

30th July 2018

Travis Baker
Trinity Point
New Road
Halesowen
B63 3HY

FAO – Mr. D. Baker

Dear Mr. Baker,

Proposed Development at Land off Hither Green Lane, Redditch

I refer to your 'Development Enquiry Request' in respect of the above named site. Please find enclosed the sewer records that are included in the fee together with the Supplementary Guidance Notes, which refer to surface water disposal from development sites.

Protective Strips

Due to recent change in legislation, there could be sewers, which have transferred over to the Company that are not shown on the statutory sewer records, but are located on your clients land. These sewers will have protective strips that we will not allow to be built over. The sewers could be identified whilst the land is being surveyed. If this is the case, please contact us for further guidance upon discovery.

Foul Water Drainage

The overall development, for 114 properties will generate approximately, 1.7784 l/s (2xDWF). With a 50/50 split of the development, due to levels generating 0.8892 l/s, per 57 properties. The sewer records show a 375mm diameter foul water sewer, south of the site. In addition, they demonstrate a 150mm diameter foul sewer, within Hither Green Lane. I confirm that foul flows from a development with your suggested splitting of flows (57 to 375mm diameter sewer and 57 to 150mm diameter sewer) should not have an adverse hydraulic impact on the aforementioned sewers. A connection is therefore acceptable to the Company, subject to formal S106 approval (see later). Please note we do not have any recorded flooding incidents, within the area.

Severn Trent Water Ltd
Regis Road
Wolverhampton
WV6 8RU

Tel: 01902 793871

www.stwater.co.uk
net.dev.west@severntrent.co.uk

Contact: Asset Protection
(waste water)

Your Ref:
Our Ref: ME/8320201

Surface Water Drainage

Under the terms of Section H of the Building Regulations 2010, the disposal of surface water by means of soakaways should be considered as the primary method. If this is not practical and no watercourse is available as an alternative, the use of sewerage should be considered. In addition, other sustainable drainage methods should also be explored before a discharge to the public sewerage system is considered, including a discharge to the adjacent pond. I appreciate, the requirement to split the site, due topography levels. With the majority of the flows, discharging to the River Arrow.

Having viewed the statutory sewer records, they demonstrate a 300>375mm diameter surface water sewer, within Hither Green Lane. If ground conditions are not favourable, for soakaways and other SUDs techniques, evidence should be submitted. This would satisfy the SGN (enclosed). A connection to the aforementioned surface water sewer, for (approximate) 1100m² area should be considered once all avenues have been exhausted. With attenuation and flows in accordance with SGN (Greenfield) or as stipulated by the Lead Local Flood Authority (Local Council Authority), as statutory consultee in the planning process.

Connections


For any new connections including the use, reuse and indirect to the public sewerage system, the developer will need to submit Section 106 application. Our Developer Services department are responsible for handling all such enquiries and applications. To contact them for an application form and associated guidance notes please call 0800 7076600 or download from www.stwater.co.uk

Please quote 8320201 in any future correspondence (including e-mails) with STW Limited. Please note that Developer Enquiry responses are only valid for 6 months from the date of this letter.

Yours Sincerely,



Matthew Evans
Asset Protection (wastewater)
Severn Trent Water Ltd

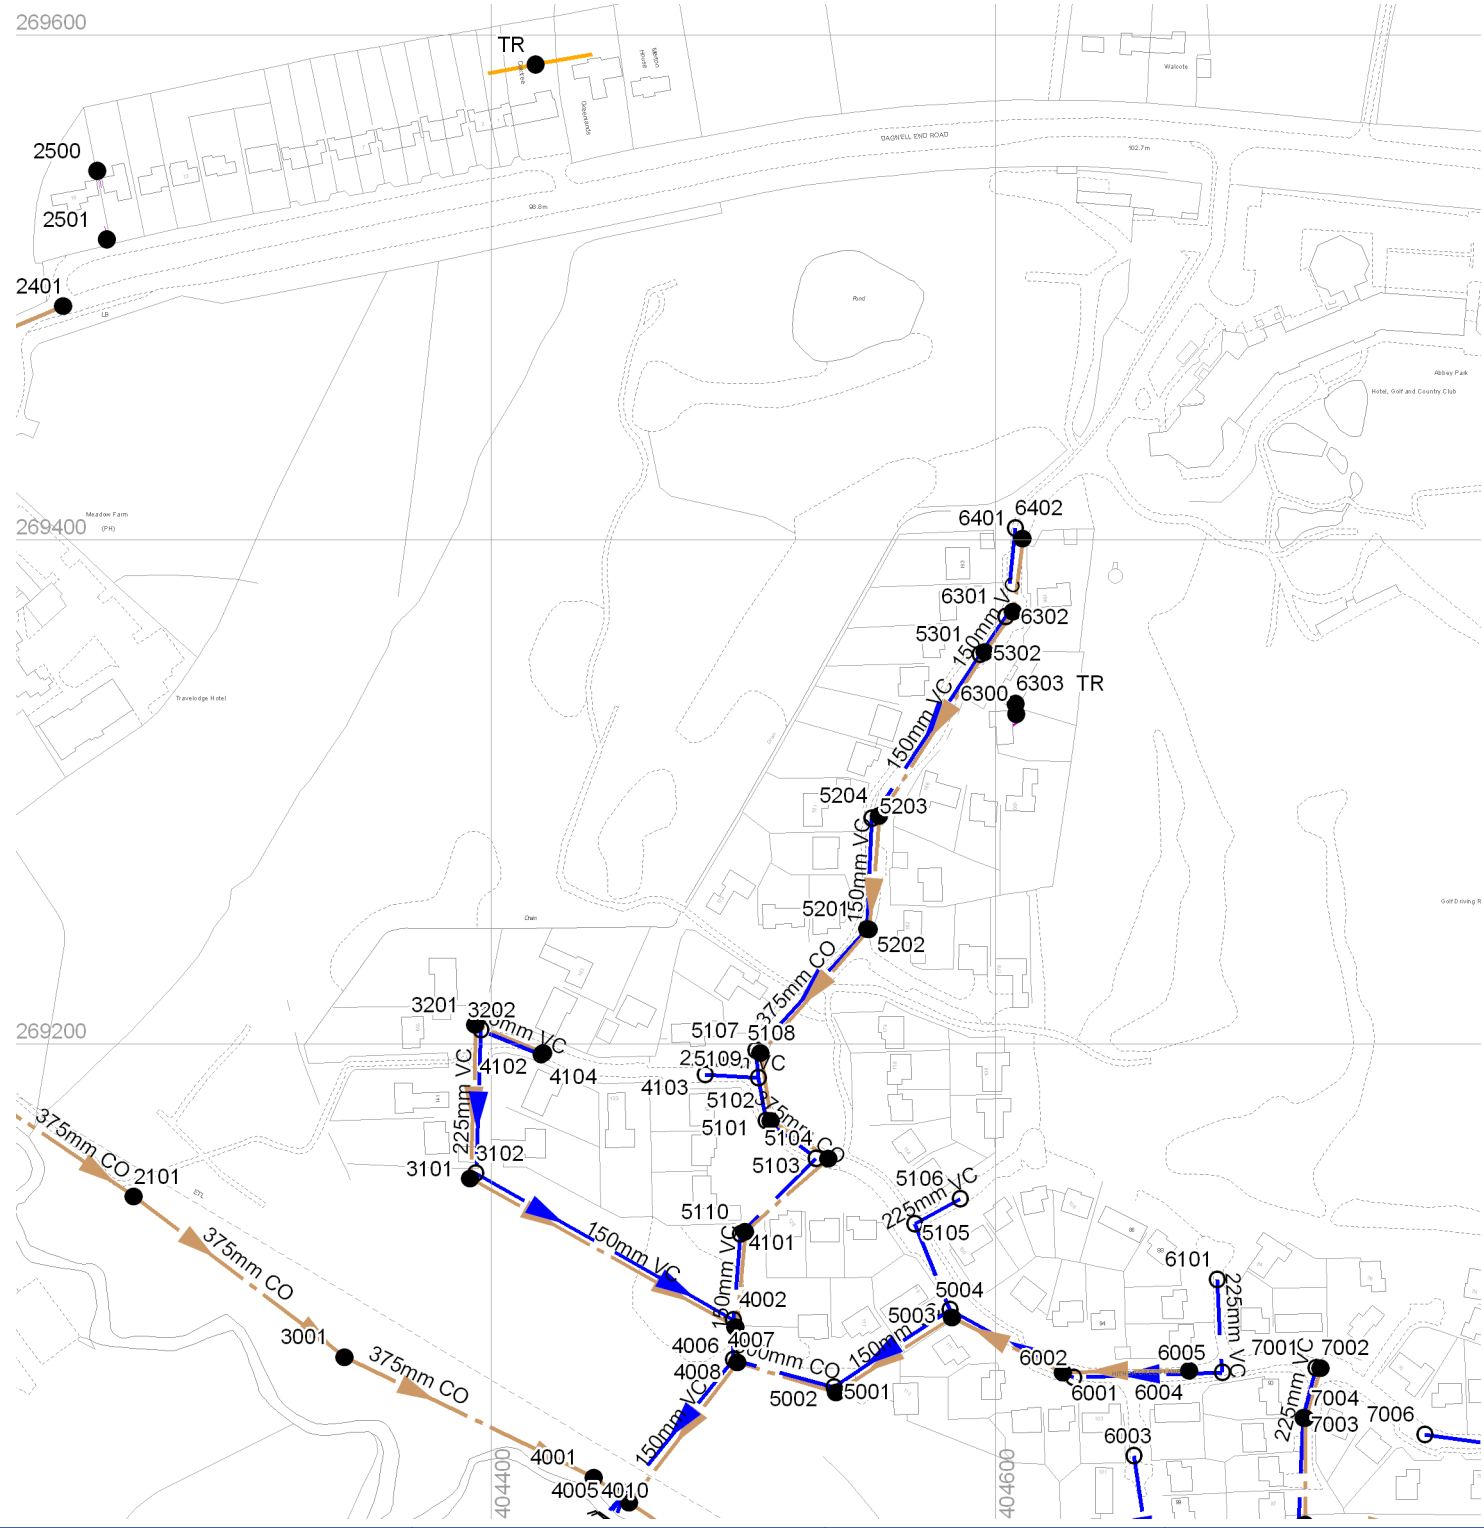

Sewer Node Sewer Pipe Data

| REFERENCE | COVER LEVEL | INV LEVEL UPSTR | INV LEVEL DOWNSTR | PURP | MATL | SHAPE | MAX SIZE | MIN SIZE | GRADIENT | YEAR LAID |
|------------|-------------|-----------------|-------------------|------|------|-------|----------|----------|----------|-----------|
| SP04692101 | 89.82 | 87.35 | 86.90 | F | CO | C | 375 | nil | 234.67 | nil |
| SP04692401 | 95.33 | 93.11 | nil | F | VC | C | 300 | nil | 0.00 | nil |
| SP04693001 | 88.63 | 86.90 | 86.43 | F | CO | C | 375 | nil | 234.09 | nil |
| SP04693101 | 89.61 | 88.34 | 87.69 | F | VC | C | 150 | nil | 185.29 | nil |
| SP04693102 | 89.72 | 88.50 | 88.11 | S | CO | C | 300 | nil | 300.87 | nil |
| SP04693201 | 90.59 | 89.04 | 88.34 | F | VC | C | 150 | nil | 87.19 | nil |
| SP04693202 | 90.62 | 89.46 | 88.62 | S | VC | C | 225 | nil | 67.90 | nil |
| SP04694001 | 87.83 | 86.42 | 86.31 | F | CO | C | 375 | nil | 156.36 | nil |
| SP04694002 | 89.46 | 88.04 | 87.49 | S | CO | C | 375 | nil | 29.09 | nil |
| SP04694003 | 87.60 | 86.31 | 85.91 | F | CO | C | 375 | nil | 219.15 | nil |
| SP04694004 | 87.59 | 85.80 | 85.75 | S | CO | C | 300 | nil | 184.40 | nil |
| SP04694004 | 87.59 | 85.80 | 85.76 | S | CO | C | 300 | nil | 215.00 | nil |
| SP04694004 | 87.59 | 85.79 | 85.75 | S | CO | C | 300 | nil | 213.50 | nil |
| SP04694006 | 89.40 | 87.64 | 87.27 | F | VC | C | 150 | nil | 37.95 | nil |
| SP04694007 | 88.89 | 87.44 | 85.82 | S | CO | C | 375 | nil | 42.13 | nil |
| SP04694008 | 88.95 | 87.25 | 86.53 | F | VC | C | 150 | nil | 98.06 | nil |
| SP04694101 | 91.02 | 89.26 | 88.09 | S | CO | C | 375 | nil | 29.17 | nil |
| SP04694102 | 90.93 | 89.28 | 89.04 | F | VC | C | 150 | nil | 121.46 | nil |
| SP04694103 | 92.43 | 90.92 | 90.85 | S | VC | C | 225 | nil | 300.29 | nil |
| SP04694104 | 90.91 | 89.61 | 89.48 | S | VC | C | 225 | nil | 200.00 | nil |
| SP04695001 | 90.00 | 88.10 | 87.29 | F | VC | C | 150 | nil | 50.37 | nil |
| SP04695002 | 90.06 | 88.43 | 87.55 | S | CO | C | 300 | nil | 47.14 | nil |
| SP04695003 | 92.89 | 90.66 | 88.21 | F | VC | C | 150 | nil | 22.42 | nil |
| SP04695004 | 92.87 | 90.98 | 88.43 | S | VC | C | 225 | nil | 21.75 | nil |
| SP04695101 | 92.57 | 90.58 | 90.36 | S | CO | C | 375 | nil | 113.64 | nil |
| SP04695102 | 92.57 | 90.22 | 89.96 | F | VC | C | 150 | nil | 105.62 | nil |
| SP04695103 | 92.92 | 90.29 | 89.25 | S | CO | C | 375 | nil | 40.80 | nil |
| SP04695104 | 92.94 | 89.89 | 88.95 | F | VC | C | 150 | nil | 46.73 | nil |
| SP04695105 | 92.96 | 91.46 | 91.00 | S | VC | C | 225 | nil | 79.93 | nil |
| SP04695106 | 93.20 | 91.90 | 91.49 | S | VC | C | 225 | nil | 50.22 | nil |
| SP04695107 | 92.60 | 90.89 | 90.80 | S | CO | C | 375 | nil | 122.78 | nil |
| SP04695108 | 92.60 | 90.47 | 90.28 | F | VC | C | 150 | nil | 143.63 | nil |
| SP04695109 | 92.43 | 90.78 | 90.62 | S | CO | C | 375 | nil | 107.88 | nil |
| SP04695110 | 91.00 | 88.89 | 87.69 | F | VC | C | 150 | nil | 31.84 | nil |
| SP04695201 | 93.96 | 91.41 | 90.90 | S | CO | C | 375 | nil | 127.69 | nil |
| SP04695202 | 93.94 | 91.91 | 90.51 | F | VC | C | 150 | nil | 46.56 | nil |
| SP04695203 | 94.50 | 91.71 | 91.44 | S | CO | C | 375 | nil | 163.15 | nil |
| SP04695204 | 94.15 | 91.96 | 91.96 | F | VC | C | 150 | nil | 0.00 | nil |
| SP04695301 | 95.24 | 92.42 | 91.73 | S | CO | C | 375 | nil | 112.96 | nil |
| SP04695302 | 95.26 | 92.98 | 91.99 | F | VC | C | 150 | nil | 78.17 | nil |
| SP04696001 | 93.86 | 91.70 | 90.72 | F | VC | C | 150 | nil | 50.19 | nil |
| SP04696002 | 93.91 | 92.03 | 91.01 | S | VC | C | 225 | nil | 54.85 | nil |
| SP04696003 | nil | nil | 89.02 | S | VC | C | 225 | nil | 0.00 | nil |
| SP04696004 | 95.15 | 92.46 | 91.74 | F | VC | C | 150 | nil | 69.46 | nil |

LEGEND

- Abandoned Gravity Sewer
- Private Combined Gravity Sewer
- Private Foul Gravity Sewer
- Private Surface Water Gravity Sewer
- Public Combined Gravity Sewer
- Public Foul Gravity Sewer
- Public Surface Water Gravity Sewer
- Trunk Combined Gravity Sewer
- Trunk Foul Use Gravity Sewer
- Trunk Surface Water Gravity Sewer
- Combined Use Pressurised Sewer
- Foul Use Pressurised Sewer
- Surface Water Pressurised Sewer
- Highway Drain
- Combined Lateral Drain (SS)
- Foul Lateral Drain (SS)
- Surface Water Lateral Drain (SS)
- Culverted Watercourse
- Cable, Earthing
- Cable Junction
- Cable, Optical Fibre/Instrumentation
- Cable, Low Voltage
- Cable, High Voltage
- Cable, Other
- Housing, Building
- Housing, Kiosk
- Disposal Site
- Sewage Treatment Works
- Housing, Other
- Pipe Support Structure
- Sewage Pumping Facility
- Sewer Facility Connection Inlet / Outlet
- Blind Shaft
- Combined Use Manhole
- Flushing Chamber
- Foul Use Manhole
- Grease Trap
- Head Node
- Hydrobrake
- Lamphole
- Outfall
- Overflow
- Penstock
- Petrol Interceptor
- Sewer Chemical Injection Point
- Sewer Junction
- Sewerage Air Valve
- Sewerage Hatch Box Point
- Sewerage Isolation Valve
- Soakaway
- Surface Water Manhole
- Vent Column
- Waste Water Storage
- Pre-1937 Properties

TABULAR KEY
A. Sewer pipe data refers to downstream sewer pipe.
B. Where the node bifurcates (splits) X and Y indicates downstream sewer pipe.
C. Gradient is stated a 1 in...

MATERIALS

- NONE
- AC - ASBESTOS CEMENT
- BR - BRICK
- CC - CONCRETE BOX CULVERT
- CI - CAST IRON
- CO - CONCRETE
- CSB - CONCRETE SEGMENTS (BOLTED)
- CSU - CONCRETE SEGMENTS (UNBOLTED)
- DI - DUCTILE IRON
- GRC - GLASS REINFORCED CONCRETE
- GRP - GLASS REINFORCED PLASTIC
- MAC - MASONRY IN REGULAR COURSES
- MAR - MASONRY RANDOMLY COURSED
- PE - POLYETHYLENE
- PF - PITCH
- PP - POLYPROPYLENE
- PSC - PLASTIC STEEL COMPOSITE
- PVC - POLYVINYL CHLORIDE
- RPM - REINFORCED PLASTIC MATRIX
- SI - SPUN (GREY) IRON
- ST - STEEL
- U - UNKNOWN
- V - VITRIFIED CLAY
- XXX - OTHER

SHAPE

- C - CIRCULAR
- E - EGG SHAPED
- O - OTHER
- R - RECTANGLE
- S - SQUARE
- T - TRAPEZOIDAL
- U - UNKNOWN

PURPOSE

- C - COMBINED
- E - FINAL EFFLUENT
- F - FOUL
- L - SLUDGE
- S - SURFACE WATER

CATEGORIES

- W - WEIR
- C - CASCADE
- DB - DAMBOARD
- SE - SIDE ENTRY
- FV - FLAP VALVE
- BD - BACK DROP
- S - SIPHON
- HD - HIGHWAY DRAIN
- S104 - SECTION 104

SEVERN TRENT WATER

SEVERN TRENT WATER


Sewern Trent Water Limited
 Asset Data Management
 PO Box 5344
 Coventry
 CV3 9FT
 Telephone: 0845 601 6616

SEWER RECORD (Tabular)

O/S Map scale: 1:3000
Date of issue: 30.07.18
Sheet No.: 1 of 2

This map is centred upon:
O / S Grid reference:
x : 404502
y : 269311

Disclaimer Statement:
 1. Do not scale off this Map.
 2. This map and any information supplied with it is furnished as a general guide, is only valid at the date of issue and no warranty as to its correctness is given or implied. In particular this Map and any information shown on it must not be relied upon in the event of any development or works (including but not limited to excavations) in the vicinity of Severn Trent Water's assets or for the purposes of determining the suitability of a point of connection to the sewerage or distribution systems.
 3. On 1 October 2011 most private sewers and private lateral drains in Severn Trent Water's sewerage area, which were connected to a public sewer as at 1 July 2011, transferred to the ownership of Severn Trent Water and became public sewers and public lateral drains. A further transfer takes place on 1 October 2012 (date to be confirmed). Private pumping stations, which form part of these sewers or lateral drains, will transfer to the ownership of Severn Trent Water on or before 1 October 2016. Severn Trent Water does not possess complete records of these assets. These assets may not be displayed on this Map.
 4. Reproduction by permission of Ordnance Survey on behalf of HMSO. © Crown Copyright and database right 2004. All rights reserved. Ordnance Survey licence number 100018202. Document users other than Severn Trent Water business users are advised that this document is provided for reference purpose only and is subject to copyright, therefore, no further copies should be made from it.

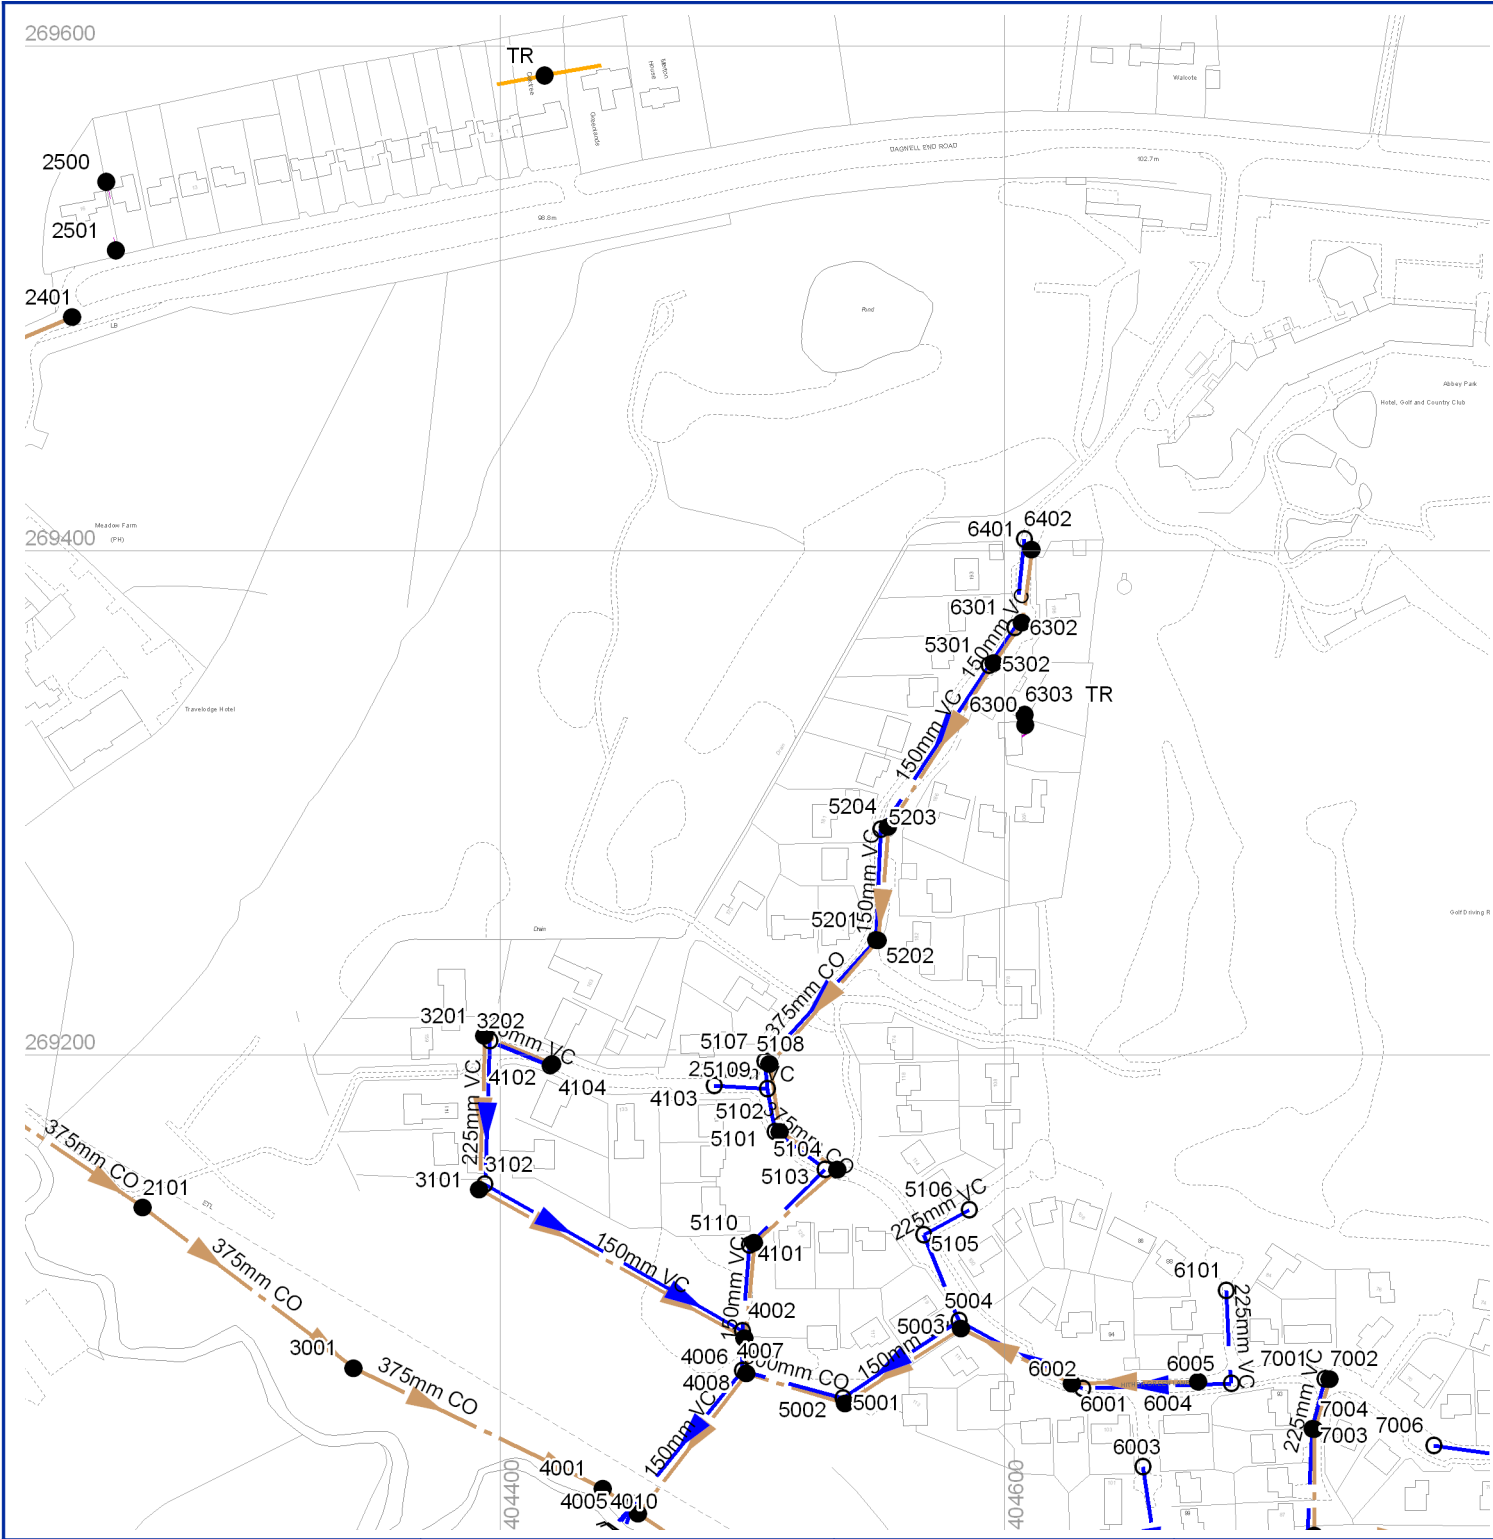

| Sewer Node | Sewer Pipe Data | | | | | | | | | |
|------------|-----------------|-----------------|-------------------|------|------|-------|----------|----------|----------|-----------|
| REFERENCE | COVER LEVEL | INV LEVEL UPSTR | INV LEVEL DOWNSTR | PURP | MATL | SHAPE | MAX SIZE | MIN SIZE | GRADIENT | YEAR LAID |
| SP04696005 | 95.50 | 92.91 | 92.03 | S | VC | C | 225 | nil | 67.08 | nill |
| SP04696101 | 94.92 | 93.37 | 92.99 | S | VC | C | 225 | nil | 97.50 | nill |
| SP04696300 | nil | nil | nil | F | PVC | C | 100 | nil | 0.00 | nill |
| SP04696301 | 95.45 | 92.67 | 92.51 | S | CO | C | 300 | nil | 112.69 | nill |
| SP04696302 | 95.49 | 93.16 | 92.99 | F | VC | C | 150 | nil | 114.24 | nill |
| SP04696401 | 96.21 | 93.57 | 93.18 | F | VC | C | 150 | nil | 75.05 | nill |
| SP04696402 | 96.16 | 92.88 | 92.69 | S | CO | C | 300 | nil | 185.42 | nill |
| SP04697001 | 94.45 | 92.14 | 92.07 | S | VC | C | 225 | nil | 294.57 | nill |
| SP04697002 | 94.38 | 92.49 | 92.32 | F | VC | C | 150 | nil | 122.82 | nill |
| SP04697003 | 94.12 | 92.03 | 88.66 | S | VC | C | 225 | nil | 13.07 | nill |
| SP04697004 | 94.06 | 92.29 | 90.17 | F | VC | C | 150 | nil | 19.81 | nill |
| SP04697006 | 91.27 | 88.97 | 88.49 | S | VC | C | 225 | nil | 90.46 | nill |

LEGEND

- Abandoned Gravity Sewer
- Private Combined Gravity Sewer
- Private Foul Gravity Sewer
- Private Surface Water Gravity Sewer
- Public Combined Gravity Sewer
- Public Foul Gravity Sewer
- Public Surface Water Gravity Sewer
- Trunk Combined Gravity Sewer
- Trunk Foul Use Gravity Sewer
- Trunk Surface Water Gravity Sewer
- Combined Use Pressurised Sewer
- Foul Use Pressurised Sewer
- Surface Water Pressurised Sewer
- Highway Drain
- Combined Lateral Drain (SS)
- Foul Lateral Drain (SS)
- Surface Water Lateral Drain (SS)

STRUCTURES

- Culverted Watercourse
- Cable, Earthing
- Cable Junction
- Cable, Optical Fibre/Instrumentation
- Cable, Low Voltage
- Cable, High Voltage
- Cable, Other
- Housing, Building
- Housing, Kiosk
- Disposal Site
- Sewage Treatment Works
- Housing, Other
- Pipe Support Structure
- Sewage Pumping Facility
- Sewer Facility Connection Inlet / Outlet

OTHER FEATURES

- Blind Shaft
- Combined Use Manhole
- Flushing Chamber
- Foul Use Manhole
- Grease Trap
- Head Node
- Hydrobrake
- Lamphole
- Outfall
- Overflow
- Penstock
- Petrol Interceptor
- Sewer Chemical Injection Point
- Sewer Junction
- Sewerage Air Valve
- Sewerage Hatch Box Point
- Sewerage Isolation Valve
- Soakaway
- Surface Water Manhole
- Vent Column
- Waste Water Storage
- Pre-1937 Properties

MATERIALS

- NONE
- AC - ASBESTOS CEMENT
- BR - BRICK
- CC - CONCRETE BOX CULVERT
- CI - CAST IRON
- CO - CONCRETE
- CSB - CONCRETE SEGMENTS (BOLTED)
- CSU - CONCRETE SEGMENTS (UNBOLTED)
- DI - DUCTILE IRON
- GRC - GLASS REINFORCED CONCRETE
- GRP - GLASS REINFORCED PLASTIC
- MAC - MASONRY IN REGULAR COURSES
- MAR - MASONRY RANDOMLY COURSED
- PE - POLYETHYLENE
- PF - PITCH
- PP - POLYPROPYLENE
- PSC - PLASTIC STEEL COMPOSITE
- PVC - POLYVINYL CHLORIDE
- RPM - REINFORCED PLASTIC MATRIX
- SI - SPUN (GREY) IRON
- ST - STEEL
- U - UNKNOWN
- VC - VITRIFIED CLAY
- XXX - OTHER

SHAPE

- C - CIRCULAR
- E - EGG SHAPED
- O - OTHER
- R - RECTANGLE
- S - SQUARE
- T - TRAPEZOIDAL
- U - UNKNOWN

PURPOSE

- C - COMBINED
- E - FINAL EFFLUENT
- F - FOUL
- L - SLUDGE
- S - SURFACE WATER

CATEGORIES

- W - WEIR
- C - CASCADE
- DB - DAMBOARD
- SE - SIDE ENTRY
- FV - FLAP VALVE
- BD - BACK DROP
- S - SIPHON
- HD - HIGHWAY DRAIN
- S104 - SECTION 104

TABULAR KEY

A. Sewer pipe data refers to downstream sewer pipe.

B. Where the node bifurcates (splits) X and Y indicates downstream sewer pipe.

C. Gradient is stated a 1 in...

Severn Trent Water Limited
Asset Data Management
PO Box 5344
Coventry
CV3 9FT
Telephone: 0845 601 6616

SEWER RECORD (Tabular)

O/S Map scale: 1:3000

Date of issue: 30.07.18

Sheet No. 2 of 2

This map is centred upon:

O / S Grid reference:

x : 404502

y : 269311

Disclaimer Statement:

1. Do not scale off this Map.

2. This map and any information supplied with it is furnished as a general guide, is only valid at the date of issue and no warranty as to its correctness is given or implied. In particular this Map and any information shown on it must not be relied upon in the event of any development or works (including but not limited to excavations) in the vicinity of Severn Trent Water's assets or for the purposes of determining the suitability of a point of connection to the sewerage or distribution systems.

3. On 1 October 2011 most private sewers and private lateral drains in Severn Trent Water's sewerage area, which were connected to a public sewer as at 1 July 2011, transferred to the ownership of Severn Trent Water and became public sewers and public lateral drains. A further transfer takes place on 1 October 2012 (date to be confirmed). Private pumping stations, which form part of these sewers or lateral drains, will transfer to the ownership of Severn Trent Water on or before 1 October 2016. Severn Trent Water does not possess complete records of these assets. These assets may not be displayed on this Map.

4. Reproduction by permission of Ordnance Survey on behalf of HMSO. © Crown Copyright and database right 2004. All rights reserved. Ordnance Survey licence number 100018202. Document users other than Severn Trent Water business users are advised that this document is provided for reference purpose only and is subject to copyright, therefore, no further copies should be made from it.

All Private Sewers are shown in magenta
 All section 104 sewers are shown in green
 All Sewers that have been transferred to Severn Trent Water after the 1st October 2011, but have not been surveyed and confirmed by Severn Trent Water are shown in orange

Appendix 8 – Severn Trent Water Existing Sewer Capacity Check

Liam Hyland

From: Network Solutions <Network.Solutions@severntrent.co.uk>
Sent: 16 September 2021 13:44
To: Mathew Grainger
Cc: Dave Baker
Subject: RE: Hither Green Lane (STW Ref ME/8320201) [Filed 20 Sep 2021 09:29]

Follow Up Flag: Follow up
Flag Status: Flagged

ST Classification: UNMARKED

Hi Mathew

Sorry for the delay in responding to your query. Envisage the flows from 216 houses (approx.. 3.38 l/s xDWF) may affect the existing performance of the network and therefore it will be necessary to undertake a sewer capacity assessment to understand the impact on the network and infrastructure further downstream.

Can you please confirm the following in order for us to prioritise the sewer capacity assessment and ensure that we can promote a growth scheme if necessary:

- Proposed submission of your Planning Application
- Proposed planned start and completion date.
- Any phasing details of the proposed development
- Planned occupation dates

Sadeq Hadi (Sid),
Senior Evaluation Technician,
Network Solutions,
Developer Services,
Network.solutions@severntrent.co.uk

WONDERFUL ON TAP



From: Mathew Grainger <mathew.grainger@travisbaker.co.uk>
Sent: 12 July 2021 12:35
To: Net Dev West <net.dev.west@severntrent.co.uk>
Cc: Dave Baker <dave.baker@travisbaker.co.uk>
Subject: Hither Green Lane (STW Ref ME/8320201)

Good Afternoon,

A development enquiry was carry out by Severn Trent Water on 30th July 2019, for the above named development. The enquiry states;

The overall development, for 114 properties will generate approximately, 1.7784 l/s (2xDWF). With a 50/50 split of the development, due to levels generating 0.8892 l/s, per 57 properties. The sewer records show a 375mm diameter foul water sewer, south of the site. In addition, they demonstrate a 150mm diameter foul sewer, within Hither Green Lane. I confirm that foul flows from a development with your suggested splitting of flows (57 to 375mm diameter

sewer and 57 to 150mm diameter sewer) should not have an adverse hydraulic impact on the aforementioned sewers.

The number of dwellings has now increased to 216 and our recent preliminary drainage design shows all the foul drainage discharging to the 375mm diameter foul water sewer in the south.

Are you able to confirm if the southern 375dia sewer has enough capacity for the 216 dwellings?

Kind Regards

Mathew Grainger
Associate

Travis Baker Limited
Trinity Point, New Road, Halesowen, West Midlands, B63 3HY

T. 0121 550 8037 DD. 0121 504 0910 W. <http://www.travisbaker.co.uk/>

Civil Engineering | Geo-Environmental Engineering | Structural Engineering | Transport Planning

This e-mail and its attachments may be confidential and are intended solely for the use of the individual to whom it is addressed. Any views or opinions expressed are solely those of the author and do not necessarily represent those of Travis Baker. If you are not the intended recipient of this e-mail and its attachments, you must take no action based upon them, nor must you copy or show them to anyone. Please contact the sender if you believe you have received this e-mail in error.

THINK GREEN: Do you need to print this e-mail?

Travis Baker is the trading name of:

Travis Baker Limited: Registered in England and Wales 05703678: VAT Registration 881 4949 79

Travis Baker Geo-Environmental Limited: Registered in England and Wales 09453821: VAT Registration 209 3190 23

Travis Baker Transport Planning Limited: Registered in England and Wales 08205643: VAT Registration 144 0064 53

Travis Baker East Midlands Limited: Registered in England and Wales 10239686: VAT Registration 250 9267 03

Registered Office: Trinity Point, New Road, Halesowen, West Midlands, B63 3HY

Severn Trent Plc (registered number 2366619) and Severn Trent Water Limited (registered number 2366686) (together the "Companies") are both limited companies registered in England & Wales with their registered office at Severn Trent Centre, 2 St John's Street, Coventry, CV1 2LZ This email (which includes any files attached to it) is not contractually binding on its own, is intended solely for the named recipient and may contain CONFIDENTIAL, legally privileged or trade secret information protected by law. If you have received this message in error please delete it and notify us immediately by telephoning +44 2477715000. If you are not the intended recipient you must not use, disclose, distribute, reproduce, retransmit, retain or rely on any information contained in this email. Please note the Companies reserve the right to monitor email communications in accordance with applicable law and regulations. To the extent permitted by law, neither the Companies or any of their subsidiaries, nor any employee, director or officer thereof, accepts any liability whatsoever in relation to this email including liability arising from any external breach of security or confidentiality or for virus infection or for statements made by the sender as these are not necessarily made on behalf of the Companies. Reduce waste! Please consider the environment before printing this email

Appendix 9 – Simple Index Assessments for SuDS features

| SUMMARY TABLE | | DESIGN CONDITIONS | | | |
|--|---|---|--|---|---|
| | | 1 | 2 | 3 | 4 |
| Land Use Type Pollution Hazard Level Pollution Hazard Indices TSS Metals Hydrocarbons | Residential parking Low 0.5 0.4 0.4 | | | | |
| SuDS components proposed | | | | | |
| Component 1 | Pond or wetland | SuDS components can only be assumed to deliver these indices if they follow design guidance with respect to hydraulics and treatment set out in the relevant technical component chapters of the SuDS Manual. See also checklists in Appendix B | Ponds/wetlands should be preceded by an upstream component(s) that trap(s) silt, or designed specifically to retain sediment in a separate zone, easily accessible for maintenance, such that the sediment will not be re-suspended in subsequent events | | |
| Component 2 | Pervious pavement (where the pavement is not designed as an infiltration component) | | | | |
| Component 3 | None | | | | |
| SuDS Pollution Mitigation Indices | | | | | |
| TSS Metals Hydrocarbons | >0.95 >0.95 0.85 | | | | |
| Groundwater protection type | None | | | | |
| Groundwater protection Pollution Mitigation Indices | | | | | |
| TSS Metals Hydrocarbons | 0 0 0 | | | | |
| Combined Pollution Mitigation Indices | | Reference to local planning documents should also be made to identify any additional protection required for sites due to habitat conservation (see Chapter 7 The SuDS design process). The implications of developments on or within close proximity to an area with an environmental designation, such as a Site of Special Scientific Interest (SSSI), should be considered via consultation with relevant conservation bodies such as Natural England | | | |
| TSS Metals Hydrocarbons | >0.95 >0.95 0.85 | | | | |
| Acceptability of Pollution Mitigation | | | | | |
| TSS Metals Hydrocarbons | Sufficient Sufficient Sufficient | | | | |

| SUMMARY TABLE | | DESIGN CONDITIONS | | | |
|--|--|---|--|---|---|
| | | 1 | 2 | 3 | 4 |
| Land Use Type Pollution Hazard Level Pollution Hazard Indices TSS Metals Hydrocarbons | Low traffic roads (e.g. residential roads and general access roads, < 300 traffic movements/day) Low 0.5 0.4 0.4 | | | | |
| SuDS components proposed | | SuDS components can only be assumed to deliver these indices if they follow design guidance with respect to hydraulics and treatment set out in the relevant technical component chapters of the SuDS Manual. See also checklists in Appendix B | Ponds/wetlands should be preceded by an upstream component(s) that trap(s) silt, or designed specifically to retain sediment in a separate zone, easily accessible for maintenance, such that the sediment will not be re-suspended in subsequent events | | |
| Component 1 | Pond or wetland | | | | |
| Component 2 | None | | | | |
| Component 3 | None | | | | |
| SuDS Pollution Mitigation Indices | | | | | |
| | | 0.7 | | | |
| | | 0.7 | | | |
| | | 0.5 | | | |
| Groundwater protection type | None | | | | |
| Groundwater protection Pollution Mitigation Indices | | | | | |
| | | 0 | | | |
| | | 0 | | | |
| | | 0 | | | |
| Combined Pollution Mitigation Indices | | | | | |
| | | 0.7 | | | |
| | | 0.7 | | | |
| | | 0.5 | | | |
| Acceptability of Pollution Mitigation | | Reference to local planning documents should also be made to identify any additional protection required for sites due to habitat conservation (see Chapter 7 The SuDS design process). The implications of developments on or within close proximity to an area with an environmental designation, such as a Site of Special Scientific Interest (SSSI), should be considered via consultation with relevant conservation bodies such as Natural England | | | |
| | Sufficient | | | | |
| | Sufficient | | | | |
| | Sufficient | | | | |

| SUMMARY TABLE | | DESIGN CONDITIONS | | | |
|--|---|---|--|---|---|
| | | 1 | 2 | 3 | 4 |
| Land Use Type Pollution Hazard Level Pollution Hazard Indices TSS Metals Hydrocarbons | Residential roofing Very low 0.2 0.2 0.05 | | | | |
| SuDS components proposed | | SuDS components can only be assumed to deliver these indices if they follow design guidance with respect to hydraulics and treatment set out in the relevant technical component chapters of the SuDS Manual. See also checklists in Appendix B | Ponds/wetlands should be preceded by an upstream component(s) that trap(s) silt, or designed specifically to retain sediment in a separate zone, easily accessible for maintenance, such that the sediment will not be re-suspended in subsequent events | | |
| Component 1 | Pond or wetland | | | | |
| Component 2 | None | | | | |
| Component 3 | None | | | | |
| SuDS Pollution Mitigation Indices | | | | | |
| TSS | | 0.7 | | | |
| Metals | | 0.7 | | | |
| Hydrocarbons | | 0.5 | | | |
| Groundwater protection type | None | | | | |
| Groundwater protection Pollution Mitigation Indices | | | | | |
| TSS | 0 | | | | |
| Metals | 0 | | | | |
| Hydrocarbons | 0 | | | | |
| Combined Pollution Mitigation Indices | | 0.7 Reference to local planning documents should also be made to identify any additional protection required for sites due to habitat conservation (see Chapter 7 The SuDS design process). The implications of developments on or within close proximity to an area with an environmental designation, such as a Site of Special Scientific Interest (SSSI), should be considered via consultation with relevant conservation bodies such as Natural England 0.7 0.5 | | | |
| TSS | | | | | |
| Metals | | | | | |
| Hydrocarbons | | | | | |
| Acceptability of Pollution Mitigation | | | | | |
| TSS | Sufficient | | | | |
| Metals | Sufficient | | | | |
| Hydrocarbons | Sufficient | | | | |

Appendix 10 – NWWM (LLFA) response

21/01830/FUL - Land West Of Hither Green Lane

Residential development (Class C3) with a vehicular access point onto Hither Green Lane, play areas, public open space including footways and cycleways, sustainable urban drainage systems and all other ancillary and enabling infrastructure.

Case Officer: Paul Lester

Deadline for comments: 11/02/2022



Comments

While NWWM is broadly supportive of the principle of development on this site, based on the current proposal for the site there are a several elements that are contrary to policies 17&18 of the Redditch Local Plan. We would raise a **Holding Objection** to this application until the proposed drainage layout is revised and it addresses concerns raised in the following comments.

The site is located within the catchment of the River Arrow, the site slopes gently from the north east to the south west. Environment Agency fluvial mapping indicates that the site is located mainly within Flood Zone 1, but small areas of the southern part of the site, adjacent to the Arrow, are covered by zones 2 and 3. The EA surface water flood maps show some minor pooling on the site and this is concentrated around existing

drainage features. The supporting FRA suitably covers the main sources of flood risk to the site and concludes that the development site is not at significant flood risk.

There are a series of existing ditchlines which current drain the site. Principally there are two main features one which runs approximately down the centre of the site and a second which follows along the eastern site boundary. There are also several existing ponds located on the site. The largest in the north western part of the site as well as another smaller features on the eastern side. The topographical survey in the FRA does not cover the south eastern part of the site, so it is unclear on the exact details of other features in this part of the site, however a total of 4 ponds have been identified in the preliminary ecological assessment.

Within the FRA an outline drainage strategy has been proposed, the proposed level of retention is acceptable (up to 1 in 100 year AEP + 40% for climate change) and the proposed off site discharge rate is acceptable. However, beyond surface water attenuation the proposed drainage scheme provides minimal further benefits. Calculations for the scheme have been provided, however they have not been assessed as they will need to be revised to accommodate revisions to the drainage layout if the scheme to be acceptable to the LLFA.

The current layout does not suitably consider existing drainage features/ water features and all but the northern pond have been lost. The supplied green space assessment flags the benefits of the existing water features and the ecology report highlights that development proposals should seek to retain/ minimise losses of the standing water habitats. Features should be retained and incorporated by the proposed layout not simply removed. The housing layout should be set around these features, it is likely there could be water nuisance issues for new properties built in the location of former features.

While it is retained northern pond is surrounded by new development which is all proposed to be positively drained and bypass this feature. The result of this is likely the pond will dry up as much of its, already limited catchment area, is lost. The other ponds on the site have not be retained or utilised in the drainage layout.

The use of a single retention feature which is located on the periphery of the development will limit benefits with respect to water quality and amenity. It does include permanent water, which is positive however this it uniformly deep, natural ponds provide a mixture of depth profiles. There are no source control SuDS features provided by the scheme. Features such as permeable paving or drained tree pits should be incorporated into the design.

The site should be split into its natural catchment areas and a series of smaller retention features should be proposed. With the appropriate inclusion of source control features this should ensure there is still suitable attenuation volume provided by the scheme. These features should be incorporated into open space areas so that they provide amenity value. Pedestrian routes can be provided adjacent swales to provide green corridors through the development.

There is minimal reference to water quality for surface water runoff from the site. The stages of treatment approach previously detailed by the CIRIA SuDS manual was amended in the 2015 manual to the Simple Index approach. While the majority of the land uses on the site are classed as low risk it is required that this approach is applied, and mitigation measures are included within the drainage design as appropriate.

It is unclear from STW records if or where the adjacent Meadow Farm pub is connected to mains sewer for foul or surface water. It needs to be ensured that any existing drainage arrangements for this property which cross the development site should be picked up by the new drainage provided for the development to ensure that it does not negatively affect the property or the proposed development.

In summary the proposed drainage scheme offers limited benefits to the site beyond surface water attenuation. The following alterations will need to be implemented if this scheme is to be acceptable to the LLFA.

- Preserve existing drainage features and incorporate them into the layout and site landscaping
- Provide attenuation to separate sub catchments of the site rather than single large feature.
- Provide source control measures for the site.
- Undertake a Simple Index Assessment for site runoff water quality.

Dave Baker

To: Dave Baker
Subject: FW: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

From: Jodie Hawkins <jodie.hawkins@nwwm.org.uk>
Sent: 28 October 2022 19:28
To: Green, David (Mercia) <david.green@barratthomes.co.uk>
Subject: RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Hi David,

I have reviewed the revised drainage strategy and can see that you have rerouted the pavement. Secondly, if you are confirming that you have incorporated the second point from my previous email, I can confirm that I am happy with the latest drainage strategy.

Kind regards,
Jodie



Jodie Hawkins
Senior Water Management Officer
North Worcestershire Water Management
A shared District Council service covering Bromsgrove, Redditch & Wyre Forest
01562 732545
Wyre Forest House, Finepoint Way, Kidderminster, DY11 7WF
Jodie.Hawkins@nwwm.org.uk

Keep up to date on the latest news via  [NorthWorcsflooding](#)



Our vision is to reduce flood risk while protecting and enhancing the water environment and encouraging sustainable water management

From: Green, David (Mercia) <david.green@barratthomes.co.uk>
Sent: 27 October 2022 11:38
To: Jodie Hawkins <jodie.hawkins@nwwm.org.uk>
Cc: Solanki, Chetan <chetan.solanki@barratthomes.co.uk>
Subject: External Email : RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Good morning Jodie

Are you happy with the drainage strategy now, please confirm.

Regards

David Green

Senior Technical Manager

BARRATT HOMES | DAVID WILSON HOMES

(trading names of BDW Trading Limited)

Mercia Division | Remus 2 | 2 Cranbrook Way | Solihull | B90 4GT

Tel 0121 713 7310 : DD 0121 713 7385 : M 07342 062783



DAVID WILSON HOMES
WHERE QUALITY LIVES



From: Green, David (Mercia)

Sent: 11 October 2022 09:34

To: Jodie Hawkins <jodie.hawkins@nwwm.org.uk>

Cc: Solanki, Chetan <chetan.solanki@barratthomes.co.uk>

Subject: RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Good morning Jodie, I trust you are well.

I attach the revised drainage strategy drawings for your approval. Firstly I can confirm that the items below were already incorporated into the scheme. Secondly, following comments from the tree officer we have reduced the number of plots (around plots 136-140) that does not affect the drainage strategy and have moved the inlet and outlets of the southern pond to reduce the effect on surrounding trees. Again this doesn't impact on the drainage strategy itself.

I would be grateful if you could confirm by return that you are happy with the scheme and will advise the planning officer accordingly.

Regards

David Green

Senior Technical Manager

BARRATT HOMES | DAVID WILSON HOMES

(trading names of BDW Trading Limited)

Mercia Division | Remus 2 | 2 Cranbrook Way | Solihull | B90 4GT

Tel 0121 713 7310 : DD 0121 713 7385 : M 07342 062783



DAVID WILSON HOMES
WHERE QUALITY LIVES



From: Jodie Hawkins <jodie.hawkins@nwwm.org.uk>

Sent: 22 September 2022 16:00

To: Green, David (Mercia) <david.green@barratthomes.co.uk>

Cc: Solanki, Chetan <chetan.solanki@barratthomes.co.uk>

Subject: RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Hi David,

Apologies it has taken me longer to get back to you than I hoped. I have gone through all your previous correspondence with Tom and can see you have incorporated some of additional things he asked for.

One thing that I did notice hadn't changed the re-route of the pavement with regards to Tom's previous comment...

“The depression that will serve plots 17-20, 204, 214-216 looks to be sitting over the route of a path obviously that will just need to be routed round this”.

Can you also confirm if you have incorporated Tom’s comment about permeable paving?...

“With respect to the proposed permeable paving the attached detail is one we have specified on another site recently. The last detail would be how we would want the adjacent properties to have their downpipes connected to the paving, then there would need to be an under drained sump which then connects to the adopted sewer.”

Kind regards,
Jodie

Jodie Hawkins

Water Management Officer
North Worcestershire Water Management
A shared District Council service covering Bromsgrove, Redditch & Wyre Forest
01562 732545
Wyre Forest House, Finepoint Way, Kidderminster, DY11 7WF
Jodie.Hawkins@nwwm.org.uk



Keep up to date on the latest news via  [NorthWorcsflooding](#)



Our vision is to reduce flood risk while protecting and enhancing the water environment and encouraging sustainable water management

From: Green, David (Mercia) <david.green@barratthomes.co.uk>

Sent: 05 September 2022 08:37

To: Jodie Hawkins <jodie.hawkins@nwwm.org.uk>

Cc: Solanki, Chetan <chetan.solanki@barratthomes.co.uk>

Subject: External Email : RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Hi Jodie, thanks for coming back to me.

Hopefully you should be able to see that we have been in correspondence with Tom over the last couple of months and have incorporated additional SUDs features throughout the scheme. Hopefully you will be happy with what we have done and I attach the latest drainage strategy drawings sent to Tom.

Don't hesitate to contact me should you have any further questions.

Regards

David Green

Senior Technical Manager

BARRATT HOMES | DAVID WILSON HOMES

(trading names of BDW Trading Limited)

Mercia Division | Remus 2 | 2 Cranbrook Way | Solihull | B90 4GT

Tel 0121 713 7310 : DD 0121 713 7385 : M 07342 062783



From: Jodie Hawkins <jodie.hawkins@nwwm.org.uk>
Sent: 02 September 2022 15:35
To: Green, David (Mercia) <david.green@barratthomes.co.uk>
Subject: RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Good afternoon,

I am the officer taking over from Tom. If you allow some time to catch up on this application, I will try get and get back to you with a response early next week. In the meantime, if there is anything else, please feel free to contact me.

Kind regards,
Jodie

Jodie Hawkins

Water Management Officer
North Worcestershire Water Management
A shared District Council service covering Bromsgrove, Redditch & Wyre Forest
01562 732545
Wyre Forest House, Finepoint Way, Kidderminster, DY11 7WF
Jodie.Hawkins@nwwm.org.uk



Keep up to date on the latest news via  [NorthWorcsflooding](#)



Our vision is to reduce flood risk while protecting and enhancing the water environment and encouraging sustainable water management

From: North Worcestershire Water Management Enquiries <Enquiries@nwwm.org.uk>
Sent: 02 September 2022 15:21
To: Jodie Hawkins <jodie.hawkins@nwwm.org.uk>
Subject: FW: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

North Worcestershire Water Management Enquiries

Wyre Forest District Council
A shared District Council service covering Bromsgrove, Redditch & Wyre Forest
01562 732191
Wyre Forest House, Finepoint Way, Kidderminster, DY11 7WF
Enquiries@nwwm.org.uk



Keep up to date on the latest news via  [NorthWorcsflooding](#)

Our vision is to reduce flood risk while protecting and enhancing the water environment and encouraging sustainable water management

From: Green, David (Mercia) <david.green@barratthomes.co.uk>
Sent: 02 September 2022 10:31
To: North Worcestershire Water Management Enquiries <Enquiries@nwwm.org.uk>
Subject: External Email : RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Good morning, can you please ask the relevant officer to make contact with me please

Regards

David Green
Senior Technical Manager

BARRATT HOMES | DAVID WILSON HOMES
(trading names of BDW Trading Limited)
Mercia Division | Remus 2 | 2 Cranbrook Way | Solihull | B90 4GT
Tel 0121 713 7310 : DD 0121 713 7385 : M 07342 062783



From: Green, David (Mercia)
Sent: 24 August 2022 14:58
To: enquiries@nwwm.org.uk
Subject: FW: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Good afternoon

Can you please ask the person taking over from Tom please acknowledge receipt of the attached and confirm their approval or otherwise asap.

Thank you

David Green
Senior Technical Manager

BARRATT HOMES | DAVID WILSON HOMES
(trading names of BDW Trading Limited)
Mercia Division | Remus 2 | 2 Cranbrook Way | Solihull | B90 4GT
Tel 0121 713 7310 : DD 0121 713 7385 : M 07342 062783



From: Green, David (Mercia)
Sent: 23 August 2022 13:58
To: Thomas Curwell <Thomas.Curwell@nwwm.org.uk>
Subject: FW: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Hi Tom

Please find attached revised drainage strategy drawings incorporating the additional features that you requested. I trust they meet with your approval but should you require any further information please do not hesitate to contact me.

Regards

David Green
Senior Technical Manager

BARRATT HOMES | DAVID WILSON HOMES

(trading names of BDW Trading Limited)

Mercia Division | Remus 2 | 2 Cranbrook Way | Solihull | B90 4GT

Tel 0121 713 7310 : DD 0121 713 7385 : M 07342 062783



From: Dave Baker <dave.baker@travisbaker.co.uk>
Sent: 12 August 2022 12:03
To: Green, David (Mercia) <david.green@barratthomes.co.uk>
Cc: Matthew Nobbs <matthew.nobbs@travisbaker.co.uk>
Subject: RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Hi David

Please see attached amended drainage strategy drawings.

Kind regards

Dave Baker
Director

Travis Baker Limited
Trinity Point, New Road, Halesowen, West Midlands, B63 3HY

T. 0121 550 8037 M. 07792 970492 <http://www.travisbaker.co.uk/>

Civil Engineering | Geo-Environmental Engineering | Structural Engineering | Transport Planning

This e-mail and its attachments may be confidential and are intended solely for the use of the individual to whom it is addressed. Any views or opinions expressed are solely those of the author and do not necessarily represent those of Travis Baker. If you are not the intended recipient of this e-mail and its attachments, you must take no action based upon them, nor must you copy or show them to anyone. Please contact the sender if you believe you have received this e-mail in error.

THINK GREEN: Do you need to print this e-mail?

Travis Baker is the trading name of:

Travis Baker Limited: Registered in England and Wales 05703678: VAT Registration 881 4949 79

Travis Baker Geo-Environmental Limited: Registered in England and Wales 09453821: VAT Registration 209 3190 23

From: Green, David (Mercia) <david.green@barratthomes.co.uk>
Sent: 05 August 2022 08:21
To: Dave Baker <dave.baker@travisbaker.co.uk>
Cc: Solanki, Chetan <chetan.solanki@barratthomes.co.uk>
Subject: FW: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch [Filed 12 Aug 2022 10:22]

Hi Dave

Are we able to comply with Tom's suggestions below, if so can you update the drainage strategy.

Regards

David Green
Senior Technical Manager

BARRATT HOMES | DAVID WILSON HOMES
(trading names of BDW Trading Limited)
Mercia Division | Remus 2 | 2 Cranbrook Way | Solihull | B90 4GT
Tel 0121 713 7310 : DD 0121 713 7385 : M 07342 062783



From: Thomas Curwell <Thomas.Curwell@nwwm.org.uk>
Sent: 04 August 2022 19:26
To: Green, David (Mercia) <david.green@barratthomes.co.uk>
Cc: Solanki, Chetan <chetan.solanki@barratthomes.co.uk>
Subject: RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Dear David

Sorry for being so slow to come back to you on this. I have been trying to speak to the planning officer at Redditch this week but he has been on leave all week and isn't back till Monday. I have reviewed the revised details you sent over. I think given the limitations of severn trent allowing land drainage to their network and the issues of the invasive species we will have to accept the larger pond not being connected to the network. The additional features you have added are welcome, however can you clarify, is the intention that the surface water ,i.e. downpipes from properties will discharge to these features before draining to the sewer network? If so can you just indicate this clearly on the drawing.

The depression that will serve plots 17-20, 204, 214-216 looks to be sitting over the route of a path obviously that will just need to be routed round this.

With respect to the proposed permeable paving the attached detail is one we have specified an another site recently. The last detail would be how we would want the adjacent properties to have their downpipes connected to the paving, then there would need to be an under drained sump which then connects to the adopted sewer.

If you can confirm these details I can speak to the planning officer next week and provide some updated comments and conditions we would require.

Happy to discuss further if required.

Regards,

Thomas Curwell BSc, MSc, PhD

Water Management Engineer

North Worcestershire Water Management

A shared District Council service covering Bromsgrove, Redditch & Wyre Forest

01527 881206 / 07929305921

Wyre Forest House, Finepoint Way, Kidderminster, DY11 7WF

Thomas.Curwell@nwwm.org.uk

Please note my workdays are Redditch & Bromsgrove: Monday - Wednesday & Friday/ Wyre Forest: Thursday.



Keep up to date on the latest news via  [NorthWorcsflooding](#)



Our vision is to reduce flood risk while protecting and enhancing the water environment and encouraging sustainable water management

From: Green, David (Mercia) <david.green@barratthomes.co.uk>

Sent: 02 August 2022 09:28

To: Thomas Curwell <Thomas.Curwell@nwwm.org.uk>

Cc: Solanki, Chetan <chetan.solanki@barratthomes.co.uk>

Subject: External Email : RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

This email originated from outside of the organisation

STOP : Were you expecting this email? Does it look genuine?

THINK : Before you **CLICK** on any links or **OPEN** any attachments.

Good morning Tom

Have you had chance to review the revised submission and if so are you happy with the proposals now?

Regards

David Green

Senior Technical Manager

BARRATT HOMES | DAVID WILSON HOMES

(trading names of BDW Trading Limited)

Mercia Division | Remus 2 | 2 Cranbrook Way | Solihull | B90 4GT

Tel 0121 713 7310 : DD 0121 713 7385 : M 07342 062783



BARRATT
HOMES



DAVID WILSON HOMES

WHERE QUALITY LIVES



From: Solanki, Chetan <chetan.solanki@barratthomes.co.uk>

Sent: 05 July 2022 17:27

To: Green, David (Mercia) <david.green@barratthomes.co.uk>; Thomas Curwell <Thomas.Curwell@nwwm.org.uk>

Subject: RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Hi Thomas,

Hope you're well.

Following your conversation with Dave Baker please find attached a revised set of drainage drawings – the FRA will be amended subject to your approval of these drawings.

I have also attached a statement from our ecologist outlining why it is not feasible to incorporate the large pond to the north of the site.

Is there anything further you need in order to lift your holding objection?

Kind regards,

Chet

Chetan Solanki
Planning Manager

Barratt David Wilson Homes (Mercia)
(a trading name of BDW Trading Ltd)

Remus 2 | 2 Cranbrook Way | Solihull Business Park | Solihull | West Midlands | B90 4GT

E: chetan.solanki@barratthomes.co.uk | DD: 0121 713 7310 | M: 07464 511 484



BARRATT
HOMES



DAVID WILSON HOMES
WHERE QUALITY LIVES

From: Green, David (Mercia) <david.green@barratthomes.co.uk>

Sent: 29 June 2022 16:32

To: Thomas Curwell <Thomas.Curwell@nwwm.org.uk>

Cc: Solanki, Chetan <chetan.solanki@barratthomes.co.uk>

Subject: RE: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

Thanks Tom, it's New Zealand Pigmy weed in the large pond that our ecologist advise:

6.5 INVASIVE PLANT SPECIES

The desk study provided no records of invasive plant species within a 1 km radius of the survey area. The invasive plant species New Zealand pigmyweed was identified within the lake on site. This species is listed on Schedule 9 of the Wildlife and Countryside Act 1981 (as amended), and it is therefore an offence to allow it to spread in the wild. Works near to the pond may cause this species to spread. Therefore, invasive plant species are a notable consideration for the proposed development and a recommendation has been made in Section 7.4.

We'll elaborate more in our resubmission.

I've asked Travis Baker to come up with some ideas and our arboriculturalist to give a view on any tree removal that might be needed to deliver the SUDs features. I'm away for a fortnight but our planning manager, Chetan Solanki, will co-ordinate matters in my absence as I would aim to get something back to you that you can support before my return.

Regards

David Green
Senior Technical Manager

BARRATT HOMES | DAVID WILSON HOMES

(trading names of BDW Trading Limited)

Mercia Division | Remus 2 | 2 Cranbrook Way | Solihull | B90 4GT

Tel 0121 713 7310 : DD 0121 713 7385 : M 07342 062783



From: Thomas Curwell <Thomas.Curwell@nwwm.org.uk>
Sent: 29 June 2022 15:49
To: Green, David (Mercia) <david.green@barratthomes.co.uk>
Subject: *EXTERNAL: 21/01830/FUL - Land West Of Hither Green Lane, Redditch

EXTERNAL EMAIL WARNING



Please do not click on LINKS or ATTACHMENTS where you are unsure of its origin. In such cases delete the email.


Hi David,

Following our conversation today regarding the above site these are my contact details.

Regards,

Thomas Curwell BSc, MSc, PhD
Water Management Engineer
North Worcestershire Water Management
A shared District Council service covering Bromsgrove, Redditch & Wyre Forest
01527 881206 / 07929305921
Wyre Forest House, Finepoint Way, Kidderminster, DY11 7WF
Thomas.Curwell@nwwm.org.uk
Please note my workdays are Redditch & Bromsgrove: Monday - Wednesday & Friday/ Wyre Forest: Thursday.



Keep up to date on the latest news via  [NorthWorcsflooding](#)



Our vision is to reduce flood risk while protecting and enhancing the water environment and encouraging sustainable water management

Confidentiality Notice

These details do not constitute an electronic signature. Wyre Forest District Council does not accept service of documents by email. This communication and any attachment may contain confidential and privileged information. If the email has been sent to you in error you may not disclose its content to anyone else or copy or forward it in any form. Please notify the sender about this error and delete this email. No employee or agent is authorised to conclude any binding agreement on behalf of Wyre Forest District Council with another party by email.

Disclaimer

Although this email and attachments have been scanned for viruses and malware, Wyre Forest District Council accepts no liability for any loss or damage arising from the receipt or use of this communication.

Monitoring of Email

Wyre Forest District Council may monitor traffic data and the content of email for lawful business purposes.

The sender of this e-mail is a member of the Barratt Developments PLC group of companies, the ultimate parent of which is Barratt Developments PLC (company number 00604574). Barratt Developments PLC is registered in England and Wales with its registered office at Barratt House, Cartwright Way, Forest Business Park, Bardon Hill, Coalville, Leicestershire LE67 1UF, together with its principal subsidiaries BDW Trading Limited (03018173), and Wilson Bowden Developments Limited (00948402). Barratt Homes, Barratt London and David Wilson Homes are trading names of BDW Trading Limited. This e-mail message is meant only for use by the intended addressee and may contain privileged and/or confidential information. If you have received this message in error please notify us and remove it from your system. Please view our 'Email Addendum v2.0' at www.barrattcommercialsupport.co.uk/barratt-developments-plc-email-a for further details.

The sender of this e-mail is a member of the Barratt Developments PLC group of companies, the ultimate parent of which is Barratt Developments PLC (company number 00604574). Barratt Developments PLC is registered in England and Wales with its registered office at Barratt House, Cartwright Way, Forest Business Park, Bardon Hill, Coalville, Leicestershire LE67 1UF, together with its principal subsidiaries BDW Trading Limited (03018173), and Wilson Bowden Developments Limited (00948402). Barratt Homes, Barratt London and David Wilson Homes are trading names of BDW Trading Limited. This e-mail message is meant only for use by the intended addressee and may contain privileged and/or confidential information. If you have received this message in error please notify us and remove it from your system. Please view our 'Email Addendum v2.0' at www.barrattcommercialsupport.co.uk/barratt-developments-plc-email-a for further details.

The sender of this e-mail is a member of the Barratt Developments PLC group of companies, the ultimate parent of which is Barratt Developments PLC (company number 00604574). Barratt Developments PLC is registered in England and Wales with its registered office at Barratt House, Cartwright Way, Forest Business Park, Bardon Hill, Coalville, Leicestershire LE67 1UF, together with its principal subsidiaries BDW Trading Limited (03018173), and Wilson Bowden Developments Limited (00948402). Barratt Homes, Barratt London and David Wilson Homes are trading names of BDW Trading Limited. This e-mail message is meant only for use by the intended addressee and may contain privileged and/or confidential information. If you have received this message in error please notify us and remove it from your system. Please view our 'Email Addendum v2.0' at www.barrattcommercialsupport.co.uk/barratt-developments-plc-email-a for further details.

The sender of this e-mail is a member of the Barratt Developments PLC group of companies, the ultimate parent of which is Barratt Developments PLC (company number 00604574). Barratt Developments PLC is registered in England and Wales with its registered office at Barratt House, Cartwright Way, Forest Business Park, Bardon Hill, Coalville, Leicestershire LE67 1UF, together with its principal subsidiaries BDW Trading Limited (03018173), and Wilson Bowden Developments Limited (00948402). Barratt Homes, Barratt London and David Wilson Homes are trading names of BDW Trading Limited. This e-mail message is meant only for use by the intended addressee and may contain privileged and/or confidential information. If you have received this message in error please notify us and remove it from your system. Please view our 'Email Addendum v2.0' at www.barrattcommercialsupport.co.uk/barratt-developments-plc-email-a for further details.

The sender of this e-mail is a member of the Barratt Developments PLC group of companies, the ultimate parent of which is Barratt Developments PLC (company number 00604574). Barratt Developments PLC is registered in England and Wales with its registered office at Barratt House, Cartwright Way, Forest Business Park, Bardon Hill, Coalville, Leicestershire LE67 1UF, together with its principal subsidiaries BDW Trading Limited (03018173), and Wilson Bowden Developments Limited (00948402). Barratt Homes, Barratt London and David Wilson Homes are trading names of BDW Trading Limited. This e-mail message is meant only for use by the intended addressee and may contain privileged and/or confidential information. If you have received this message in error please notify us and remove it from your

system. Please view our 'Email Addendum v2.0' at www.barrattcommercialsupport.co.uk/barratt-developments-plc-email-a for further details.

The sender of this e-mail is a member of the Barratt Developments PLC group of companies, the ultimate parent of which is Barratt Developments PLC (company number 00604574). Barratt Developments PLC is registered in England and Wales with its registered office at Barratt House, Cartwright Way, Forest Business Park, Bardon Hill, Coalville, Leicestershire LE67 1UF, together with its principal subsidiaries BDW Trading Limited (03018173), and Wilson Bowden Developments Limited (00948402). Barratt Homes, Barratt London and David Wilson Homes are trading names of BDW Trading Limited. This e-mail message is meant only for use by the intended addressee and may contain privileged and/or confidential information. If you have received this message in error please notify us and remove it from your system. Please view our 'Email Addendum v2.0' at www.barrattcommercialsupport.co.uk/barratt-developments-plc-email-a for further details.